THE CITY OF Fitchburg City of Fitchburg Planning/Zoning Department 5520 Lacy Road Fitchburg, WI 53711 (608-270-4200)	**ARCHITECTURAL & DESIGN REVIEW APPLICATION**

Applicant/Contact Person: Woronora Ventures LLC / Edward Hoyt

Address: 3101 Fish Hatchery Road #411 **Phone Number of Contact Person:** 608-949-2151

City, State, Zip Code: Fitchburg, WI, 53713 **Email of Contact Person:** ned@happenstancegroup.com

Project Address: 2622 Blaney Road , Fitchburg WI **Lot:** 8 **Subdivision:** Hartung Fields

Project Type: X **Multi-Family** N/A **Commercial** N/A **Industrial** N/A **Other**

X **New** N/A **Addition**

Impervious Surface Ratio (ISR): 83.4% (City Standard: maximum 65% ISR)

All items listed below must be included with the application to be considered complete. If an item is not included with the application, the applicant must provide in writing the basis for not including it. Building and site plans submitted to the Fitchburg Plan Commission for architectural and design review shall contain the following information:

Site Data:

- ☒ 1. Lot or property dimensions.
- ☒ 2. Orientation (to north).
- ☒ 3. Adjacent highways, roads, drive, etc.
- ☒ 4. Existing natural features (rivers, ponds, wetlands).
- ☒ 5. Existing buildings and/or improvements.
- ☒ 6. Existing and proposed site drainage.
- ☒ 7. Utility plans, including main/lateral sizes and existing fire hydrants on site or within 300 feet of the site
- ☒ 8. ISR shall be indicated on all plans.
- ☒ 9. Stormwater management plans and details, including grading plan.
- ☒ 10. Lighting plan in footcandles and light fixture cut sheets.

Building:

- ☒ 1. Building size, configuration and orientation.
- ☒ 2. Distance from lot lines.
- ☒ 3. Distance from other buildings, improvements and natural features.
- ☒ 4. Location of well, septic tank, drainfield, etc. (if applicable)
- ☒ 5. Additional proposed additions or new structures, including trash/recycling enclosure(s).
- ☒ 6. Construction type (wood frame, structural steel, etc.).
- ☒ 7. Foundation type (full basement, slab on grade, etc.).
- ☒ 8. Number of levels.
- ☒ 9. Siding/exterior covering type, color, texture, etc.
- ☒ 10. Roof type (gable, hip, shed, flat, etc.) and pitch.
- ☒ 11. Roofing material type, color, texture, etc.
- ☒ 12. Exterior door and window location, size, type, etc.
- ☒ 13. Fire protection sprinklers or fire alarm systems.

Ingress, Egress, Parking:

- ☒ 1. Location of highway and road access points.
- ☒ 2. Location, size, configuration of drivers and walks.
- ☒ 3. Number, size, location of parking spaces.
- ☒ 4. Location of handicapped parking and accessible building entrances.
- ☒ 5. Bicycle rack(s).

Landscaping:

- [8] 1. Location, species, size of existing trees, shrubs, and plantings.
- [8] 2. Location, species, size of proposed plantings.
- [8] 3. Location and size of all paved, seeded/sodded and gravelled areas.
- [8] 4. Location of all retaining walls, fences, berms and other landscape features.

***It is highly recommended that an applicant hold at least one neighborhood meeting prior to submitting an ADR application to identify any concerns or issues of surrounding residents.**

The preceding information is considered to be the minimum information for submission, and the City may require additional information for its review. Any interpretations provided by city officials as the result of submitting the attached information are based on the submitted plans, and any plan changes, may affect the interpretations.

It is the responsibility of the owner/applicant to insure compliance with all local and state requirements. The below signed applicant acknowledges the above information and hereby submits the attached information for the City's Architectural and Design Review Process.

Signed: Edward Richter IV **Date:** 23 October 2023
Applicant or Authorized Agent

***** Application shall be accompanied by one (1) sets of full-size plans, two (2) sets no larger than 11"x17", and one (1) pdf document of the complete submittal to planning@fitchburgwi.gov. Applications are due at least 4 weeks prior to the desired Plan Commission Meeting. The time frame assumes a complete set of plans is provided, and if it is not provided the Plan Commission date will be adjusted.**

FOR CITY USE ONLY

Date Received:_____ **Plan Commission Date:**_____

Comments:

JLA ARCHITECTS

LETTER OF INTENT

Date: October 24, 2023

To: City of Fitchburg - Planning/Zoning Department
Attn. Deanna Schmidt, City Planner & Zoning Administrator
5520 Lacy Road
Fitchburg, Wisconsin 53711
via email delivery only

Project Name: Hartung Fields – Lot 8 Development High Density Residential Development
(Hartung Fields Apartments – Building A)

JLA Project: W22-0913

Message:

On behalf of our client, Ned Hoyt of Woronora Ventures LLC, we submit this formal letter of intent for a request of an early start for our proposed multi-family project located on Lot 8 at 2622 Blaney Road, also known as 'Hartung Fields Apartments – Building A'. We are requesting an early start for this project, to maintain the project schedule and maintain momentum throughout the entitlements and plan review process. The subdivision works for the whole of the final plat are being progressed by the Hartung family in parallel with our proposed project. Our project on Lot 8 will have access to sufficient services and access to allow an early start to progress.

If you should have any questions or comments, then please feel free to contact me at (608)442-3828 or rzdanowski@jla-ap.com.

Sincerely,

Rob Zdanowski
Project Manager

Cc: Edward Hoyt

HARTUNG FIELDS - BUILDING A

FITCHBURG, WI

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

ADR PLAN SET

10/24/2023

JLA ARCHITECTS

JLA PROJECT NUMBER: W22-0913

10/24/2023 5:02:09 PM

ABBREVIATIONS

A
A/C air condition
A/E Architect/Engineer
ACT acoustical ceiling tile
ADDL additional
ADDM addendum
AFC above finished counter
AFF above finished floor
AFG above finished grade
AFS above finished slab
ALT alternate
ALUM aluminum
APPD approved
APT apartment
ASC above suspended ceiling

B
BB baseboard
BB bulletin board
BLDG building
BL blinds (window)
BLT borrowed light
BLW below
BPL base plate
BO bottom of
BOS bottom of steel

C
CB catch basin
CB construction bulletin
CF/CI contractor furnished, contractor installed
CF/OI contractor furnished, owner installed
CF/VI contractor furnished, vendor installed
CG corner guard
CH BD chalkboard
CIP cast-in-place
CJ control joint
CJ construction joint
CL centerline
CLG ceiling
CLR clear
CM construction management
CMU concrete masonry unit
CO cleanout
COL column
CONC concrete
CORR corridor
CONT continuous
CPT carpet
CSWK casework
CT ceramic tile
CTB ceramic tile base

D
DEMO demolition
DEPT department
DF drinking fountain
DFS Door and Frame Schedule
DH double hung
DIA diameter
DR door
DR FR door frame
DTL detail
DW dishwasher
DWG drawing

E
E east
EIFS exterior insulation & finish system
EL elevation
ELEC electric, electrical
ELEV elevator
EP epoxy
EPB epoxy base
EPS expanded polystyrene board
EQ equal
EXIST existing
EXP expand, expansion
EXT exterior

F
F female
F filler
FA fire alarm
FAB fabric
FAX facsimile
FC file cabinet
FD floor drain
FEC fire extinguisher cabinet
FHC fire hose cabinet
FG foot grille
FLR floor
FM factory mutual
FM floor mat
FP fire protection
FP fireproof
FPL fire place
FRP fiber reinforced panel
FT feet
FTG footing
FWP fabric wrapped panel

G
GA gage
GALV galvanized
GB grab bar
GC general contractor
GL glass
GLT glass tile

G (continued)
GLU LAM glued laminated wood
GR grade, grading
GRAN granite
GT grout
GWT glazed wall tile
GYP BD gypsum board

H
HB hose bibb
HC hollow core
HCP handicapped
HM hollow metal
HORIZ horizontal
HSKPG housekeeping
HT height
HVAC heating, ventilating & air conditioning
HW hot water
HWF hardwood floor
HWY highway

I
ID inside diameter
INSUL insulation
INT interior

J
JS janitor sink

K

L
LAM laminate
LAV lavatory
LL live load

M
MAX maximum
MC modular carpet tile
MECH mechanical
MFR manufacturer
MIN minimum
MIN minute
MISC miscellaneous
MO masonry opening
MS mop sink
MR moisture resistant
MRB marble base
MRF marble floor
MTL metal

N
N north
N/A not applicable

N (continued)
NIC not in contract
NO number
NOM nominal
NS no scale
NTS not to scale

O
OC on center
OD outside diameter
OF/CI owner furnished, contractor installed
OF/OI owner furnished, owner installed
OF/VI owner furnished, vendor installed
OH DR overhead (coiling) door
OPH opposite hand
OPNG opening

P
PLAM plastic laminate
PLYWD plywood
PREFAB prefabricated
PREFIN prefinished
PSI pounds per square inch
PT paint, painted
PTN partition

Q
QT quarry tile
QTB quarry tile base

R
RB resilient base
RCP reflected ceiling plan
RD roof drain
REBAR reinforcing steel bars
RF resilient flooring
RFS room finish schedule
RO rough opening

S
S south
SAN sanitary
SC sealed concrete
SC solid core
SF square foot
SH shades
SIM similar
SS stainless steel
SST solid surface
ST stain
ST stair
STN stone

S (continued)
STNB stone base
STRUCT structure
SV sheet vinyl

T
T&M time & materials
TEMP temperature
TER terrazzo
TERB terrazzo base
TFF top of finish floor
TK BD tackboard
TO top of ____
TOB top of beam
TOC top of concrete
TOJ top of joist
TOPO topography
TOS top of slab
TOS top of steel
TV television
TYP typical

U
UNO unless noted otherwise
UON unless otherwise noted

V
VCT vinyl composition tile
VF/CI vendor furnished, contractor installed
VF/OI vendor furnished, owner installed
VF/VI vendor furnished, vendor installed
VNR veneer
VIF verify in field
VWC vinyl wall covering

W
W west
W/ with
W/O without
WC water closet
WC wall covering
WD wood
WDB wood base
WDV wood veneer
WH water heater
WP wall protection
WP workpoint

X
XPS extruded polystyrene board (insul)

Y Z

SYMBOL LEGEND

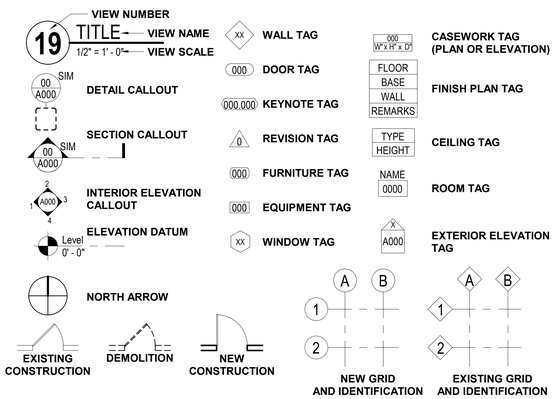

VICINITY MAP

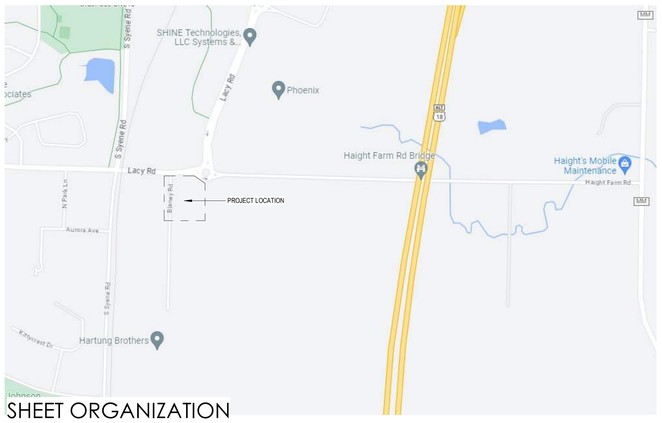

SHEET ORGANIZATION

EACH DRAWING SHEET IS BASED UPON A 30 SQUARE GRID SYSTEM, STARTING WITH '1' IN THE TOP LEFT HAND CORNER AND WORKING LEFT-TO-RIGHT AND TOP-TO-BOTTOM TO '30' IN THE BOTTOM RIGHT HAND CORNER, EXAMPLE BELOW:

1	2	3	4	5	6	TITLEBLOCK
7	8	9	10	11	12	
13	14	15	16	17	18	
19	20	21	22	23	24	
25	26	27	28	29	30	

10/24/2023 5:02:09 PM

PROJECT ADDRESS

HARTUNG FIELDS - BUILDING A
FITCHBURG, WI

OWNER INFORMATION

WORONORA VENTURES LLC
3131 FISH HATCHERY ROAD
FITCHBURG, WI 53713

CONTACT: NED HOYT
EMAIL: Ned@happenstancegroup.com.au
MAIN: 608.949.2151

PROJECT TEAM

GENERAL CONTRACTOR

KRUPP
749 UNIVERSITY ROW, SUITE 101
MADISON, WISCONSIN 53705
CONTACT: Scott Vukobrat
EMAIL: Scott@kruppconstruction.com
MAIN: 608.249.2020

ARCHITECTURAL

JLA ARCHITECTS & PLANNERS
800 WEST BROADWAY - SUITE 200
MONONA, WISCONSIN 53715
CONTACT: Rob Zdanowski
EMAIL: rzdanowski@jla-ap.com
MAIN: 608.442.3828

CIVIL ENGINEERING

VIERBICHER
999 FOURIER DRIVE #201
MADISON, WISCONSIN 53717
CONTACT: Johnathan Lilley
EMAIL: Jlil@Vierbicher.com
MAIN: 608.826.0532

STRUCTURAL ENGINEERING

MP SQUARED
583 D'ONOFRIO DRIVE
MADISON, WISCONSIN 53719
CONTACT: Alissa Jenne
EMAIL: ajenne@mpsqrd.com
MAIN: 608.821.4770

SET ISSUE

ADR PLAN SET
10/24/2023

SHEET INDEX

SHEET INDEX

SHEET DISCIPLINE AND NUMBER	
GENERAL	
G000	COVER
G001	INDEX SHEET
CIVIL	
C0	TITLE SHEET
C1	NOTES & LEGENDS
C2	EXISTING CONDITIONS
C3	DEMOLITION PLAN
C4	SITE PLAN
C5	GRADING PLAN
C6	UTILITY PLAN
C7	CONSTRUCTION DETAILS
C8	CONSTRUCTION DETAILS
C9	CONSTRUCTION DETAILS
C10	CONSTRUCTION DETAILS
LANDSCAPE	
L1	BUILDING A LANDSCAPE PLAN
L2	BUILDING A LANDSCAPE PLAN NORTH
L3	BUILDING A LANDSCAPE PLAN SOUTH
ARCHITECTURAL	
A000	PERSPECTIVE RENDERINGS
A101	FIRST FLOOR PLAN
A102	SECOND FLOOR PLAN
A103	THIRD - FIFTH FLOOR PLAN
A110	ROOF PLAN
A200	EXTERIOR ELEVATIONS
A201	EXTERIOR ELEVATIONS
A202	EXTERIOR ELEVATIONS
A203	EXTERIOR ELEVATIONS
A204	EXTERIOR ELEVATIONS
A300	BUILDING SECTIONS
A310	WALL SECTIONS
A311	WALL SECTIONS
A312	WALL SECTIONS
A313	WALL SECTIONS

JLA ARCHITECTS
MADISON : MILWAUKEE
jla-ap.com

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE
INDEX SHEET

SHEET NUMBER
G001

PERSPECTIVE 1

PERSPECTIVE 2

JLA
ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

PERSPECTIVE RENDERINGS

SHEET NUMBER

A000

10/24/2023 5:01:12 PM

PARKING INFORMATION	ACCESSIBLE PARKING CALCULATIONS
AUTO PARKING INSIDE= 170 SPACES AUTO PARKING OUTSIDE = 83 SPACES AUTO PARKING TOTAL = 253 SPACES BIKE PARKING TOTAL = 148 SPACES	170 INTERIOR SPACES x 2% = 3.4 SPACES 4 TYPE "A" UNITS ARE PROVIDED **4 ACCESSIBLE SPACES ARE PROVIDED FOR TENANTS** 83 EXTERIOR SPACES x 2% = 1.66 SPACES **3 ACCESSIBLE SPACES ARE PROVIDED FOR GUESTS**

ACCESSIBLE PARKING CODE INFORMATION

1106.3 GROUPS I-1, R-1, R-2, R-3 AND R-4. ACCESSIBLE PARKING SPACES SHALL BE PROVIDED IN GROUP I-1, R-1, R-2, R-3 AND R-4 OCCUPANCIES IN ACCORDANCE WITH ITEMS 1 THROUGH 4 AS APPLICABLE.

1. IN GROUP R-2, R-3 AND R-4 OCCUPANCIES THAT ARE REQUIRED TO HAVE ACCESSIBLE, TYPE A OR TYPE B DWELL-ING UNITS OR SLEEPING UNITS, AT LEAST 2 PERCENT, BUT NOT LESS THAN ONE, OF EACH TYPE OF PARKING SPACE PROVIDED SHALL BE ACCESSIBLE.

2. IN GROUP I-1 AND R-1 OCCUPANCIES, ACCESSIBLE PARKING SHALL BE PROVIDED IN ACCORDANCE WITH TABLE 1106.2.

3. WHERE AT LEAST ONE PARKING SPACE IS PROVIDED FOR EACH DWELLING UNIT OR SLEEPING UNIT, AT LEAST ONE ACCESSIBLE PARKING SPACE SHALL BE PROVIDED FOR EACH ACCESSIBLE AND TYPE A UNIT.

4. WHERE PARKING IS PROVIDED WITHIN OR BENEATH A BUILD-ING, ACCESSIBLE PARKING SPACES SHALL BE PROVIDED WITHIN OR BENEATH THE BUILDING.

KEYNOTE SCHEDULE

MARK	NOTE
106	PROVIDE FLOOR DRAIN AND SUMP CROCK & PUMP PER CODE - VERIFY SUMP LOCATION WITH DESIGN-BUILD PLUMBING CONTRACTOR.
109	TYPICAL 2YRD DUMPSTER.
110	FLOOR DRAIN - PITCH CONCTRETE FLOOR TO PROVIDE PROPER DRAINAGE.
111	INACCESSIBLE SPACE UNDER STAIRS.
112	RECESSED ENTRY MAT - SEE SCOPE SPECIFICATIONS. COORDINATE FINAL FLOOR RECESS WITH FLOOR FINISH MATERIAL. TOP OF MAT SHOULD EQUAL THE TOP OF FLOOR FINISH.
115	PEDESTRIAN CODE COMPLIANT STRIPING
132	3-HR-RATED COLUMNS SUPPORTING BUILDING PRECAST PLANK (TYP)
148	PRECAST CONC STRUCTURAL TEE- SEE STRUCTURAL
150	GC TO PROVIDE 48" HIGH PROTECTION BOLLARD
161	LOCATION OF EXTERIOR WALLS ABOVE

GENERAL NOTES - PARKING LEVEL FLOOR PLAN

1. EXTERIOR DIMENSIONS ARE TO OUTSIDE FACE OF STUD OR MASONRY/ CONCRETE FOUNDATION WALL UNLESS OTHERWISE NOTED.
2. INTERIOR DIMENSIONS ARE TO FACE OF STUD OR CONCRETE MASONRY UNIT (CMU) WALLS UNLESS OTHERWISE NOTED.
3. EXTERIOR WINDOW & DOOR LOCATION DIMENSIONS ARE TO ROUGH OPENING ENDS OF WINDOW/DOOR UNLESS OTHERWISE NOTED. CONTRACTOR SHALL VERIFY ALL ROUGH OPENINGS WITH MANUFACTURER.
4. ALL CONCRETE MASONRY UNIT (CMU) WALLS SHALL BE TYPE M8-2X UNLESS NOTED OTHERWISE.
5. ALL METAL STUD WALLS SHALL BE AS TAGGED AND/ OR INDICATED ON THE INTERIOR WALL ASSEMBLIES SHEET, UNLESS NOTED OTHERWISE.
6. VERIFY ALL STRUCTURAL MEMBER SIZE, SPACING, REINFORCING, AND BRACING WITH STRUCTURAL DRAWINGS.
7. ANY EXPOSED STEEL THAT SUPPORTS LOAD-BEARING WALLS OR FLOORS SHALL BE PROTECTED BY MEANS OF SPRAY-FIREPROOFING. GENERAL CONTRACTOR TO COORDINATE WITH FINAL DESIGN AND INSTALLATION OF PRECAST CONCRETE STRUCTURAL MEMBERS.
8. ALL WOOD EXPOSED TO THE EXTERIOR OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-TREATED AND FIRE TREATED.
9. DESIGN-BUILD MECHANICAL, ELECTRICAL, AND PLUMBING CONTRACTORS SHALL MAINTAIN A CLEAR HEIGHT OF 7'-0" MINIMUM IN VEHICLE AND PEDESTRIAN TRAFFIC AREAS PER 2015 IBC 406.
10. VERIFY QUANTITY AND LOCATION OF INTERIOR AND EXTERIOR HOSE BIBBS WITH OWNER.
11. VERIFY QUANTITY, LOCATION, AND TYPE OF ELECTRICAL OUTLETS IN PARKING AREA WITH OWNER.
12. PRIOR TO CONSTRUCTION, GENERAL CONTRACTOR TO VERIFY REQUIREMENTS OF ALL TRADES INCLUDING: PRECAST, PLUMBING, SPRINKLERS, HVAC, ELEVATOR & ELECTRICAL.
13. GENERAL CONTRACTOR TO COORDINATE ALL PENETRATION AND OPENINGS THROUGH PRECAST PLANK WITH PRECAST PLANK PROVIDER, MEP CONTRACTORS, AND ARCHITECT.
14. COORDINATE LOCATION OF PRECAST PLANK DEPTHS W/ PRECAST SHOP DRAWINGS PRIOR TO POURING WALLS.
15. CONTRACTOR TO VERIFY LOCATIONS OF GAS METER, ELECTRICAL METERS, AND THEIR SPACE REQUIREMENTS PRIOR TO CONSTRUCTION.

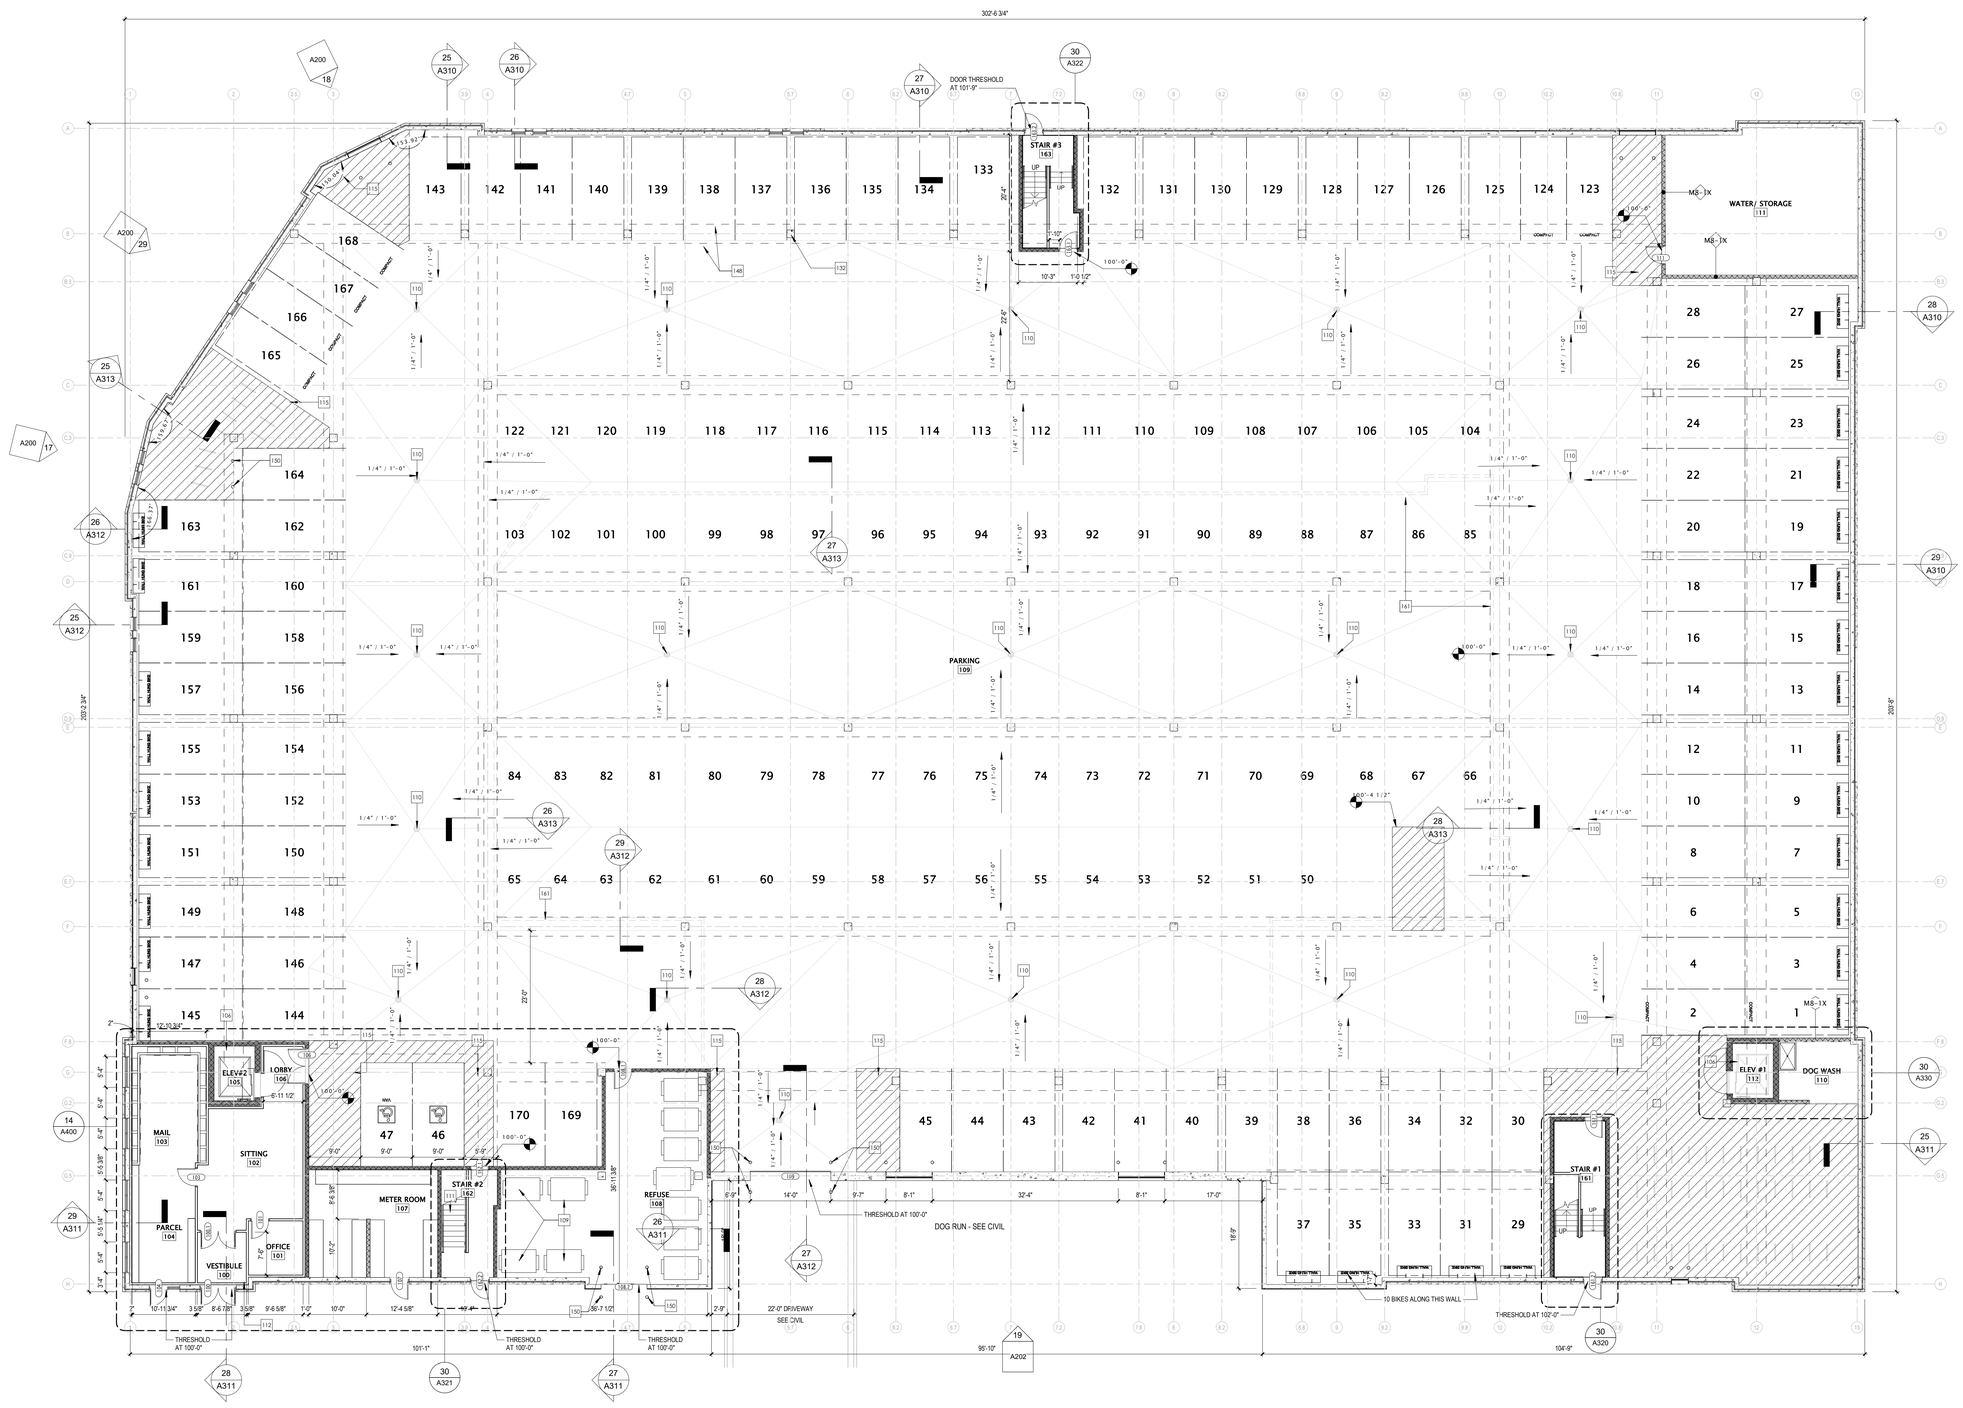

JLA ARCHITECTS

MADISON | MILWAUKEE | DENVER

JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

FIRST FLOOR PLAN

SHEET NUMBER

A101

10/24/2023 5:01:15 PM

SHEET INDEX – ENLARGED UNIT TYPES	
PLAN TYPE	SHEET NO.
PLAN B1 - ENLARGED UNIT	A410
PLAN B1.2 - ENLARGED UNIT	A410
PLAN B2 - ENLARGED UNIT	A410
PLAN B3 - ENLARGED UNIT	A410
PLAN B3.1 - ENLARGED UNIT	A410
PLAN B4 - ENLARGED UNIT	A410
PLAN B5 - ENLARGED UNIT	A410
PLAN B6 - ENLARGED UNIT	A410
PLAN C1 - ENLARGED UNIT	A411
PLAN C2 - ENLARGED UNIT	A411
PLAN C3 - ENLARGED UNIT	A411
PLAN D1 - ENLARGED UNIT	A411
PLAN D3 - ENLARGED UNIT	A412
PLAN D3.1 - ENLARGED UNIT	A412
PLAN D4 - ENLARGED UNIT	A412
PLAN D5 - ENLARGED UNIT	A412
PLAN F1 - ENLARGED UNIT	A412
PLAN H2 - ENLARGED UNIT	A413
PLAN H4 - ENLARGED UNIT	A413
PLAN H5 - ENLARGED UNIT	A413
PLAN H7 - ENLARGED UNIT	A413
PLAN H7.1 - ENLARGED UNIT	A413
PLAN H8 - ENLARGED UNIT	A414
PLAN D1.1 - ENLARGED UNIT	A411
PLAN H3 - ENLARGED UNIT	A413
PLAN H9 - ENLARGED UNIT	A414
PLAN B6A - ENLARGED UNIT	A415
PLAN H6A - ENLARGED UNIT	A415

UNIT AREAS	
PLAN TYPE	AREA
PLAN B1	518 SF
PLAN B1.2	611 SF
PLAN B2	535 SF
PLAN B3	568 SF
PLAN B3.1	644 SF
PLAN B4	659 SF
PLAN B5	690 SF
PLAN B6	723 SF
PLAN B6A	723 SF
PLAN C1	781 SF
PLAN C2	834 SF
PLAN C3	867 SF
PLAN D1	993 SF
PLAN D1.1	1039 SF
PLAN D3	1048 SF
PLAN D3.1	1200 SF
PLAN D4	1207 SF
PLAN D4.1	1135 SF
PLAN D5	1091 SF
PLAN F1	1365 SF
PLAN H2	1088 SF
PLAN H4	705 SF
PLAN H5	710 SF
PLAN H6A	1245 SF
PLAN H7	1007 SF
PLAN H7.1	1135 SF
PLAN H8	806 SF
PLAN H9	895 SF

KEYNOTE SCHEDULE	
MARK	NOTE
104	STRUCTURAL PRECAST T BEAMS - SHOWN ABOVE @ FIRST FLOOR AND BELOW @ SECOND FLOOR - SEE STRUCTURAL PLAN SET.
464	42" TALL GUARDRAIL

GENERAL NOTES - FLOOR PLANS

1. EXTERIOR DIMENSIONS ARE TO OUTSIDE FACE OF STUD UNLESS OTHERWISE NOTED.
2. INTERIOR DIMENSIONS ARE TO FACE OF STUD OR CONCRETE MASONRY UNIT (CMU) WALLS UNLESS OTHERWISE NOTED.
3. EXTERIOR WINDOW & DOOR LOCATION DIMENSIONS ARE TO CENTERLINE OF WINDOW/DOOR UNLESS OTHERWISE NOTED. CONTRACTOR SHALL VERIFY ALL ROUGH OPENINGS WITH MANUFACTURER.
4. INTERIOR WINDOW & DOOR LOCATION DIMENSIONS ARE TO CENTERLINE OF WINDOW/DOOR UNLESS OTHERWISE NOTED. CONTRACTOR SHALL VERIFY ALL ROUGH OPENINGS WITH MANUFACTURER.
5. ALL INTERIOR WALLS TYPES ARE TO BE AS TAGGED AND/ OR INDICATED ON THE INTERIOR WALL ASSEMBLIES SHEET, UNLESS NOTED OTHERWISE.
6. FURR-OUT UNIT DEMISING WALLS AS REQUIRED TO ALIGN WITH EXTERIOR WALL FACES.
7. VERIFY ALL STRUCTURAL MEMBER SIZE, SPACING, REINFORCING, AND BRACING WITH STRUCTURAL DRAWINGS.
8. ALL WOOD EXPOSED TO THE EXTERIOR OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-TREATED.
11. INSTALL FIXTURES, ACCESSORIES, ETC. ACCORDING TO THE MOUNTING HEIGHT SCHEDULE - SEE THE G300 SERIES SHEETS.
12. VERIFY ALL WINDOW, DOOR, TUB, SHOWER, APPLIANCE, EQUIPMENT, ETC. ROUGH OPENINGS & CLEARANCE REQUIREMENTS WITH MANUFACTURER.
13. PROVIDE SOUND BATT INSULATION AT ALL WALLS SURROUNDING BATHROOMS, LAUNDRY ROOMS/ CLOSETS, MECHANICAL ROOMS/ CLOSETS, AND OTHER PLUMBING WALLS.
14. PROVIDE BLOCKING AT ALL GRAB BAR LOCATIONS INCLUDING LOCATIONS OF FUTURE GRAB BARS & SEATS IN BATHROOMS DESIGNATED AS ACCESSIBLE.
15. FIELD VERIFY ALL CABINETRY LAYOUTS AND COORDINATE WITH THE DIMENSIONAL REQUIREMENTS OF ALL APPLIANCES & FIXTURES. PROVIDE FINISHED END PANELS AT ALL EXPOSED CABINETRY ENDS.
16. CAULK AT PERIMETER OF ALL TUB & SHOWER ENCLOSURES. CAULK AT PERIMETER OF ALL COUNTERTOP BACKSPLASHES & SIDESPLASHES.
17. PROVIDE MOISTURE-RESISTANT AND MOLD-RESISTANT TYPE GYPSUM BOARD AT PLUMBING FIXTURE WALLS.
18. PROVIDE 3/4" FIRE-RETARDANT TREATED PLYWOOD AS BACKING PANELS FOR ELECTRICAL EQUIPMENT. INSTALL AT 1'-0" AFF TO FINISHED CEILING. PAINT PLYWOOD TO MATCH ADJACENT WALL FINISH. COORDINATE FINAL SIZE AND LOCATION WITH DESIGN-BUILD ELECTRICAL CONTRACTOR.

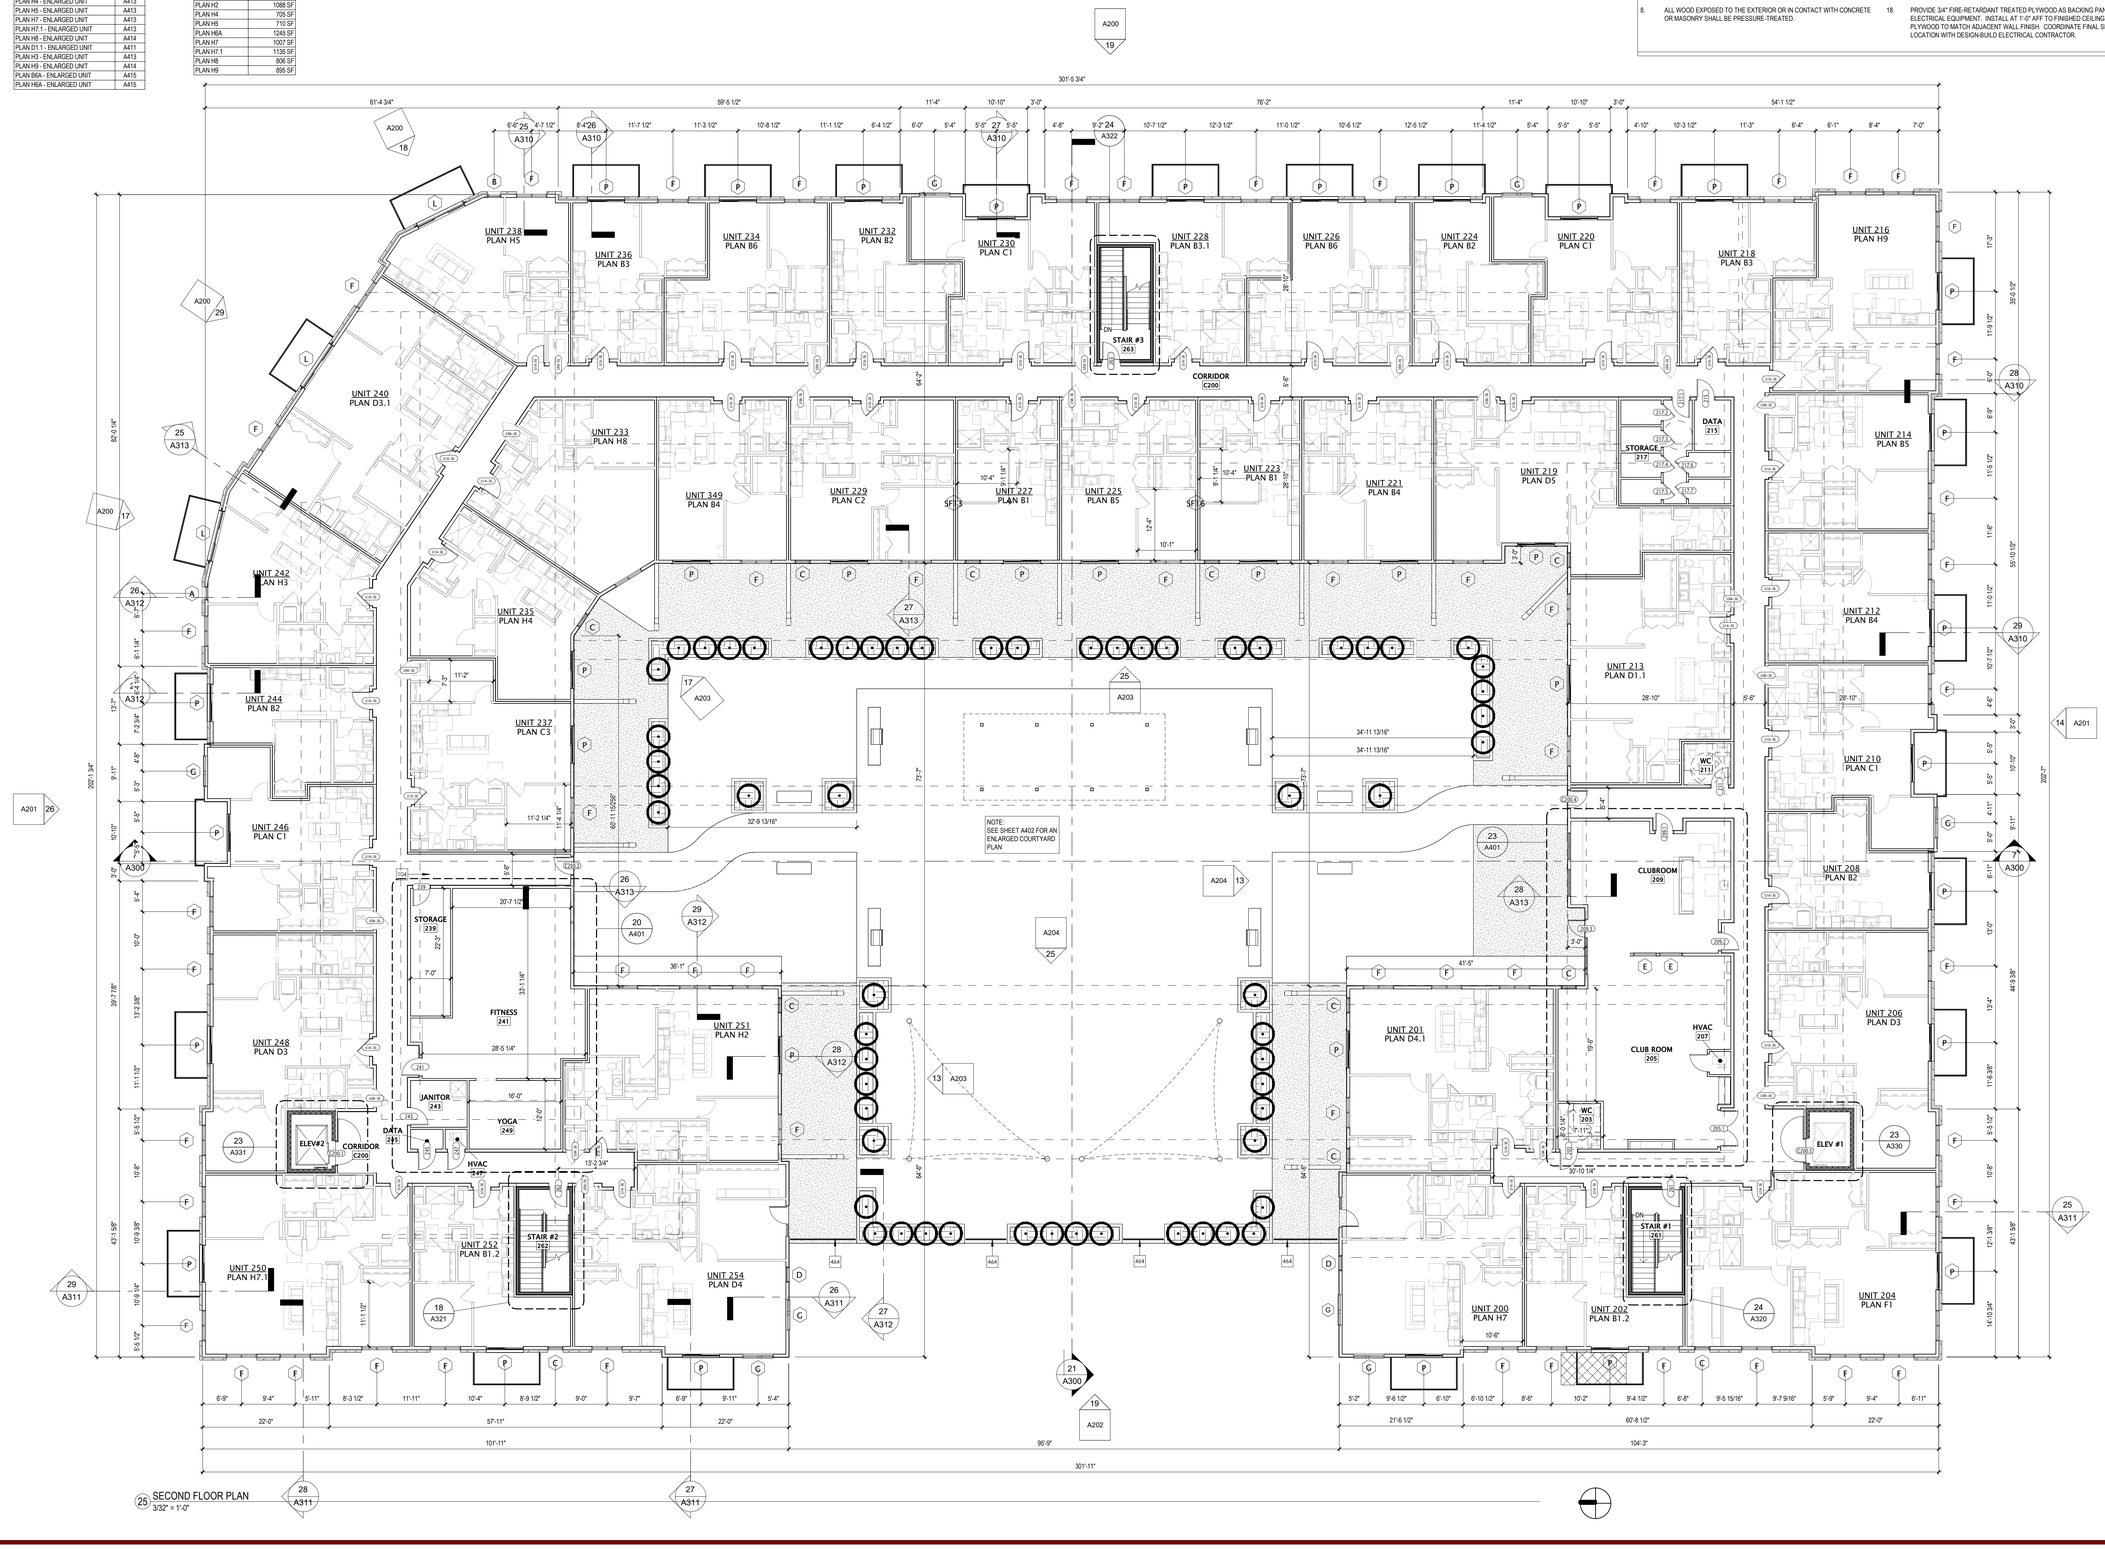

25 SECOND FLOOR PLAN
3/32" = 1'-0"

10/24/2023 5:01:22 PM

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

SECOND FLOOR PLAN

SHEET NUMBER

A102

SHEET INDEX – ENLARGED UNIT TYPES	
PLAN TYPE	SHEET NO.
PLAN B1 - ENLARGED UNIT	A410
PLAN B1.2 - ENLARGED UNIT	A410
PLAN B2 - ENLARGED UNIT	A410
PLAN B3 - ENLARGED UNIT	A410
PLAN B3.1 - ENLARGED UNIT	A410
PLAN B4 - ENLARGED UNIT	A410
PLAN B5 - ENLARGED UNIT	A410
PLAN B6 - ENLARGED UNIT	A410
PLAN C1 - ENLARGED UNIT	A411
PLAN C2 - ENLARGED UNIT	A411
PLAN C3 - ENLARGED UNIT	A411
PLAN D1 - ENLARGED UNIT	A411
PLAN D3 - ENLARGED UNIT	A412
PLAN D3.1 - ENLARGED UNIT	A412
PLAN D4 - ENLARGED UNIT	A412
PLAN D5 - ENLARGED UNIT	A412
PLAN F1 - ENLARGED UNIT	A412
PLAN H2 - ENLARGED UNIT	A413
PLAN H4 - ENLARGED UNIT	A413
PLAN H5 - ENLARGED UNIT	A413
PLAN H7 - ENLARGED UNIT	A413
PLAN H7.1 - ENLARGED UNIT	A413
PLAN H8 - ENLARGED UNIT	A414
PLAN D1.1 - ENLARGED UNIT	A411
PLAN H3 - ENLARGED UNIT	A413
PLAN H9 - ENLARGED UNIT	A414
PLAN B6A - ENLARGED UNIT	A415
PLAN H6A - ENLARGED UNIT	A415

UNIT AREAS	
PLAN TYPE	AREA
PLAN B1	518 SF
PLAN B1.2	611 SF
PLAN B2	535 SF
PLAN B3	568 SF
PLAN B3.1	644 SF
PLAN B4	659 SF
PLAN B5	690 SF
PLAN B6	723 SF
PLAN B6A	723 SF
PLAN C1	781 SF
PLAN C2	834 SF
PLAN C3	867 SF
PLAN D1	993 SF
PLAN D1.1	1039 SF

UNIT AREAS	
PLAN TYPE	AREA
PLAN D3	1048 SF
PLAN D3.1	1200 SF
PLAN D4	1207 SF
PLAN D4.1	1135 SF
PLAN D5	1091 SF
PLAN F1	1365 SF
PLAN H2	1088 SF
PLAN H4	705 SF
PLAN H5	710 SF
PLAN H6A	1245 SF
PLAN H7	1007 SF
PLAN H7.1	1135 SF
PLAN H8	806 SF
PLAN H9	895 SF

KEYNOTE SCHEDULE	
MARK	NOTE

GENERAL NOTES - FLOOR PLANS

1. EXTERIOR DIMENSIONS ARE TO OUTSIDE FACE OF STUD UNLESS OTHERWISE NOTED.
2. INTERIOR DIMENSIONS ARE TO FACE OF STUD OR CONCRETE MASONRY UNIT (CMU) WALLS UNLESS OTHERWISE NOTED.
3. EXTERIOR WINDOW & DOOR LOCATION DIMENSIONS ARE TO CENTERLINE OF WINDOW/DOOR UNLESS OTHERWISE NOTED. CONTRACTOR SHALL VERIFY ALL ROUGH OPENINGS WITH MANUFACTURER.
4. INTERIOR WINDOW & DOOR LOCATION DIMENSIONS ARE TO CENTERLINE OF WINDOW/DOOR UNLESS OTHERWISE NOTED. CONTRACTOR SHALL VERIFY ALL ROUGH OPENINGS WITH MANUFACTURER.
5. ALL INTERIOR WALLS TYPES ARE TO BE AS TAGGED AND/ OR INDICATED ON THE INTERIOR WALL ASSEMBLIES SHEET, UNLESS NOTED OTHERWISE.
6. FURR-OUT UNIT DEMISING WALLS AS REQUIRED TO ALIGN WITH EXTERIOR WALL FACES.
7. VERIFY ALL STRUCTURAL MEMBER SIZE, SPACING, REINFORCING, AND BRACING WITH STRUCTURAL DRAWINGS.
8. ALL WOOD EXPOSED TO THE EXTERIOR OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-TREATED.
11. INSTALL FIXTURES, ACCESSORIES, ETC. ACCORDING TO THE MOUNTING HEIGHT SCHEDULE - SEE THE G200 SERIES SHEETS.
12. VERIFY ALL WINDOW, DOOR, TUB, SHOWER, APPLIANCE, EQUIPMENT, ETC. ROUGH OPENINGS & CLEARANCE REQUIREMENTS WITH MANUFACTURER.
13. PROVIDE SOUND BATT INSULATION AT ALL WALLS SURROUNDING BATHROOMS, LAUNDRY ROOMS/ CLOSETS, MECHANICAL ROOMS/ CLOSETS, AND OTHER PLUMBING WALLS.
14. PROVIDE BLOCKING AT ALL GRAB BAR LOCATIONS INCLUDING LOCATIONS OF FUTURE GRAB BARS & SEATS IN BATHROOMS DESIGNATED AS ACCESSIBLE.
15. FIELD VERIFY ALL CABINETRY LAYOUTS AND COORDINATE WITH THE DIMENSIONAL REQUIREMENTS OF ALL APPLIANCES & FIXTURES. PROVIDE FINISHED END PANELS AT ALL EXPOSED CABINETRY ENDS.
16. CAULK AT PERIMETER OF ALL TUB & SHOWER ENCLOSURES. CAULK AT PERIMETER OF ALL COUNTERTOP BACKSPLASHES & SIDESPLASHES.
17. PROVIDE MOISTURE-RESISTANT AND MOLD-RESISTANT TYPE GYPSUM BOARD AT PLUMBING FIXTURE WALLS.
18. PROVIDE 3/4" FIRE-RETARDANT TREATED PLYWOOD AS BACKING PANELS FOR ELECTRICAL EQUIPMENT. INSTALL AT 1'-0" AFF TO FINISHED CEILING. PAINT PLYWOOD TO MATCH ADJACENT WALL FINISH. COORDINATE FINAL SIZE AND LOCATION WITH DESIGN-BUILD ELECTRICAL CONTRACTOR.

25 THIRD - FIFTH FLOOR PLAN
3/32" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE		
Mark	Description	Date

SHEET TITLE

THIRD - FIFTH FLOOR PLAN

SHEET NUMBER

A103

10/24/2023 5:01:31 PM

KEYNOTE SCHEDULE	
MARK	NOTE
125	STAIR SHAFT BELOW / ELEVATOR OVER-RUN WITH ROOF ASSEMBLY WR3-X - SEE ELEVATOR AND STAIR SECTIONS.
136	RIGID TAPPERED INSULATION ROOF CRICKETS. SEE ROOF PLAN NOTES.
138	ROOF DRAIN.
139	OVERFLOW DRAIN AND PROPOSED ROUTING TO SCUPPERS.
141	30" x 96" CLASS 'A' ROOF HATCH PER 2015 IBC SECTIONS 1011.12.2 AND 1011.13. GC TO COORDINATE LOCATION WITH ROOF TRUSS SUPPLIER. (GUARDS ARE REQUIRED IF THE ROOF HATCH IS LOCATED WITHIN 10 FEET OF THE ROOF EDGE)
160	SOLAR PANELS

ROOF NOTES

1. ROOF SHALL BE ROOF ASSEMBLY - WR1-X, UNLESS NOTED OTHERWISE. TOP CHORDS OF TRUSSES SHALL BE PITCHED AT 1/4" PER FOOT (MINIMUM) TO PROVIDE ROOF DRAINAGE. SEE A501 FOR FOR ROOF ASSEMBLY DESCRIPTIONS.
2. PROVIDE TAPERED INSULATION BOARD WHERE NECESSARY OVER ROOF ASSEMBLY TO MAINTAIN A 1/4" PER FOOT MINIMUM PITCH TO ROOF DRAINS. PROVIDE A 3/16" PER FOOT MINIMUM PITCH FOR TAPERED INSULATION SADDLES AND/ OR CRICKETS WHERE NECESSARY.
3. ROOF DRAINS ARE SHOWN FOR INTENT ONLY. DESIGN/BUILD PLUMBING CONTRACTOR SHALL PROVIDE NECESSARY CALCULATIONS TO DETERMINE FINAL QUANTITY, SIZE, AND LOCATION OF ROOF DRAINS AND OVERFLOW DRAINS. COORDINATE ALL ROOF DRAINS WITH ROOFING CONTRACTOR TO PROVIDE PROPER DRAINAGE.
4. AT ALL FIRE WALLS, PROVIDE NON-COMBUSTIBLE ROOF SHEATHING EXTENDING TO A DISTANCE OF 4ft" (MINIMUM) FROM BOTH SIDES OF FIRE WALL.
5. PROVIDE WATERTIGHT INTEGRITY AT ALL PENETRATIONS AND EQUIPMENT PER ROOFING MANUFACTURER'S STANDARD DETAILS AND REQUIREMENTS FOR WARRANTY AND CURRENT NRCA STANDARDS.
6. VERIFY ANY ROOFTOP EQUIPMENT AND PENETRATIONS WITH OWNER'S DESIGN / BUILD MECHANICAL, ELECTRICAL, AND PLUMBING PLANS.
7. DESIGN / BUILD CONTRACTORS PROVIDING ROOF PENETRATIONS MUST PROVIDE TEMPORARY WEATHERTIGHT COVERS FOR OPENING UNTIL PLACEMENT OF FINISHED WORK OR COVERING.
8. OVERHANGS (IF ANY) SHALL BE AS SHOWN ON ROOF PLAN.
9. PROVIDE CONTINUOUS ATTIC DRAFTSTOPPING AT LOCATIONS INDICATED ON ROOF PLAN. EXTEND DRAFTSTOPPING FULLY INTO SOFFITS AND PENETRATIONS. SEAL ALL JOINTS WITH CAULK AND/ OR TAPE AS NEEDED TO PROVIDE SMOKETIGHT SEAL.
10. ALL DRYERS SHALL BE VENTED WITH U.L. CLASSIFIED DRYER BOX & VENT. PROVIDE POWER BOOSTER FAN/ VENT IF VENT RUN EXCEEDS 25'-0".
11. PLUMBING DESIGN-BUILD CONTRACTOR TO COORDINATE THE LOCATION OF ROOF FROST PROOF HOSE BIB WITH OWNER. COORDINATE LOCATION WITH TRUSS LAYOUT AND UNIT LAYOUT BELOW.
12. PROVIDE PREFINISHED SHEET METAL COPINGS AND/ OR GRAVEL STOPS PER PLANS. REFER TO EXTERIOR ELEVATIONS MATERIAL SCHEDULE FOR SPECIFIED METAL COLORS.
13. PROVIDE PREFINISHED SHEET METAL DOWNSPOUTS WHERE INDICATED. REFER TO EXTERIOR ELEVATIONS MATERIAL SCHEDULE FOR SPECIFIED METAL COLORS. DESIGN/BUILD PLUMBING CONTRACTOR SHALL PROVIDE NECESSARY CALCULATIONS AND DETERMINE FINAL QUANTITY, SIZE, AND LOCATION OF DOWNSPOUTS AND SHALL COORDINATE WITH ROOFING CONTRACTOR TO PROVIDE PROPER DRAINAGE.
14. *ROOF DRAINS AND/ OR DOWNSPOUTS SHOWN FOR INTENT ONLY. ROOFING AND PLUMBING CONTRACTORS SHALL DETERMINE AND COORDINATE FINAL ROOF DRAIN/ DOWNSPOUT SIZES AND LOCATIONS BASED ON DRAINAGE CALCULATIONS PROVIDED BY PLUMBING SUB-CONTRACTOR.

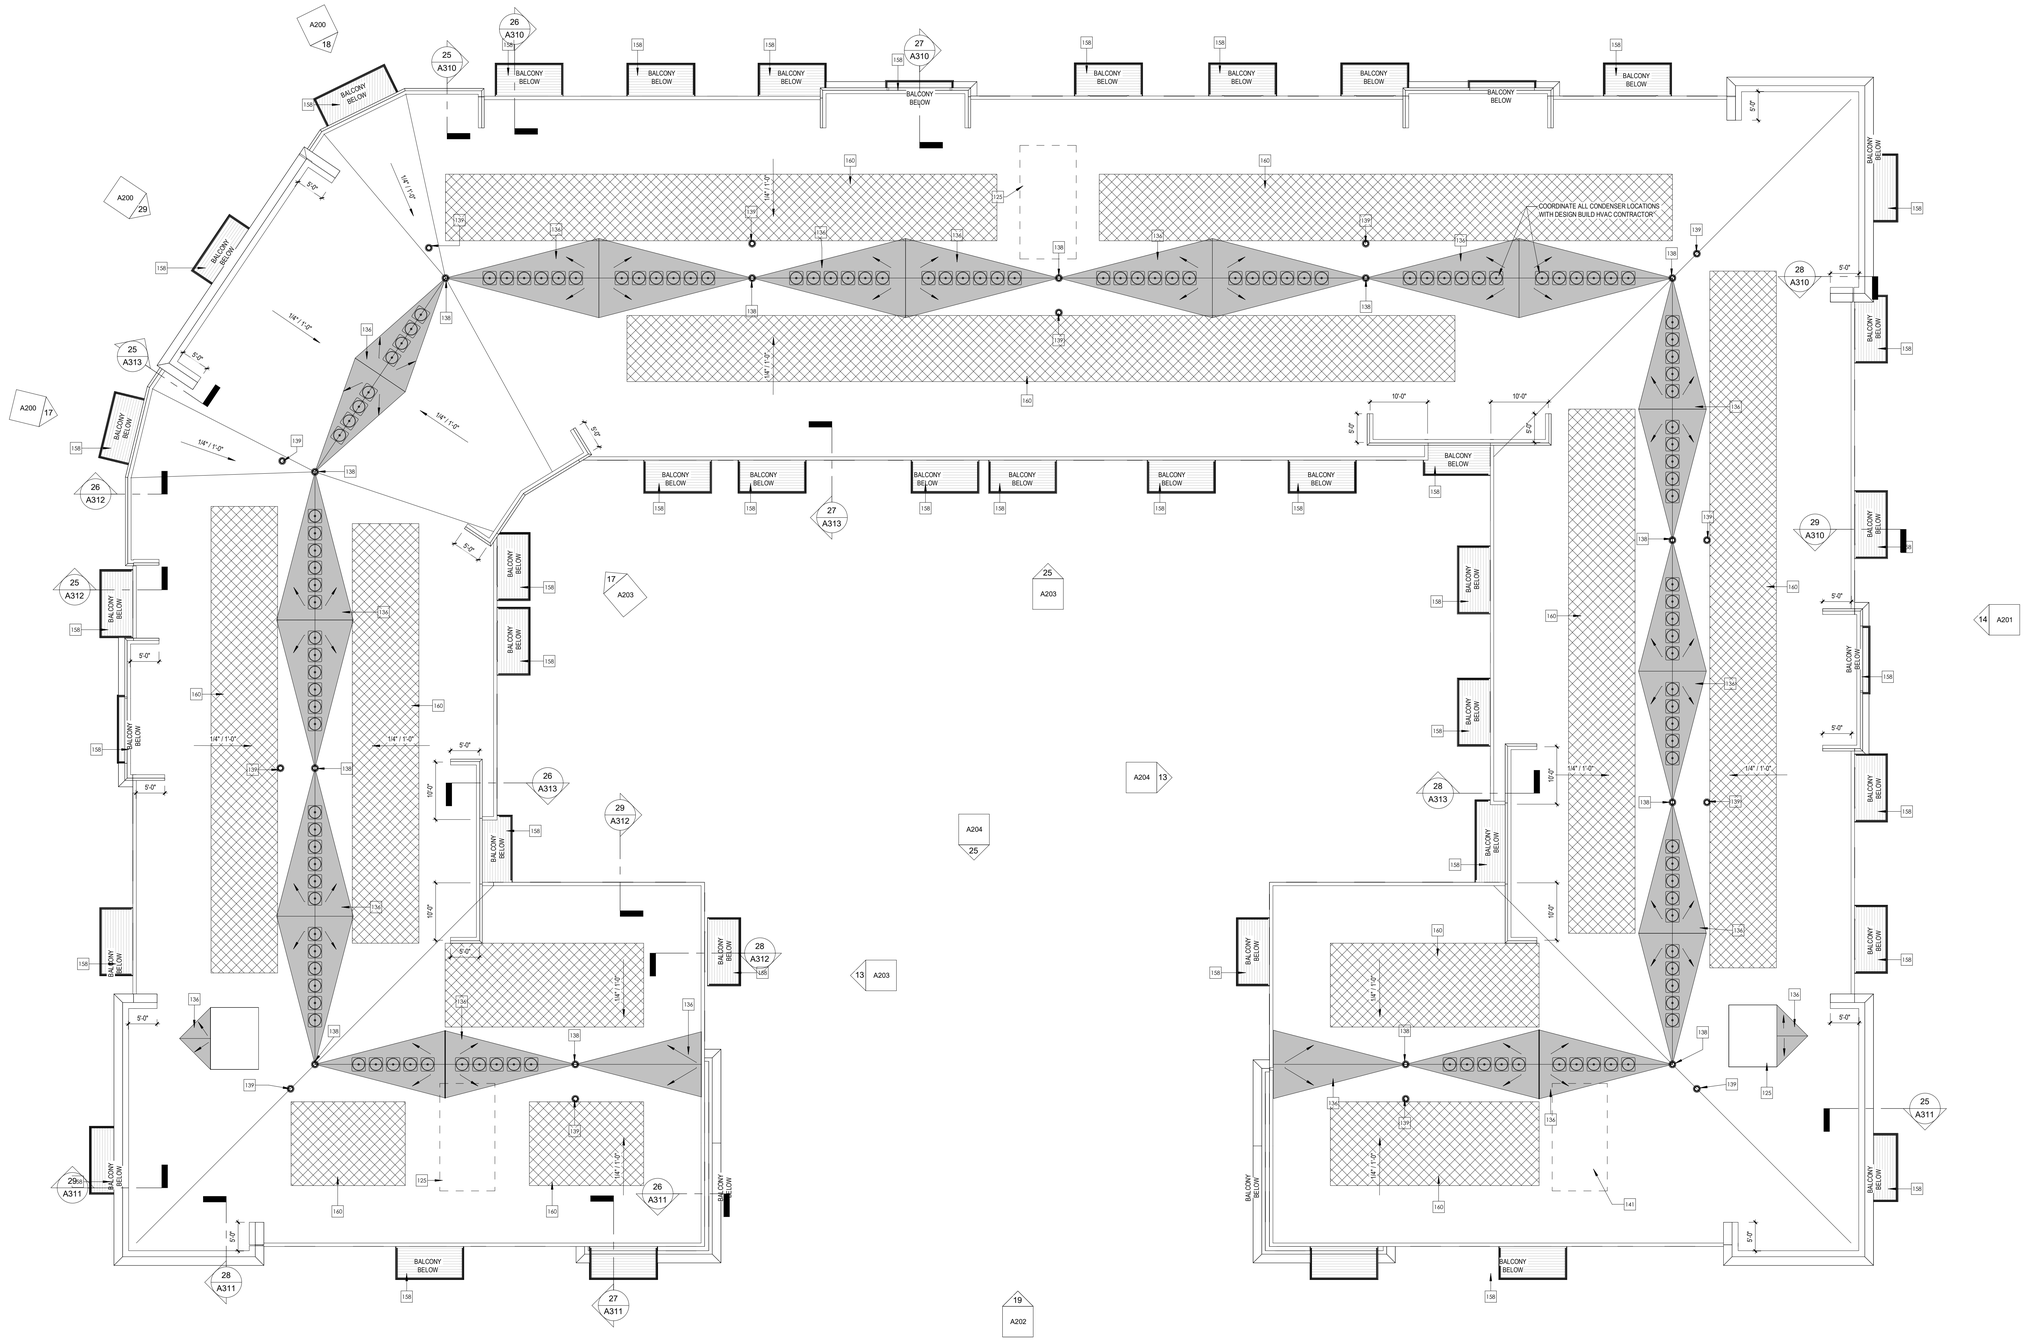

25 ROOF PLAN
3/32" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

ROOF PLAN

SHEET NUMBER

A110

10/24/2023 3:01:34 PM

EXTERIOR MATERIAL LEGEND

BRICK 01

BRICK 02

PANEL 01

PANEL 02

WINDOW COLOR

STONE ROUGH FACE ONLY

FIBER CEMENT SIDING - 6" EXPOSURE

ALUMINUM RAILING - MEDIUM BRONZE

EXTERIOR MATERIALS SCHEDULE

MARK	DESCRIPTION	MANUFACTURER	TYPE / STYLE	DIMENSIONS	COLOR	NOTES
1	WINDOW (DARK)	MARVIN ESSENTIAL WINDOWS	SEE SCHEDULE	SEE WINDOW SCHEDULE	BLACK	
2	MASONRY - STONE	DUTCH QUALITY	MANUFACTURED STONE VENEER	4" NOMINAL	NATURAL BLEND - WEATHER LEDGE	
3	MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
4	MASONRY - 2 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	WINTER BLEND	
5	PANEL - 1 (DARK)	NICHIHA	CORRIGOA CONCRETE SERIES	TBD	SHADOW	
6	PANEL - 2 (ACCENT)	CERACLAD	ORIGINAL DESIGN	TBD	ELEMENTS / CORTEN STEEL	
7	SIDING - 1	JAMES HARDIE	CEDARMILL HORIZONTAL	8" NOMINAL (6" EXPOSURE)	COBBLESTONE	
8	BALCONY RAILING	WILLIAMS, INC.	TBD	SEE PLANS	DARK BRONZE	
9	BALCONY / DECK	TBD	COMPOSITE	SEE PLANS	TBD	
10	BALCONY FASCIA & TRIM	TBD	-	-	TBD	
11	PATIO DOORS	TBD	SEE SCHEDULE	SEE PLANS	SEE WINDOW SCHEDULE	
12	STEEL ENTRY DOOR	-	INSULATED	SEE DOOR SCHEDULE	PAINT TO MATCH ADJACENT MATERIAL	
13	OVERHEAD GARAGE DOOR	-	-	SEE DOOR SCHEDULE	-	
14	ALUMINUM ENTRANCE DOOR(S)	KAWNEER - OR EQUAL	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
15	ALUMINUM STOREFRONT SYSTEM	TBD	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
16	DOOR / WINDOW TRIM	TBD	TBD	1x4	TBD	
17	PATIO AREA UNIT DIVIDER WALLS	TBD	-	SEE PLANS	TBD	
18	PRECAST CONCRETE BAND - PROFILE #1	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
19	PRECAST CONCRETE BAND - PROFILE #2	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
20	PRECAST CONCRETE LINTEL- PROFILE #3	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
21	METAL WALL CAP	-	-	SEE PLANS	PAINT TO MATCH ADJACENT MATERIAL	
22	SOLDIER COURSE - MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
23	CORNICE	-	EIFS CORNICE	-	-	
24	TYPICAL FASCIA	ROLLEX - OR EQUAL	FIBER CEMENT	SEE PLANS	CLAY	
25	RESIDENTIAL HVAC LOUVER / GRILLE	TBD	EXTRUDED ALUMINUM	TBD	PAINT TO MATCH ADJACENT MATERIALS	

7 EAST ELEVATION - 1
1/8" = 1'-0"

17 NORTHEAST ELEVATION - 1
1/8" = 1'-0"

18 NORTHEAST ELEVATION - 3
1/8" = 1'-0"

19 EAST ELEVATION - 2
1/8" = 1'-0"

29 NORTHEAST ELEVATION - 2
1/8" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

EXTERIOR ELEVATIONS

SHEET NUMBER

A200

10/24/2023 3:01:42 PM

EXTERIOR MATERIAL LEGEND

BRICK 01 | BRICK 02 | PANEL 01 | PANEL 02 | WINDOW COLOR | STONE ROUGH FACE ONLY | FIBER CEMENT SIDING - 6" EXPOSURE | ALUMINUM RAILING - MEDIUM BRONZE

EXTERIOR MATERIALS SCHEDULE

MARK	DESCRIPTION	MANUFACTURER	TYPE / STYLE	DIMENSIONS	COLOR	NOTES
1	WINDOW (DARK)	MARVIN ESSENTIAL WINDOWS	SEE SCHEDULE	SEE WINDOW SCHEDULE	BLACK	
2	MASONRY - STONE	DUTCH QUALITY	MANUFACTURED STONE VENEER	4" NOMINAL	NATURAL BLEND - WEATHER LEDGE	
3	MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
4	MASONRY - 2 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	WINTER BLEND	
5	PANEL - 1 (DARK)	NICHIHA	CORBOSA CONCRETE SERIES	TBD	SHADOW	
6	PANEL - 2 (ACCENT)	CERACLAD	ORIGINAL DESIGN	TBD	ELEMENTS / CORTEN STEEL	
7	SIDING - 1	JAMES HARDIE	CEDARMILL HORIZONTAL	8" NOMINAL (6" EXPOSURE)	COBBLESTONE	
8	BALCONY RAILING	WILLIAMS, INC.	TBD	SEE PLANS	DARK BRONZE	
9	BALCONY / DECK	TBD	COMPOSITE	SEE PLANS	TBD	
10	BALCONY FASCIA & TRIM	TBD	-	-	TBD	
11	PATIO DOORS	TBD	SEE SCHEDULE	SEE PLANS	SEE WINDOW SCHEDULE	
12	STEEL ENTRY DOOR	-	INSULATED	SEE DOOR SCHEDULE	PAINT TO MATCH ADJACENT MATERIAL	
13	OVERHEAD GARAGE DOOR	-	-	SEE DOOR SCHEDULE	-	
14	ALUMINUM ENTRANCE DOOR(S)	KAWNEER - OR EQUAL	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
15	ALUMINUM STOREFRONT SYSTEM	TBD	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
16	DOOR / WINDOW TRIM	TBD	TBD	1x4	TBD	
17	PATIO AREA UNIT DIVIDER WALLS	TBD	-	SEE PLANS	TBD	
18	PRECAST CONCRETE BAND - PROFILE #1	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
19	PRECAST CONCRETE BAND - PROFILE #2	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
20	PRECAST CONCRETE LINTEL- PROFILE #3	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
21	METAL WALL CAP	-	-	SEE PLANS	PAINT TO MATCH ADJACENT MATERIAL	
22	SOLDIER COURSE - MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
23	CORNICE	-	EIFS CORNICE	-	-	
24	TYPICAL FASCIA	ROLLEX - OR EQUAL	FIBER CEMENT	SEE PLANS	CLAY	
25	RESIDENTIAL HVAC LOUVER / GRILLE	TBD	EXTRUDED ALUMINUM	TBD	PAINT TO MATCH ADJACENT MATERIALS	

14 SOUTH ELEVATION
1/8" = 1'-0"

26 NORTH ELEVATION
1/8" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

EXTERIOR ELEVATIONS

SHEET NUMBER

A201

10/24/2023 5:01:49 PM

EXTERIOR MATERIAL LEGEND

BRICK 01

BRICK 02

PANEL 01

PANEL 02

WINDOW COLOR

STONE ROUGH FACE ONLY

FIBER CEMENT SIDING - 6" EXPOSURE

ALUMINUM RAILING - MEDIUM BRONZE

EXTERIOR MATERIALS SCHEDULE

MARK	DESCRIPTION	MANUFACTURER	TYPE / STYLE	DIMENSIONS	COLOR	NOTES
1	WINDOW (DARK)	MARVIN ESSENTIAL WINDOWS	SEE SCHEDULE	SEE WINDOW SCHEDULE	BLACK	
2	MASONRY - STONE	DUTCH QUALITY	MANUFACTURED STONE VENEER	4" NOMINAL	NATURAL BLEND - WEATHER LEDGE	
3	MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
4	MASONRY - 2 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	WINTER BLEND	
5	PANEL - 1 (DARK)	NICHIHA	CORBOSA CONCRETE SERIES	TBD	SHADOW	
6	PANEL - 2 (ACCENT)	CERACLAD	ORIGINAL DESIGN	TBD	ELEMENTS / CORTEN STEEL	
7	SIDING - 1	JAMES HARDIE	CEDARMILL HORIZONTAL	8" NOMINAL (6" EXPOSURE)	COBBLESTONE	
8	BALCONY RAILING	WILLIAMS, INC.	TBD	SEE PLANS	DARK BRONZE	
9	BALCONY / DECK	TBD	COMPOSITE	SEE PLANS	TBD	
10	BALCONY FASCIA & TRIM	TBD			TBD	
11	PATIO DOORS	TBD	SEE SCHEDULE	SEE PLANS	SEE WINDOW SCHEDULE	
12	STEEL ENTRY DOOR		INSULATED	SEE DOOR SCHEDULE	PAINT TO MATCH ADJACENT MATERIAL	
13	OVERHEAD GARAGE DOOR			SEE DOOR SCHEDULE		
14	ALUMINUM ENTRANCE DOOR(S)	KAWNEER - OR EQUAL	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
15	ALUMINUM STOREFRONT SYSTEM	TBD	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
16	DOOR / WINDOW TRIM	TBD	TBD	1x4	TBD	
17	PATIO AREA UNIT DIVIDER WALLS	TBD	-	SEE PLANS	TBD	
18	PRECAST CONCRETE BAND - PROFILE #1	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
19	PRECAST CONCRETE BAND - PROFILE #2	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
20	PRECAST CONCRETE LINTEL- PROFILE #3	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
21	METAL WALL CAP		-	SEE PLANS	PAINT TO MATCH ADJACENT MATERIAL	
22	SOLDIER COURSE - MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
23	CORNICE		EIFS CORNICE			
24	TYPICAL FASCIA	ROLLEX - OR EQUAL	FIBER CEMENT	SEE PLANS	CLAY	
25	RESIDENTIAL HVAC LOUVER / GRILLE	TBD	EXTRUDED ALUMINUM	TBD	PAINT TO MATCH ADJACENT MATERIALS	

7 WEST ELEVATION - 1
1/8" = 1'-0"

19 WEST ELEVATION - 2
1/8" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

EXTERIOR ELEVATIONS

SHEET NUMBER

A202

10/24/2023 8:01:58 PM

EXTERIOR MATERIAL LEGEND

BRICK 01

BRICK 02

PANEL 01

PANEL 02

WINDOW COLOR

STONE ROUGH FACE ONLY

FIBER CEMENT SIDING - 6" EXPOSURE

ALUMINUM RAILING - MEDIUM BRONZE

EXTERIOR MATERIALS SCHEDULE

MARK	DESCRIPTION	MANUFACTURER	TYPE / STYLE	DIMENSIONS	COLOR	NOTES
1	WINDOW (DARK)	MARVIN ESSENTIAL WINDOWS	SEE SCHEDULE	SEE WINDOW SCHEDULE	BLACK	
2	MASONRY - STONE	DUTCH QUALITY	MANUFACTURED STONE VENEER	4" NOMINAL	NATURAL BLEND - WEATHER LEDGE	
3	MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
4	MASONRY - 2 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	WINTER BLEND	
5	PANEL - 1 (DARK)	NICHIHA	CORBOSA CONCRETE SERIES	TBD	SHADOW	
6	PANEL - 2 (ACCENT)	CERACLAD	ORIGINAL DESIGN	TBD	ELEMENTS / CORTEN STEEL	
7	SIDING - 1	JAMES HARDIE	CEDARMILL HORIZONTAL	8" NOMINAL (6" EXPOSURE)	COBBLESTONE	
8	BALCONY RAILING	WILLIAMS, INC.	TBD	SEE PLANS	DARK BRONZE	
9	BALCONY / DECK	TBD	COMPOSITE	SEE PLANS	TBD	
10	BALCONY FASCIA & TRIM	TBD	-	-	TBD	
11	PATIO DOORS	TBD	SEE SCHEDULE	SEE PLANS	SEE WINDOW SCHEDULE	
12	STEEL ENTRY DOOR	-	INSULATED	SEE DOOR SCHEDULE	PAINT TO MATCH ADJACENT MATERIAL	
13	OVERHEAD GARAGE DOOR	-	-	SEE DOOR SCHEDULE	-	
14	ALUMINUM ENTRANCE DOOR(S)	KAWNEER - OR EQUAL	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
15	ALUMINUM STOREFRONT SYSTEM	TBD	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
16	DOOR / WINDOW TRIM	TBD	TBD	1x4	TBD	
17	PATIO AREA UNIT DIVIDER WALLS	TBD	-	SEE PLANS	TBD	
18	PRECAST CONCRETE BAND - PROFILE #1	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
19	PRECAST CONCRETE BAND - PROFILE #2	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
20	PRECAST CONCRETE LINTEL- PROFILE #3	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
21	METAL WALL CAP	-	-	SEE PLANS	PAINT TO MATCH ADJACENT MATERIAL	
22	SOLDIER COURSE - MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
23	CORNICE	-	EIFS CORNICE	-	-	
24	TYPICAL FASCIA	ROLLEX - OR EQUAL	FIBER CEMENT	SEE PLANS	CLAY	
25	RESIDENTIAL HVAC LOUVER / GRILLE	TBD	EXTRUDED ALUMINUM	TBD	PAINT TO MATCH ADJACENT MATERIALS	

13 COURTYARD NORTH ELEVATION
1/8" = 1'-0"

17 COURTYARD NORTHEAST ELEVATION
1/8" = 1'-0"

25 COURTYARD EAST ELEVATION
1/8" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

EXTERIOR ELEVATIONS

SHEET NUMBER

A203

10/24/2023 5:01:08 PM

EXTERIOR MATERIAL LEGEND

BRICK 01

BRICK 02

PANEL 01

PANEL 02

WINDOW COLOR

STONE ROUGH FACE ONLY

FIBER CEMENT SIDING - 6" EXPOSURE

ALUMINUM RAILING - MEDIUM BRONZE

EXTERIOR MATERIALS SCHEDULE

MARK	DESCRIPTION	MANUFACTURER	TYPE / STYLE	DIMENSIONS	COLOR	NOTES
1	WINDOW (DARK)	MARVIN ESSENTIAL WINDOWS	SEE SCHEDULE	SEE WINDOW SCHEDULE	BLACK	
2	MASONRY - STONE	DUTCH QUALITY	MANUFACTURED STONE VENEER	4" NOMINAL	NATURAL BLEND - WEATHER LEDGE	
3	MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
4	MASONRY - 2 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	WINTER BLEND	
5	PANEL - 1 (DARK)	NICHIHA	CORBOSA CONCRETE SERIES	TBD	SHADOW	
6	PANEL - 2 (ACCENT)	CERACLAD	ORIGINAL DESIGN	TBD	ELEMENTS / CORTEN STEEL	
7	SIDING - 1	JAMES HARDIE	CEDARMILL HORIZONTAL	8" NOMINAL (6" EXPOSURE)	COBBLESTONE	
8	BALCONY RAILING	WILLIAMS, INC.	TBD	SEE PLANS	DARK BRONZE	
9	BALCONY / DECK	TBD	COMPOSITE	SEE PLANS	TBD	
10	BALCONY FASCIA & TRIM	TBD			TBD	
11	PATIO DOORS	TBD	SEE SCHEDULE	SEE PLANS	SEE WINDOW SCHEDULE	
12	STEEL ENTRY DOOR		INSULATED	SEE DOOR SCHEDULE	PAINT TO MATCH ADJACENT MATERIAL	
13	OVERHEAD GARAGE DOOR			SEE DOOR SCHEDULE		
14	ALUMINUM ENTRANCE DOOR(S)	KAWNEER - OR EQUAL	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
15	ALUMINUM STOREFRONT SYSTEM	TBD	PREFINISHED ALUMINUM	SEE DOOR SCHEDULE	TBD	
16	DOOR / WINDOW TRIM	TBD	TBD	1x4	TBD	
17	PATIO AREA UNIT DIVIDER WALLS	TBD	-	SEE PLANS	TBD	
18	PRECAST CONCRETE BAND - PROFILE #1	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
19	PRECAST CONCRETE BAND - PROFILE #2	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
20	PRECAST CONCRETE LINTEL- PROFILE #3	TBD	PRECAST CONCRETE	SEE PRECAST PROFILES	TBD	
21	METAL WALL CAP		-	SEE PLANS	PAINT TO MATCH ADJACENT MATERIAL	
22	SOLDIER COURSE - MASONRY - 1 (BRICK)	CLOUD CERAMICS-KANSAS BRICK & TILE	UTILITY BRICK	UTILITY SIZE	COFFEE	
23	CORNICE		EIFS CORNICE			
24	TYPICAL FASCIA	ROLLEX - OR EQUAL	FIBER CEMENT	SEE PLANS	CLAY	
25	RESIDENTIAL HVAC LOUVER / GRILLE	TBD	EXTRUDED ALUMINUM	TBD	PAINT TO MATCH ADJACENT MATERIALS	

13 COURTYARD SOUTH ELEVATION
1/8" = 1'-0"

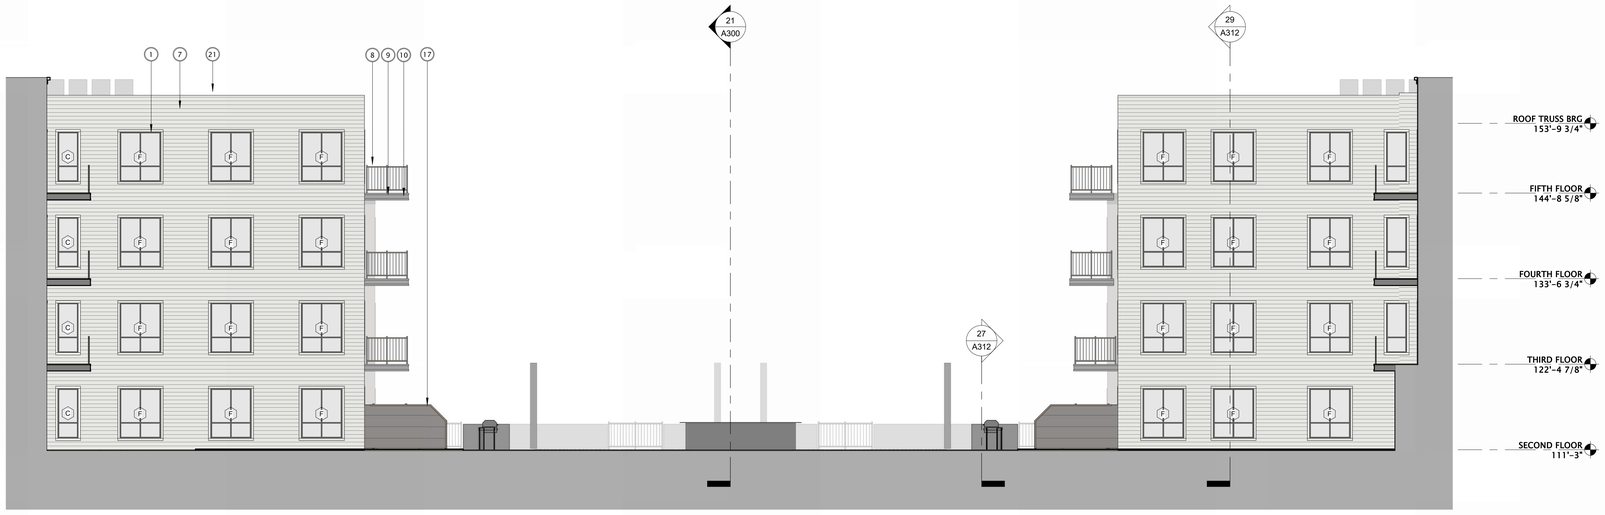

25 COURTYARD WEST ELEVATION
1/8" = 1'-0"

10/24/2023 5:02:02 PM

JLA ARCHITECTS

MADISON | MILWAUKEE | DENVER

JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

EXTERIOR ELEVATIONS

SHEET NUMBER

A204

7 BUILDING SECTION
3/32" = 1'-0"

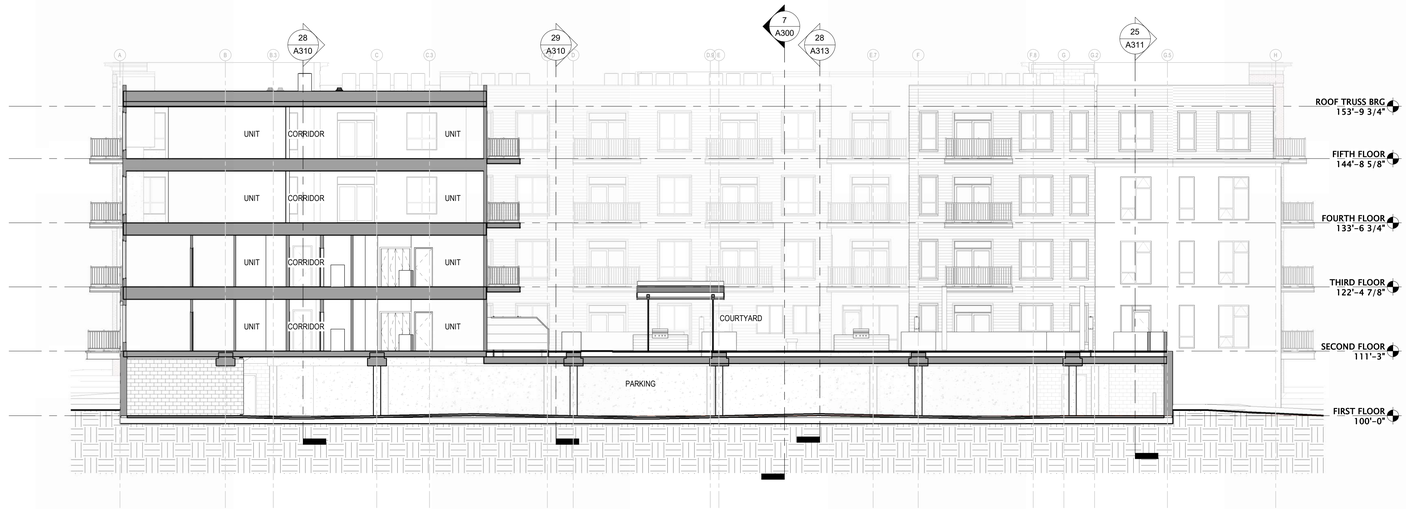

21 BUILDING SECTION
3/32" = 1'-0"

JLA ARCHITECTS
MADISON | MILWAUKEE | DENVER
JLA-AP.COM

JLA PROJECT NUMBER: W22-0913

HARTUNG FIELDS - BUILDING A

ADR PLAN SET

PROGRESS DOCUMENTS

These documents reflect progress and intent and may be subject to change, including additional detail. These are not final construction documents and should not be used for final bidding or construction-related purposes.

DATE OF ISSUANCE 10/24/2023

REVISION SCHEDULE

Mark	Description	Date

SHEET TITLE

BUILDING SECTIONS

SHEET NUMBER

A300

10/24/2023 5:02:08 PM

© Vierbicher Associates, Inc.

HARTUNG FIELDS

CITY OF FITCHBURG

DANE COUNTY, WISCONSIN

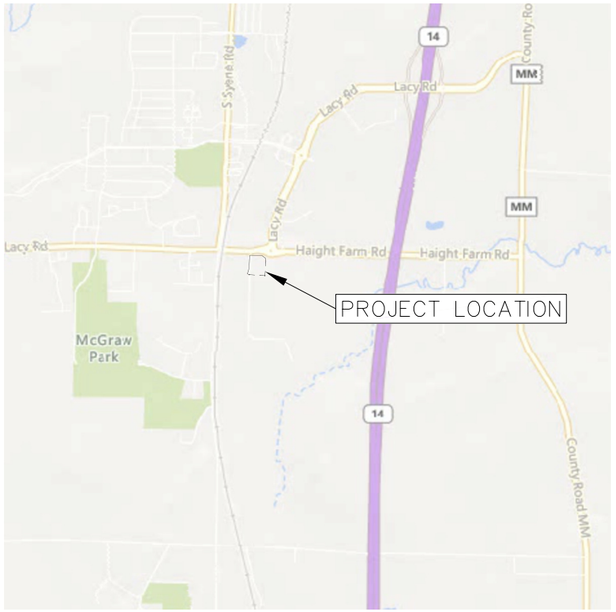

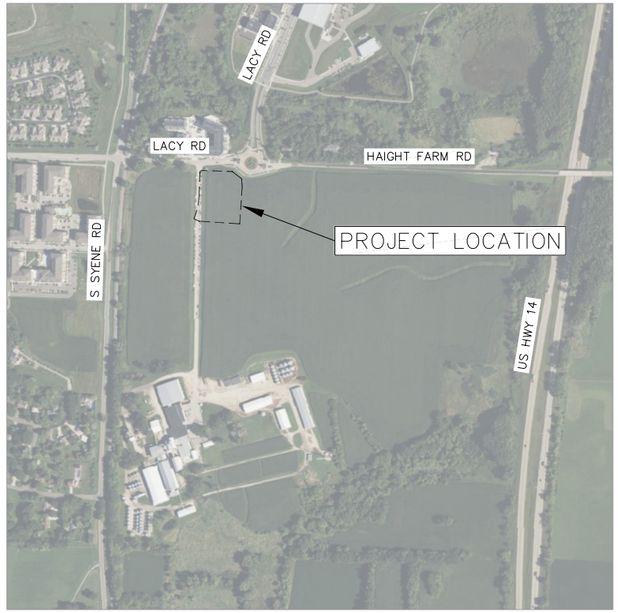

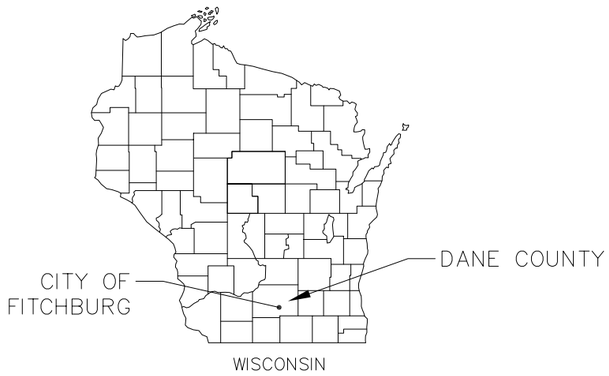

DIGGERS HOTLINE
Dial 811 or (800) 242-8511
www.DiggersHotline.com

THE LOCATION OF EXISTING UTILITIES, BOTH UNDERGROUND AND OVERHEAD ARE APPROXIMATE ONLY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR ITS REPRESENTATIVE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT LOCATION OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT, BEFORE COMMENCING WORK, AND SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UTILITIES.

CALL DIGGER'S HOTLINE
1-800-242-8511

SHEET NO.	DESCRIPTION
0	TITLE SHEET
1	NOTES & LEGENDS
2	EXISTING CONDITIONS
3	DEMOLITION PLAN
4	SITE PLAN
5	GRADING PLAN
6	UTILITY PLAN
7-10	CONSTRUCTION DETAILS
L1-3	LANDSCAPE PLAN

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

TITLE SHEET
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS
NO. | DATE | REMARKS

REVISIONS
NO. | DATE | REMARKS

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C0

24 Oct 2023 - 3:05p M:\Inventure Capital\230003_Hartung\CADD\230003 - Title and Details.dwg by: bhan

© Vierbicher Associates, Inc.

TOPOGRAPHIC SYMBOL LEGEND

- EXISTING CURB INLET
- EXISTING ENDWALL
- EXISTING FIELD INLET RECTANGULAR
- EXISTING FIELD INLET
- EXISTING STORM MANHOLE
- EXISTING SANITARY MANHOLE
- EXISTING FIRE HYDRANT
- EXISTING WATER MAIN VALVE

TOPOGRAPHIC LINEWORK LEGEND

- SAN SAN — EXISTING SANITARY SEWER LINE (SIZE NOTED)
- ST ST — EXISTING STORM SEWER LINE (SIZE NOTED)
- WM WM — EXISTING WATER MAIN (SIZE NOTED)
- 820 — EXISTING MAJOR CONTOUR
- 818 — EXISTING MINOR CONTOUR
- EXISTING EDGE OF PAVEMENT
- EXISTING CONCRETE SURFACE
- EXISTING ASPHALT SURFACE

PROPOSED UTILITY LEGEND

- STORM SEWER PIPE
- STORM SEWER MANHOLE
- STORM SEWER ENDWALL
- STORM SEWER CURB INLET
- STORM SEWER CURB INLET W/MANHOLE
- STORM SEWER FIELD INLET
- ROOF DRAIN CLEANOUT
- SANITARY SEWER PIPE (GRAVITY)
- FM FM — SANITARY SEWER PIPE (FORCE MAIN)
- SANITARY SEWER LATERAL PIPE
- SANITARY SEWER MANHOLE
- SANITARY SEWER CLEANOUT
- WATER MAIN
- WATER SERVICE LATERAL PIPE
- FIRE HYDRANT
- WATER VALVE
- CURB STOP
- WATER VALVE MANHOLE
- PROPOSED PIPE INSULATION
- G G — GAS MAIN
- UE UE — ELECTRIC SERVICE

ABBREVIATIONS

STMH – STORM MANHOLE
FI – FIELD INLET
CI – CURB INLET
CB – CATCH BASIN
EW – ENDWALL
SMH – SANITARY MANHOLE

SITE PLAN LEGEND

- PROPERTY BOUNDARY
- CURB AND GUTTER (REVERSE CURB HATCHED)
- PROPOSED CHAIN LINK FENCE
- PROPOSED WOOD FENCE
- PROPOSED CONCRETE
- PROPOSED LIGHT–DUTY ASPHALT
- PROPOSED HEAVY–DUTY ASPHALT
- PROPOSED SIGN
- PROPOSED LIGHT POLE
- PROPOSED BOLLARD
- PROPOSED ADA DETECTABLE WARNING FIELD
- PROPOSED HANDICAP PARKING

ABBREVIATIONS

TC – TOP OF CURB
FF – FINISHED FLOOR
FL – FLOW LINE
SW – TOP OF WALK
TW – TOP OF WALL
BW – BOTTOM OF WALL

SITE PLAN NOTES:

1. CONCRETE TO BE 5" THICK, CONSTRUCTED ON A BASE OF 4" COMPACTED BASE COURSE UNLESS OTHERWISE NOTED.
2. CONCRETE FOR DRIVEWAYS AND SIDEWALK AT DRIVEWAY ENTRANCES SHALL BE 7" THICK, CONSTRUCTED ON A BASE COURSE OF 5" COMPACTED SAND OR CRUSHED STONE UNLESS OTHERWISE NOTED.
3. ALL DIMENSIONS WITH CURB & GUTTER ARE REFERENCED TO THE FACE OF CURB.
4. CONTRACTOR SHALL DEEP TILL ANY DISTURBED AREAS TO BE RESTORED WITH TOPSOIL AFTER CONSTRUCTION IS COMPLETE AND BEFORE RESTORING.
5. CONTRACTOR TO OBTAIN ANY NECESSARY DRIVEWAY CONNECTION, RIGHT OF WAY AND EXCAVATION PERMITS PRIOR TO CONSTRUCTION.
6. ANY SIDEWALK AND CURB & GUTTER ABUTTING THE PROPERTY SHALL BE REPLACED IF IT IS DAMAGED DURING CONSTRUCTION OR IF THE CITY ENGINEERING DEPARTMENT DETERMINES THAT IT IS NOT AT A DESIRABLE GRADE, REGARDLESS OF WHETHER THE CONDITION EXISTED PRIOR TO BEGINNING CONSTRUCTION.
7. SEE ARCHITECTS PLANS FOR THE BUILDING DIMENSIONS. ALL BUILDING DIMENSIONS SHALL BE COORDINATED AND VERIFIED WITH THE ARCHITECTS PLANS. ALL DIMENSIONS TO BUILDINGS SHALL BE FIELD VERIFIED PRIOR TO CONSTRUCTION.

GRADING LEGEND

- 820 — EXISTING MAJOR CONTOURS
- 818 — EXISTING MINOR CONTOURS
- (820) PROPOSED MAJOR CONTOURS
- (818) PROPOSED MINOR CONTOURS
- DITCH CENTERLINE
- SILT FENCE
- DISTURBED LIMITS
- BERM
- DRAINAGE DIRECTION
- 2.92% PROPOSED SLOPE ARROWS
- 1048.61 PROPOSED SPOT ELEVATIONS (BY OTHERS)
- 1048.61 PROPOSED SPOT ELEVATIONS
- STONE WEEPER
- VELOCITY CHECK
- INLET PROTECTION
- EROSION MAT CLASS I, TYPE A
- EROSION MAT CLASS II, TYPE B
- EROSION MAT CLASS III, TYPE C
- EROSION MAT CLASS II, TYPE A
- TRACKING PAD
- RIP RAP

GENERAL NOTES:

1. THE LOCATION OF EXISTING UTILITIES, BOTH UNDERGROUND AND OVERHEAD ARE APPROXIMATE ONLY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR ITS REPRESENTATIVE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT LOCATION OF ALL EXISTING UTILITIES WHETHER SHOWN ON THESE PLANS OR NOT, BEFORE COMMENCING WORK, AND SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UTILITIES. THE CONTRACTOR SHALL ALSO VERIFY TOPOGRAPHIC INFORMATION PRIOR TO STARTING CONSTRUCTION.
2. THE CONTRACTOR IS RESPONSIBLE FOR ANY DAMAGE CAUSED DURING CONSTRUCTION TO PUBLIC PROPERTY, PRIVATE PROPERTY OR UTILITIES.
3. THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR REVIEW BY THE ENGINEER PRIOR TO INSTALLATION OF SUCH ITEM.
4. RIGHT OF WAY (ROW) AND PROPERTY LINES ARE APPROXIMATE. CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING EXISTING PROPERTY CORNER MONUMENTATION. ANY MONUMENTS DISTURBED BY CONTRACTOR SHALL BE REPLACED AT THE CONTRACTORS EXPENSE.
5. CONTRACTOR SHALL COORDINATE WITH DRY UTILITY COMPANY'S REGARDING ANY POTENTIAL CONFLICTS AND COORDINATE RELOCATIONS AS MAY BE REQUIRED. CONTRACTOR SHALL ALSO COORDINATE THE PROPOSED INSTALLATION OF NEW FACILITIES AS REQUIRED.
5. CONTRACTOR SHALL OBTAIN ANY NECESSARY WORK IN RIGHT OF WAY, EXCAVATION, DRIVEWAY, UTILITY CONNECTION, PLUGGING AND ABANDONMENT PERMITS PRIOR TO CONSTRUCTION.
6. RETAINING WALLS TO BE DESIGNED BY OTHERS
7. ALL WORK WITHIN THE RIGHT–OF–WAY SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITION OF THE CITY OF FITCHBURG STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.

DEMOLITION NOTES:

1. CONTRACTOR SHALL KEEP ALL STREETS FREE AND CLEAR OF CONSTRUCTION RELATED DIRT/DUST/DEBRIS.
2. COORDINATE EXISTING UTILITY REMOVAL/ABANDONMENT WITH LOCAL AUTHORITIES AND UTILITY COMPANIES HAVING JURISDICTION.
3. ALL SAWCUTTING SHALL BE FULL DEPTH TO PROVIDE A CLEAN EDGE TO MATCH NEW CONSTRUCTION. MATCH EXISTING ELEVATIONS AT POINTS OF CONNECTION FOR NEW AND EXISTING PAVEMENT, CURB, SIDEWALKS, ETC. ALL SAWCUT LOCATIONS SHOWN ARE APPROXIMATE AND MAY BE FIELD ADJUSTED TO ACCOMMODATE CONDITIONS, JOINTS, MATERIAL TYPE, ETC. REMOVE MINIMUM AMOUNT NECESSARY FOR INSTALLATION OF PROPOSED IMPROVEMENTS.
4. CONTRACTOR SHALL PROVIDE AND SHALL BE RESPONSIBLE FOR ANY NECESSARY TRAFFIC CONTROL SIGNAGE AND SAFETY MEASURES DURING DEMOLITION AND CONSTRUCTION OPERATIONS WITHIN OR NEAR THE PUBLIC ROADWAY.
5. COORDINATE TREE REMOVAL WITH LANDSCAPE ARCHITECT. ALL TREES TO BE REMOVED SHALL BE REMOVED IN THEIR ENTIRETY AND STUMPS SHALL BE GROUND TO 12" BELOW PROPOSED SUBGRADE.
6. IF APPLICABLE, PROVIDE TREE PROTECTION FENCING PRIOR TO CONSTRUCTION OPERATIONS. MAINTAIN THROUGHOUT CONSTRUCTION.
7. ALL LIGHT POLES TO BE REMOVED FROM PRIVATE PROPERTY SHALL BE REMOVED IN THEIR ENTIRETY, INCLUDING BASE AND ALL APPURTENANCES. COORDINATE ABANDONMENT OF ELECTRICAL LINES WITH ELECTRICAL ENGINEER AND OWNER PRIOR TO DEMOLITION.
8. CONTRACTOR SHALL CLOSE ALL ABANDONED DRIVEWAYS BY REPLACING THE CURB IN FRONT OF THE DRIVEWAYS AND RESTORING THE TERRACE WITH GRASS.
9. CONTRACTOR SHALL OBTAIN ANY NECESSARY DEMOLITION AND UTILITY PLUGGING PERMITS.
10. ANY DAMAGE TO THE PUBLIC STREETS, INCLUDING DAMAGE RESULTING FROM CURB REPLACEMENT, WILL REQUIRE RESTORATION IN ACCORDANCE WITH THE CITY PATCHING CRITERIA.

GRADING NOTES:

1. CONTOURS ARE SHOWN FOR PURPOSES OF INDICATING ROUGH GRADING. FINAL GRADE SHALL BE ESTABLISHED ON PAVED SURFACES BY USING SPOT GRADES ONLY.
2. ALL GRADES SHOWN REFERENCE FINISHED ELEVATIONS.
3. CROSS SLOPE OF SIDEWALKS SHALL BE 2.0% UNLESS OTHERWISE NOTED.
4. LONGITUDINAL GRADE OF SIDEWALK RAMPS SHALL NOT EXCEED 8.33% (1:12) AND SHALL BE IN ACCORDANCE WITH ADA REQUIREMENTS.
5. LONGITUDINAL GRADE OF SIDEWALK SHALL NOT EXCEED 5.0% OR THE ADJACENT STREET GRADE WHICHEVER IS GREATER.
6. ACCESSIBLE ROUTES SHALL BE 5.0% MAX LONGITUDINAL SLOPE AND 1.5% MAX CROSS SLOPE. ACCESSIBLE LOADING AREAS OR LANDINGS SHALL NOT EXCEED 2.0% MAX SLOPE IN ANY DIRECTION. RAMPS SHALL BE 8.33% MAX SLOPE.
7. NO LAND DISTURBANCE ACTIVITIES SHALL BEGIN UNTIL ALL EROSION CONTROL BMP'S ARE INSTALLED.
8. SEE DETAIL SHEETS FOR EROSION CONTROL NOTES AND CONSTRUCTION SEQUENCE.

UTILITY NOTES:

1. CONTRACTOR TO VERIFY EXISTING UTILITY LOCATIONS AND ELEVATIONS PRIOR TO STARTING WORK.
2. SANITARY & STORM SEWER LENGTHS SHOWN ARE FROM CENTER OF STRUCTURE TO CENTER OF STRUCTURE. STORM SEWER END SECTIONS ARE INCLUDED IN THE LENGTH AND SLOPE OF THE PIPE.
3. CONTRACTOR SHALL INVESTIGATE ALL UTILITY CROSSINGS PRIOR TO CONSTRUCTION AND NOTIFY ENGINEER OF ANY CONFLICTS.
4. CONTRACTOR SHALL BE RESPONSIBLE FOR ADJUSTING ALL UTILITY STRUCTURES TO FINISHED GRADE (MANHOLE RIMS, WATER VALVES, AND CURB STOPS), IF NECESSARY.
5. FOR ALL SEWER AND WATER MAIN CROSSINGS: PROVIDE MINIMUM 18" SEPARATION WHEN WATER MAIN CROSSES BELOW SEWER AND MINIMUM 6" SEPARATION WHEN WATER MAIN CROSSES ABOVE SEWER.
6. IF DEWATERING OPERATIONS EXCEED 70 GALLONS PER MINUTE OF PUMPING CAPACITY, A DEWATERING WELL PERMIT SHALL BE OBTAINED PRIOR TO STARTING ANY DEWATERING ACTIVITIES.
7. A COPY OF THE APPROVED UTILITY PLANS, SPECIFICATIONS AND PLUMBING PERMIT APPROVAL LETTER SHALL BE ON–SITE DURING CONSTRUCTION AND OPEN TO INSPECTION BY AUTHORIZED REPRESENTATIVES OF THE DEPARTMENT OF SAFETY AND PROFESSIONAL SERVICES AND OTHER LOCAL INSPECTORS.
8. PROPOSED UTILITY SERVICE LINES SHOWN ARE APPROXIMATE. COORDINATE THE EXACT LOCATIONS WITH THE PLUMBING DRAWINGS. COORDINATE THE LOCATION WITH THE PLUMBING CONTRACTOR AND/OR OWNER'S CONSTRUCTION REPRESENTATIVE PRIOR TO INSTALLATION OF ANY NEW UTILITIES.
9. STORM BUILDING SEWER PIPE SHALL CONFORM TO ONE OF THE STANDARDS LISTED IN TABLE 384.30–6 OF SPS 384.30(3)(C).
10. UNDERGROUND DRAIN AND VENT PIPE/TUBING SHALL CONFORM TO ONE OF THE STANDARDS LISTED IN TABLE 384.30–2 OF SPS 384.30(2).
11. PRIVATE WATER SERVICES AND PRIVATE WATER MAINS SHALL CONFORM TO ONE OF THE STANDARDS LISTED IN TABLE 384.30–7 OF SPS 384.30(4)(D).
12. PRIVATE SANITARY SEWER AND LATERALS SHALL BE POLYVINYL CHLORIDE (PVC) ASTM D3034 – SDR 35 OR APPROVED EQUAL MATERIAL THAT CONFORMS TO ONE OF THE STANDARDS LISTED IN TABLE 384.30–3 OF SPS 384.30(2)(C).
13. A MEANS TO LOCATE BURIED UNDERGROUND EXTERIOR NON METALLIC SEWERS/MAINS AND WATER SERVICES/MAINS MUST BE PROVIDED WITH TRACER WIRE OR OTHER METHODS IN ORDER TO BE LOCATED PER SPS 382.10(11)(H) AND SPS 382.40(8)(K).
14. EXTERIOR WATER SUPPLY PIPING SETBACKS AND CROSSINGS SHALL BE IN ACCORDANCE WITH SPS 382.40(8)(B.).
15. NO PERSON MAY ENGAGE IN PLUMBING WORK IN THE STATE UNLESS LICENSED TO DO SO BY THE DEPARTMENT OF SAFETY AND PROFESSIONAL SERVICES PER S.145.06.
16. SITE CONTRACTOR SHALL LEAVE SANITARY AND WATER LATERALS FIVE (5) FEET SHORT (HORIZONTALLY) FROM THE BUILDING. BUILDING PLUMBER SHALL VERIFY SIZE, LOCATION, AND INVERT ELEVATION OF PROPOSED SANITARY AND WATER LATERALS.
17. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THAT THE EXISTING VALVES WILL HOLD THE PRESSURE TEST PRIOR TO CONNECTION. THE LOCAL MUNICIPALITY IS NOT RESPONSIBLE FOR ANY COSTS INCURRED DUE TO THE CONTRACTOR NOT VERIFYING THAT THE EXISTING VALVE WILL HOLD THE PRESSURE TEST PRIOR TO CONNECTION. IF A NEW VALVE IS REQUIRED, THE APPLICANT WILL BE REQUIRED TO INSTALL ONE AT THEIR EXPENSE, AT THE POINT OF CONNECTION.
18. CONTRACTOR TO CHLORINATE AND BACTERIA TEST BEFORE DOMESTIC SUPPLY PURPOSES. CONTRACTOR SHALL PROVIDE SAFE SAMPLE RESULTS TO FITCHBURG UTILITY PRIOR TO PRESSURE TESTING PRIVATE WATER MAINS.
19. CLEAN OUT ALL EXISTING AND PROPOSED STORM INLETS AND CATCH BASINS AT THE COMPLETION OF CONSTRUCTION.
20. CONTRACTOR SHALL COORDINATE WITH DRY UTILITY COMPANY'S REGARDING ANY POTENTIAL CONFLICTS AND COORDINATE RELOCATIONS AS MAY BE REQUIRED. CONTRACTOR SHALL ALSO COORDINATE THE PROPOSED INSTALLATION OF NEW FACILITIES AS REQUIRED.
21. ALL WATER MAIN AND SERVICES SHALL BE INSTALLED AT A MINIMUM DEPTH OF 6.5' FROM TOP OF FINISHED GRADE ELEVATION TO TOP OF MAIN. PROVIDE 1.5' CLEAR SEPARATION IF WATER CROSSES BELOW SEWER AND MINIMUM 0.5' IF WATER CROSSES ABOVE.
22. PER CITY ORDINANCE, CONTRACTORS ARE NOT ALLOWED TO OPERATE CITY OWNED VALVES. THE CONTRACTOR SHALL CALL THE FITCHBURG UTILITY AT 270–4270 FOR OPERATION OF THESE VALVES.
23. SANITARY MANHOLES WITH SEWER MAIN CONNECTIONS GREATER THAN 2' ABOVE THE LOWEST INVERT SHALL BE CONSTRUCTED WITH AN EXTERNAL DROP. MANHOLES WITH SEWER LATERAL CONNECTIONS GREATER THAT 2' ABOVE THE LOWEST INVERT SHALL BE CONSTRUCTED WITH AN INTERNAL DROP.
24. OPEN PICK HOLES ARE PROHIBITED ON SANITARY MANHOLES.
25. INSTALL 1 SHEET OF 4'X8'X4" HIGH DENSITY STYROFOAM INSULATION AT ALL LOCATIONS WHERE STORM SEWER CROSSES WATER MAIN OR WATER LATERALS.
26. CONTRACTOR TO INSTALL BENDS AND CLEANOUTS AS NECESSARY ON WATER AND SEWER LATERALS.

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

NOTES & LEGENDS

HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS		
NO.	DATE	REMARKS

REVISIONS		
NO.	DATE	REMARKS

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C1

24 Oct 2023 - 3:06p M:\Inventure Capital\230003_Hartung\CADD\230003 - Title and Details.dwg by: bhan

© Vierbicher Associates, Inc.

GENERAL NOTES:

1. Existing features, utilities, and property lines shown are based on engineering plans prepared by D'Onofrio, Kottke and Associates (DKA) dated October 16, 2023. This is anticipated to be completed prior to commencement of the Hartung Fields, Lot 8 work.

2. No attempt has been made as a part of this plan to obtain or show data concerning condition or capacity of any utility or municipal/public service facility. For information regarding these utilities contact the appropriate agencies.

BOTANICAL DRIVE

LACY ROAD

BLANEY ROAD

LOT 7

LOT 8

20' EASEMENT

11.4' WIDE PUBLIC PEDESTRIAN ACCESS EASEMENT

6' UTILITY EASEMENT

8' UTILITY EASEMENT

10' UTILITY EASEMENT

EX STMH
RIM=919.33
IE=911.09 N
IE=911.09 E

EX CIN
TC=917.91
IE=902.79 W
IE=902.79 E

EX SMH
RIM=916.43
IE=901.62 N
IE=901.72 S

EX CIN
TC=911.00
IE=907.30 N

EX SMH
RIM=910.92
IE=897.89 W

EX SMH
RIM=918.75
IE=902.00 N
IE=902.10 SW
IE=902.20 E

EX CIN
TC=911.04
IE=907.18 E
IE=907.18 S

EX CIN
TC=917.97
IE=903.82 N
IE=903.32 W
IE=904.82 S

EX CIN
TC=911.00
IE=907.06 N

EX SMH
RIM=911.14
IE=898.45 S
IE=898.35 E
IE=898.25 W

EX STMH
RIM=910.72
IE=906.74 W
IE=906.49 E
IE=905.74 N
IE=904.99 S

EX CIN
TC=911.12
IE=906.83 S
IE=906.58 W
IE=906.58 E

EX STMH
RIM=911.21
IE=905.86 E
IE=905.86 S

EX STMH
RIM=916.74
IE=912.49 E
IE=911.99 W

EX STMH
RIM=914.78
IE=907.04 W
IE=907.29 SE

EX SMH
RIM=914.42
IE=899.55 W
IE=899.65 SE
IE=899.75 S

EX STMH
RIM=922.64
IE=915.85 W
IE=915.85 E

EX CIN
TC=923.48
IE=916.10 W
IE=916.10 E

EX STMH
RIM=925.15
IE=916.43 N
IE=916.93 S
IE=916.68 E

EX STMH
RIM=923.62
IE=916.63 E
IE=916.13 S
IE=916.13 W

EX CIN
TC=924.10
IE=919.10 W

EX CIN
TC=913.27
IE=907.77 S
IE=907.77 NW

EX CIN
TC=913.01
IE=907.93 N
IE=907.93 E

GRAPHIC SCALE FEET
0 10 20 40

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

EXISTING CONDITIONS

HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C2

24 Oct 2023 - 2:18p M:\Inventure Capital\230003_Hartung\CADD\230003 - Existing Conditions.dwg by: bhan

© Vierbicher Associates, Inc.

BOTANICAL DRIVE

EX STMH
RIM=919.33
IE=911.09 N
IE=911.09 E

EX SMH
RIM=918.75
IE=902.00 N
IE=902.10 SW
IE=902.20 E

EX CIN
TC=917.91
IE=902.79 W
IE=902.79 E

EX SMH
RIM=916.43
IE=901.62 N
IE=901.72 S

EX CIN
TC=917.97
IE=903.82 N
IE=903.32 W
IE=904.82 S

EX CIN
TC=911.00
IE=907.30 N

EX CIN
TC=911.04
IE=907.18 E
IE=907.18 S

EX SMH
RIM=910.92
IE=897.89 W

EX CIN
TC=911.00
IE=907.06 N

EX SMH
RIM=911.14
IE=898.45 S
IE=898.35 E
IE=898.25 W

EX STMH
RIM=910.72
IE=906.74 W
IE=906.49 E
IE=905.74 N
IE=904.99 S

EX STMH
RIM=911.21
IE=905.86 E
IE=905.86 S

EX CIN
TC=911.12
IE=906.83 S
IE=906.58 W
IE=906.58 E

SAWCUT AND REMOVE EXISTING CURB. MAINTAIN EXISTING FLAG.

REMOVE AND REPLACE CONCRETE (TYP.)

LACY ROAD

GRAPHIC SCALE FEET
0 10 20 40

LOT 7

LOT 8

20' WIDE PUBLIC STORM SEWER EASEMENT

11.4' WIDE PUBLIC PEDESTRIAN ACCESS EASEMENT

EX STMH
RIM=916.74
IE=912.49 E
IE=911.99 W

EX STMH
RIM=922.64
IE=915.85 W
IE=915.85 E

EX STMH
RIM=914.78
IE=907.04 W
IE=907.29 SE

6' UTILITY EASEMENT

EX SMH
RIM=914.42
IE=899.55 W
IE=899.65 SE
IE=899.75 S

10' UTILITY EASEMENT

8' UTILITY EASEMENT

REMOVE AND REPLACE CONCRETE (TYP.)

SAWCUT AND REMOVE EXISTING CURB. MAINTAIN EXISTING FLAG.

EX CIN
TC=923.48
IE=916.10 W
IE=916.10 E

EX STMH
RIM=925.15
IE=916.43 N
IE=916.93 S
IE=916.68 E

EX STMH
RIM=923.62
IE=916.63 E
IE=916.13 S
IE=916.13 W

EX CIN
TC=924.10
IE=919.10 W

EX CIN
TC=913.27
IE=907.77 S
IE=907.77 NW

EX CIN
TC=913.01
IE=907.93 N
IE=907.93 E

BLANEY ROAD

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

DEMOLITION PLAN

HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE
10/24/2023

DRAFTER
BHAN

CHECKED
TSCH

PROJECT NO.
230003

C3

24 Oct 2023 - 2:18p M:\Inventure Capital\230003_Hartung\CADD\230003 - Existing Conditions.dwg by: bhan

© Vierbicher Associates, Inc.

BOTANICAL DRIVE

LACY ROAD

BLANEY ROAD

GRAPHIC SCALE FEET
0 10 20 40

18" CURB AND GUTTER (TYP.)

CONCRETE VALLEY GUTTER (TYP.)

CURBED SIDEWALK

DOG RUN

LIMESTONE RETAINING WALL (TYP.)

FUTURE 18" CURB AND GUTTER (TYP.)

FUTURE BUILDING

FUTURE 8' WIDE WALKING TRAIL

AT GRADE PARKING ENTRANCE

ADA SIGNS (3). ONE SHALL BE MOUNTED TO THE FACE OF THE RETAINING WALL.

PROPOSED BUILDING A

AMENITY DECK SEE ARCHITECTURAL PLANS.

ADA RAMP WITH HANDRAILS. SEE ARCHITECTURAL PLANS.

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

SITE PLAN
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C4

24 Oct 2023 - 3:53p M:\Inventure Capital\230003_Hartung\CADD\230003 - BaseEng.dwg by: bhan

© Vierbicher Associates, Inc.

BOTANICAL DRIVE

LACY ROAD

BLANEY ROAD

FUTURE BUILDING

PROPOSED BUILDING
FF=915.00

AMENITY DECK
SEE ARCHITECTURAL
PLANS.

WATERPROOF
BUILDING EXTERIOR
TO ELEVATION 925.00

WATERPROOF
BUILDING EXTERIOR
TO ELEVATION 917.50

GRAPHIC SCALE FEET
0 10 20 40

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

GRADING PLAN

HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE
10/24/2023

DRAFTER
BHAN

CHECKED
TSCH

PROJECT NO.
230003

C5

© Vierbicher Associates, Inc.

BOTANICAL DRIVE

S4: 48" CONC SMH
RIM=917.58
IE=903.31 W
IE=903.41 E

S10: 2' x 3' CI
R-3067 FRAME
TYPE R GRATE
INSTALL OIL & GREASE FILTER
TC=914.27
IE=910.77 N

S1: 48" CONC STMH
R-1550 FRAME
SOLID LID
RIM=912.57
IE=906.84 W
IE=906.92 E
IE=908.85 S

9'-12" RCP STORM @ 1.00%

S12: 2' x 3' CI
R-3067 FRAME
TYPE R GRATE
INSTALL OIL & GREASE FILTER
TC=919.78
IE=912.74 E
IE=912.64 S

65'-8" PVC SAN @ 1.04%

S9: 2' x 3' CI
R-3067 FRAME
TYPE R GRATE
INSTALL OIL & GREASE FILTER
TC=912.44
IE=909.04 S
IE=908.94 N

130'-12" RCP STORM @ 1.33%

29'-12" RCP STORM @ 0.50%

EX STMH
ADJUST RIM TO FINAL GRADE
RIM=920.00
IE=912.49 E
IE=911.99 W
IE=912.49 N

69'-12" HDPE STORM @ 1.04%

8" PVC SANITARY SEWER LATERAL. CONFIRM SIZE, IE, AND LOCATION WITH PLUMBING PLANS

DOG RUN

ROOF DRAIN. CONFIRM SIZE, IE, AND LOCATION WITH PLUMBING PLANS.

118'-12" RCP STORM @ 0.50%

PROPOSED BUILDING A
FF=915.00

AMENITY DECK
SEE ARCHITECTURAL PLANS.

S14: 2' x 3' CI
R-3067 FRAME
TYPE R GRATE
INSTALL OIL & GREASE FILTER
TC=921.55
IE=913.33 W

24'-12" HDPE STORM @ 1.04%

ROOF DRAIN. CONFIRM SIZE, IE, AND LOCATION WITH PLUMBING PLANS.

8" D.I. WATER LATERAL. CONNECT TO EXISTING 8" SERVICE. CONTRACTOR SHALL CONFIRM SIZE, IE, AND LOCATION WITH PLUMBING PLANS

8" PVC SANITARY SEWER LATERAL. CONFIRM SIZE, IE, AND LOCATION WITH PLUMBING PLANS

3'-8" PVC SAN @ 1.04%

S6: 48" CONC SMH
OUTSIDE DROP
RIM=914.88
IE=900.98 N
IE=901.08 SW

LACY ROAD

BLANEY ROAD

GRAPHIC SCALE FEET
0 10 20 40

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

UTILITY PLAN
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C6

24 Oct 2023 - 3:53p M:\Inventure Capital\230003_Hartung\CADD\230003 - BaseEng.dwg by: bhan

© Vierbicher Associates, Inc.

EROSION CONTROL MEASURES

1. EROSION CONTROL SHALL BE IN ACCORDANCE WITH THE CITY OF FITCHBURG EROSION CONTROL ORDINANCE AND CHAPTER NR 216 OF THE WISCONSIN ADMINISTRATIVE CODE.

2. CONSTRUCT AND MAINTAIN ALL EROSION AND SEDIMENT CONTROL MEASURES IN ACCORDANCE WITH WISCONSIN DNR TECHNICAL STANDARDS (http://dnr.wi.gov/runoff/stormwater/techstds.htm) AND WISCONSIN CONSTRUCTION SITE BEST MANAGEMENT PRACTICE HANDBOOK.

3. INSTALL SEDIMENT CONTROL PRACTICES (TRACKING PAD, PERIMETER SILT FENCE, SEDIMENT BASINS, ETC.) PRIOR TO INITIATING OTHER LAND DISTURBING CONSTRUCTION ACTIVITIES.

4. THE CONTRACTOR IS REQUIRED TO MAKE EROSION CONTROL INSPECTIONS AT THE END OF EACH WEEK AND WHEN 0.5 INCHES OF RAIN FALLS WITHIN 24 HOURS. INSPECTION REPORTS SHALL BE PREPARED AND FILED AS REQUIRED BY THE DNR AND/OR CITY. ALL MAINTENANCE SHALL FOLLOW AN INSPECTION WITHIN 24 HOURS.

5. EROSION CONTROL IS THE RESPONSIBILITY OF THE CONTRACTOR UNTIL 70% ESTABLISHMENT, AS DETERMINED BY THE CITY. EROSION CONTROL MEASURES AS SHOWN SHALL BE THE MINIMUM PRECAUTIONS THAT WILL BE ALLOWED. ADDITIONAL EROSION CONTROL MEASURES, AS REQUESTED IN WRITING BY THE STATE OR LOCAL INSPECTORS, OR THE DEVELOPER'S ENGINEER, SHALL BE INSTALLED WITHIN 24 HOURS.

6. A 3" CLEAR STONE TRACKING PAD SHALL BE INSTALLED AT THE END OF ROAD CONSTRUCTION LIMITS TO PREVENT SEDIMENT FROM BEING TRACKED ONTO THE ADJACENT PAVED PUBLIC ROADWAY. SEDIMENT TRACKING PAD SHALL CONFORM TO WisDNR TECHNICAL STANDARD 1057. SEDIMENT REACHING THE PUBLIC ROAD SHALL BE REMOVED BY STREET CLEANING (NOT HYDRAULIC FLUSHING) BEFORE THE END OF EACH WORK DAY.

7. CHANNELIZED RUNOFF: FROM ADJACENT AREAS PASSING THROUGH THE SITE SHALL BE DIVERTED AROUND DISTURBED AREAS.

8. STABILIZED DISTURBED GROUND: ANY SOIL OR DIRT PILES WHICH WILL REMAIN IN EXISTENCE FOR MORE THAN 7-CONSECUTIVE DAYS, WHETHER TO BE WORKED DURING THAT PERIOD OR NOT, SHALL NOT BE LOCATED WITHIN 25-FEET OF ANY ROADWAY, PARKING LOT, PAVED AREA, OR DRAINAGE STRUCTURE OR CHANNEL (UNLESS INTENDED TO BE USED AS PART OF THE EROSION CONTROL MEASURES). TEMPORARY STABILIZATION AND CONTROL MEASURES (SEEDING, MULCHING, TARPING, EROSION MATTING, BARRIER FENCING, ETC.) ARE REQUIRED FOR THE PROTECTION OF DISTURBED AREAS AND SOIL PILES, WHICH WILL REMAIN UN-WORKED FOR A PERIOD OF MORE THAN 14-CONSECUTIVE CALENDAR DAYS. THESE MEASURES SHALL REMAIN IN PLACE UNTIL SITE HAS STABILIZED.

9. SITE DE-WATERING: WATER PUMPED FROM THE SITE SHALL BE TREATED BY TEMPORARY SEDIMENTATION BASINS OR OTHER APPROPRIATE CONTROL MEASURES. SEDIMENTATION BASINS SHALL HAVE A DEPTH OF AT LEAST 3 FEET, BE SURROUNDED BY SNOWFENCE OR EQUIVALENT BARRIER AND HAVE SUFFICIENT SURFACE AREA TO PROVIDE A SURFACE SETTLING RATE OF NO MORE THAN 750 GALLONS PER SQUARE FOOT PER DAY AT THE HIGHEST DEWATERING PUMPING RATE. WATER MAY NOT BE DISCHARGED IN A MANNER THAT CAUSES EROSION OF THE SITE, A NEIGHBORING SITE, OR THE BED OR BANKS OF THE RECEIVING WATER. POLYMERS MAY BE USED AS DIRECTED BY DNR TECHNICAL STANDARD 1061 (DE-WATERING).

10. INLET FILTERS ARE TO BE PLACED IN STORMWATER INLET STRUCTURES AS SOON AS THEY ARE INSTALLED. THE FILTERS SHALL BE MAINTAINED UNTIL THE DISTURBED AREAS ARE BOTH 70% RESTORED AND PAVED.

11. TERRACES SHALL BE RESTORED WITH 6" TOPSOIL, PERMANENT SEED, FERTILIZER AND URBAN CLASS I TYPE A EROSION MAT. LOTS SHALL BE RESTORED WITH 6" TOPSOIL, TEMPORARY SEED, FERTILIZER AND MULCH.

12. SEED, FERTILIZER AND MULCH/E-MAT SHALL BE APPLIED WITHIN 7 DAYS AFTER FINAL GRADE HAS BEEN ESTABLISHED. IF DISTURBED AREAS WILL NOT BE RESTORED IMMEDIATELY AFTER ROUGH GRADING, TEMPORARY SEED SHALL BE PLACED.

13. FOR THE FIRST SIX WEEKS AFTER RESTORATION (E.G. SEED & MULCH, EROSION MAT, SOD) OF A DISTURBED AREA, INCLUDE SUMMER WATERING PROVISIONS OF ALL NEWLY SEEDED AND MULCHED AREAS WHENEVER 7 DAYS ELAPSE WITHOUT A RAIN EVENT.

14. SOIL STABILIZERS SHALL BE APPLIED TO DISTURBED AREAS WITH SLOPES BETWEEN 10% AND 3:1 (DO NOT USE IN CHANNELS). SOIL STABILIZERS SHALL BE TYPE B, PER WISCONSIN D.O.T. P.A.L. (PRODUCT ACCEPTABILITY LIST), OR EQUAL. APPLY AT RATES AND METHODS SPECIFIED PER MANUFACTURER. SOIL STABILIZERS SHALL BE RE-APPLIED WHENEVER VEHICLES OR OTHER EQUIPMENT TRACK ON THE AREA.

15. SILT FENCE OR EROSION MAT SHALL BE INSTALLED ALONG THE CONTOURS AT 100 FOOT INTERVALS DOWN THE SLOPE ON THE DISTURBED SLOPES STEEPER THAN 5% AND MORE THAN 100 FEET LONG THAT SHEET FLOW TO THE ROADWAY UNLESS SOIL STABILIZERS ARE USED.

16. SILT FENCE TO BE USED ACROSS AREAS OF THE LOT THAT SLOPE TOWARDS A PUBLIC STREET OR WATERWAY. SEE DETAILS.

17. SEDIMENT SHALL BE CLEANED FROM CURB AND GUTTER AFTER EACH RAINFALL AND PRIOR TO PROJECT ACCEPTANCE AND AS DIRECTED BY ENGINEER/CITY/OWNER.

18. ALL CONSTRUCTION ENTRANCES SHALL HAVE TWO TYPE III TEMPORARY ROAD CLOSED BARRICADES WITH SIGNS THAT WILL BE IN PLACE WHEN THE ENTRANCE IS NOT IN USE AND AT THE END OF EACH DAY.

19. ANY PROPOSED CHANGES TO THE EROSION CONTROL PLAN MUST BE SUBMITTED AND APPROVED BY THE CITY AND DNR.

20. THE CITY, OWNER AND/OR ENGINEER MAY REQUIRE ADDITIONAL EROSION CONTROL MEASURES AT ANY TIME DURING CONSTRUCTION.

21. THE CONTRACTOR SHALL REMOVE ANY SEDIMENT TRACKED ONTO ADJACENT ROADS BY MEANS OF STREET SWEEPING (NOT FLUSHING) AT A MINIMUM OF THE END OF EACH WORK DAY OR MORE AS NEEDED.

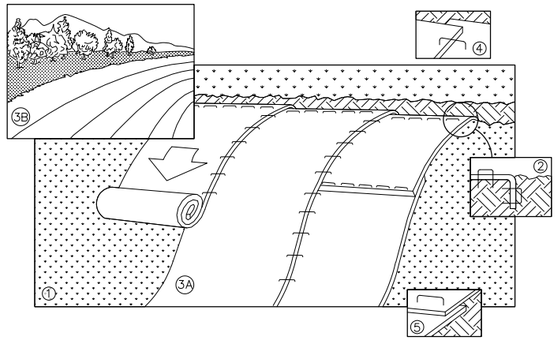

NOTE: REFER TO GENERAL STAPLE PATTERN GUIDE FOR CORRECT STAPLE PATTERN RECOMMENDATIONS FOR SLOPE INSTALLATIONS.

1. PREPARE SOIL BEFORE INSTALLING BLANKETS, INCLUDING APPLICATION OF FERTILIZER AND SEED.
   NOTE: WHEN USING CELL-O-SEED, DO NOT SEED PREPARED AREA. CELL-O-SEED MUST BE INSTALLED WITH PAPER SIDE DOWN.
2. BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE BLANKET IN 6" DEEP BY 6" WIDE TRENCH. BACKFILL AND COMPACT THE TRENCH AFTER STAPLING.
3. ROLL THE BLANKETS <A.> DOWN, OR <B.> HORIZONTALLY ACROSS THE SLOPE.
4. THE EDGES OF PARALLEL BLANKETS MUST BE STAPLED WITH APPROXIMATELY 2" OVERLAP.
5. WHEN BLANKETS MUST BE SPLICED DOWN THE SLOPE, PLACE BLANKETS END OVER END (SHINGLE STYLE) WITH APPROXIMATELY 4" OVERLAP. STAPLE THROUGH OVERLAPPED AREA, APPROXIMATELY 12" APART.
6. ALL BLANKETS MUST BE SECURELY FASTENED TO THE SLOPE BY PLACING STAPLES/STAKES IN APPROPRIATE LOCATIONS AS RECOMMENDED BY THE MANUFACTURER.

1/1 EROSION MAT
NOT TO SCALE

SEEDING RATES:

TEMPORARY:
1. USE ANNUAL OATS AT 3.0 LB./1,000 S.F. FOR SPRING AND SUMMER PLANTINGS.
2. USE WINTER WHEAT OR RYE AT 3.0 LB./1,000 SF FOR FALL PLANTINGS STARTED

AFTER SEPTEMBER 15.

PERMANENT:
1. USE WISCONSIN D.O.T. SEED MIX #40 AT 2 LB./1,000 S.F.

FERTILIZING RATES:

TEMPORARY AND PERMANENT:
USE WISCONSIN D.O.T. TYPE A OR B AT 7 LB./1,000 S.F.

MULCHING RATES:

TEMPORARY AND PERMANENT:
USE ½" TO 1-½" STRAW OR HAY MULCH, CRIMPED PER SECTION 607.3.2.3, OR OTHER RATE AND METHOD PER SECTION 627, WISCONSIN D.O.T. STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION

CONSTRUCTION SEQUENCE:

1. INSTALL SILT FENCE AND TRACKING PAD
2. STRIP TOPSOIL-DETENTION BASINS
3. ROUGH GRADE DETENTION BASINS
4. SEED DETENTION BASINS
5. STRIP TOPSOIL-STREETS & LOTS
6. ROUGH GRADE STREETS & LOTS
7. SEED LOT AREAS AND INSTALL DRIVE-OVER VELOCITY CHECKS
8. CONSTRUCT UNDERGROUND UTILITIES
9. INSTALL INLET PROTECTION
10. CONSTRUCT ROADS (STONE BASE, CURB & GUTTER, AND SIDEWALK). REMOVE DRIVE-OVER VELOCITY CHECKS WHEN BASE COURSE IS PLACED
11. RESTORE TERRACES
12. REMOVE TRACKING PAD, SILT FENCE AND DIVERSION BERM MEASURES AFTER DISTURBED AREAS ARE RESTORED

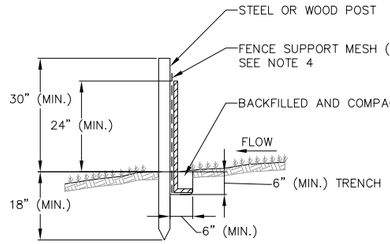

NOTES:

1. INSTALL SILT FENCE TO FOLLOW THE GROUND CONTOURS AS CLOSELY AS POSSIBLE.
2. CURVE THE SILT FENCE UP THE SLOPE TO PREVENT WATER FROM RUNNING AROUND THE ENDS.
3. POST SPACING WITH FENCE SUPPORT MESH = 10 FT. (MAX.)

   POST SPACING WITHOUT FENCE SUPPORT MESH = 6 FT. (MAX.)
4. SILT FENCE SUPPORT MESH CONSISTS OF 14-GAUGE STEEL WIRE WITH A MESH SPACING OF 6 IN. X 6 IN. OR PREFABRICATED POLYMERIC MESH OF EQUIVALENT STRENGTH

1/1 SILT FENCE
NOT TO SCALE

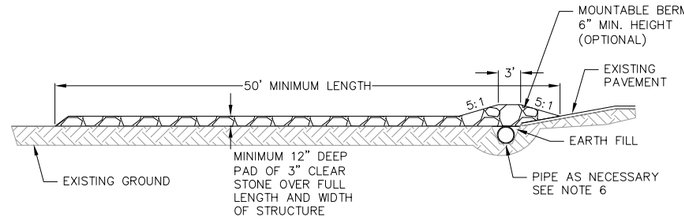

PROFILE VIEW

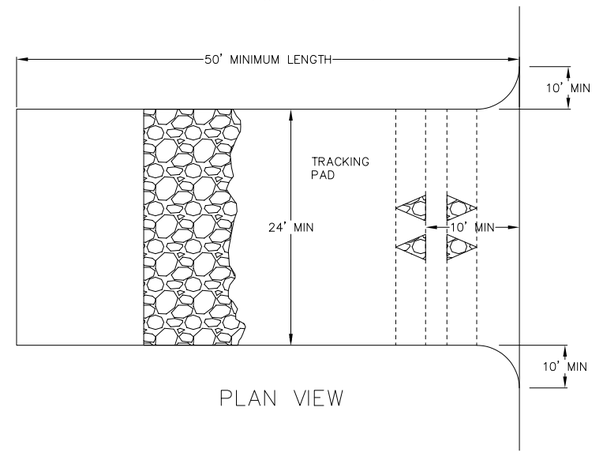

PLAN VIEW

1. FOLLOW WISCONSIN DNR TECHNICAL STANDARD 1057 FOR FURTHER DETAILS AND INSTALLATION.
2. LENGTH – MINIMUM OF 50'
3. WIDTH – 24' MINIMUM, SHOULD BE FLARED AT THE EXISTING ROAD TO PROVIDE A TURNING RADIUS.
4. ON SITES WITH A HIGH GROUND WATER TABLE OR WHERE SATURATED CONDITIONS EXIST, GEOTEXTILE FABRIC SHALL BE PLACED OVER EXISTING GROUND PRIOR TO PLACING STONE. FABRIC SHALL BE WISDOT TYPE-HR GEOTEXTILE FABRIC.
5. STONE – CRUSHED 3" CLEAR STONE SHALL BE PLACED AT LEAST 12" DEEP OVER THE ENTIRE LENGTH AND WIDTH OF ENTRANCE.
6. SURFACE WATER – ALL SURFACE WATER FLOWING TO OR DIVERTED TOWARDS CONSTRUCTION ENTRANCES SHALL BE PIPED THROUGH THE ENTRANCE. MAINTAINING POSITIVE DRAINAGE. PIPE INSTALLED THROUGH THE STABILIZED CONSTRUCTION ENTRANCE SHALL BE PROTECTED WITH A MOUNTABLE BERM WITH 5:1 SLOPES AND MINIMUM OF 6" STONE OVER THE PIPE. PIPE SHALL BE SIZED ACCORDING TO THE DRAINAGE REQUIREMENTS. WHEN THE ENTRANCE IS LOCATED AT A HIGH SPOT AND HAS NO DRAINAGE TO CONVEY A PIPE SHALL NOT BE NECESSARY. THE MINIMUM PIPE DIAMETER SHALL BE 6". CONTRACTOR SHALL BE RESPONSIBLE FOR THE MAINTENANCE OF SAID PIPE.
7. LOCATION – A STABILIZED CONSTRUCTION ENTRANCE SHALL BE LOCATED WHERE CONSTRUCTION TRAFFIC ENTERS AND/OR LEAVES THE CONSTRUCTION SITE. VEHICLES LEAVING THE SITE MUST TRAVEL OVER THE ENTIRE LENGTH OF THE TRACKING PAD.

1/1 TRACKING PAD
NOT TO SCALE

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

CONSTRUCTION DETAILS
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C7

© Vierbicher Associates, Inc.

INLET PROTECTION DEVICES SHALL BE MAINTAINED OR REPLACED AT THE DIRECTION OF THE ENGINEER.

WHEN REMOVING OR MAINTAINING INLET PROTECTION, ANY TRAPPED MATERIAL THAT FALLS INTO THE INLET SHALL BE IMMEDIATELY REMOVED BY THE CONTRACTOR.

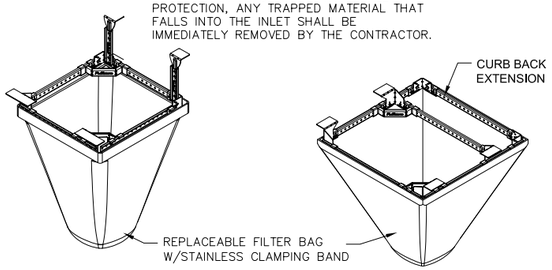

FLEXSTORM CATCH-IT INLET FITLERS FOR ROLLED CURB

FLEXSTORM CATCH-IT INLET FITLERS FOR CURB BOX OPENINGS (MAGNETIC CURB FLAP)

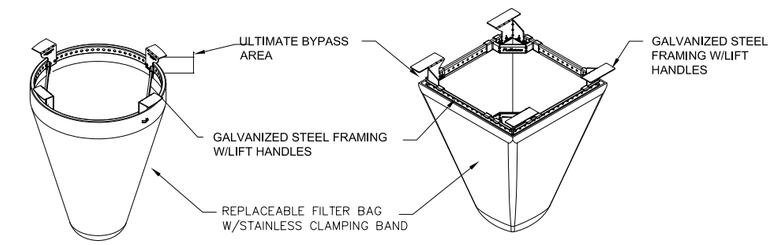

FLEXSTORM CATCH-IT INLET FILTERS FOR ROUND OPENINGS

FLEXSTORM CATCH-IT INLET FITLERS FOR SQUARE/RECTANGULAR OPENINGS

NEENAH CASTING	INLET TYPE	GRATE SIZE	OPENING SIZE	ADS P/N
1040/1642/1733	ROUND	26	24	62MRDFX
3067 W/FLAP	CURB BOX	35.25 X 17.75	33.0 X 15.0	62LCBEXTFX
3067 EXTENDED BACK	CURB BOX	35.25 X 17.75	33.0 X 15.0	62LCBEXTFX
3246A	CURB BOX	35.75 X 23.875	33.5 X 21.0	62LCBFX
3030	SQUARE/RECT	23 X 16	20.5 X 13.5	62MCBFX
3067-C	SQUARE/RECT	35.25 X 17.75	33 X 15	62LSQFX

1/11 FRAMED INLET PROTECTION
NOT TO SCALE

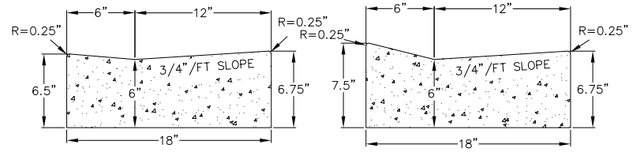

HANDICAP RAMP GUTTER CROSS SECTION

DRIVEWAY GUTTER CROSS SECTION

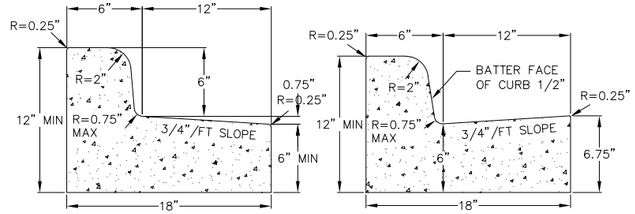

CURB AND GUTTER REJECT SECTION

CURB AND GUTTER CROSS SECTION

1/1 18" CONCRETE CURB AND GUTTER
NOT TO SCALE

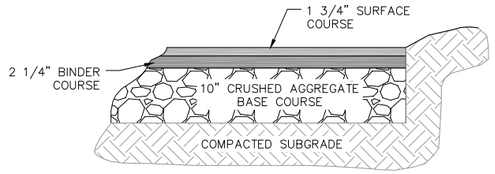

BITUMINOUS PAVEMENT DRIVES

1/1 ASPHALT PAVEMENT
NOT TO SCALE

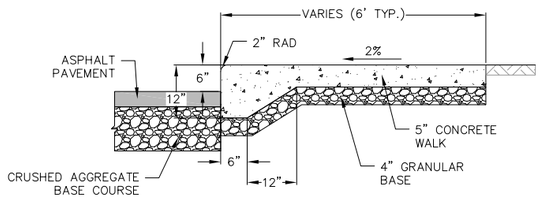

1/1 CURBED SIDEWALK SITE DETAIL
NOT TO SCALE

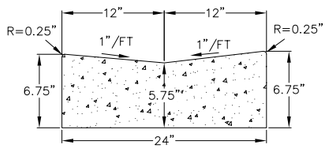

24" VALLEY GUTTER CROSS SECTION

1/1 24" VALLEY GUTTER
NOT TO SCALE

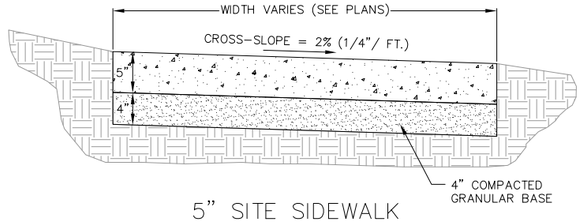

5" SITE SIDEWALK

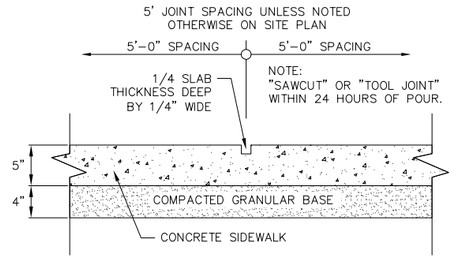

SIDEWALK CONTROL JOINT

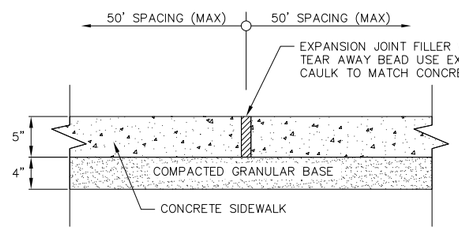

SIDEWALK EXPANSION JOINT

1/1 5" SIDEWALK
NOT TO SCALE

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

CONSTRUCTION DETAILS
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C8

24 Oct 2023 - 3:06p M:\Inventure Capital\230003_Hartung\CADD\230003 - Title and Details.dwg by: bhan

© Vierbicher Associates, Inc.

NOTE:
SIGN TO BE CENTERED AT THE INTERIOR END OF PARKING SPACE

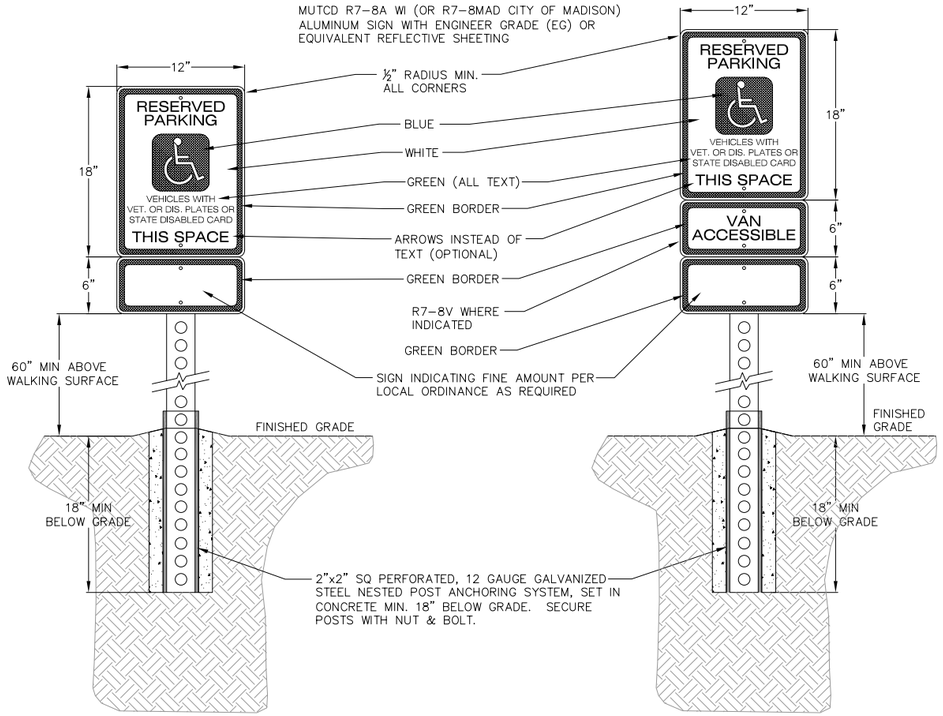

1/1 HANDICAP SIGN DETAIL
NOT TO SCALE

SPECIFIER CHART			
MODEL	INLET ID	GRATE OD	COMMENTS
FF-12D	12" X 12"	15" X 15"	GRATED INLET
FF-16D	16" X 16"	18" X 18"	GRATED INLET
FF-18D	18" X 18"	20" X 20"	GRATED INLET
FF-1836SD	18" X 36"	18" X 40"	GRATED INLET
FF-1836DGO	18" X 36"	18" X 40"	COMBINATION INLET
FF-24D	24" X 24"	26" X 26"	GRATED INLET
FF-2436SD	24" X 36"	24" X 40"	GRATED INLET
FF-24DGO	24" X 24"	18" X 26"	COMBINATION INLET
FF-2436DGO	24" X 36"	24" X 40"	COMBINATION INLET
FF-36D (2 PIECE)	36" X 36"	36" X 40"	GRATED INLET
FF-3648D (2 PIECE)	36" X 48"	40" X 48"	GRATED INLET

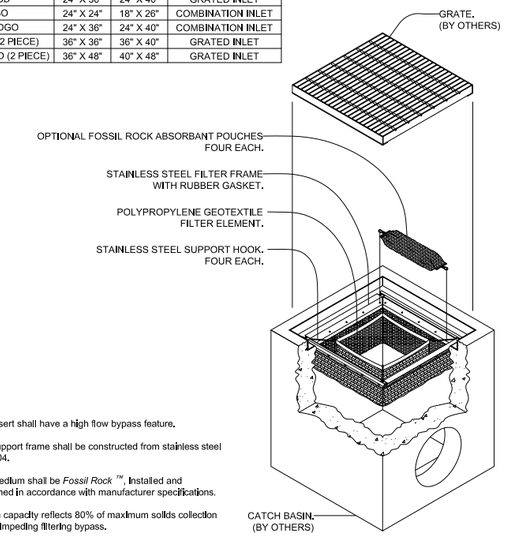

NOTES:
1. Filter insert shall have a high flow bypass feature.
2. Filter support frame shall be constructed from stainless steel Type 304.
3. Filter medium shall be *Fossil Rock* ™, installed and maintained in accordance with manufacturer specifications.
4. Storage capacity reflects 80% of maximum solids collection prior to impeding filtering bypass.

FloGard®
Catch Basin Insert Filter
Grated Inlet Style

Oldcastle® Stormwater Solutions
7501 Southpark Plaza, Suite 200 | Littleton, CO | 80120 | Ph: 800.579.8619 | oldcastlestormwater.com
THIS DRAWING IS THE PROPERTY OF OLDCASTLE PRECAST, INC. AND SHALL NOT BE REPRODUCED, COPIED OR USED AS THE BASIS FOR THE MANUFACTURE OR SALE OF APPARATUS WITHOUT PERMISSION. COPYRIGHT © OLDCASTLE PRECAST, INC. ALL RIGHTS RESERVED.

DRAWING NO.	REV.	ECO	DATE	SHEET
FG-0001	E	ECO-0142 JPR 7/13/16	JPR 12/18/06	SHEET 1 OF 2

1/1 OIL & GREASE INLET FILTER
NOT TO SCALE

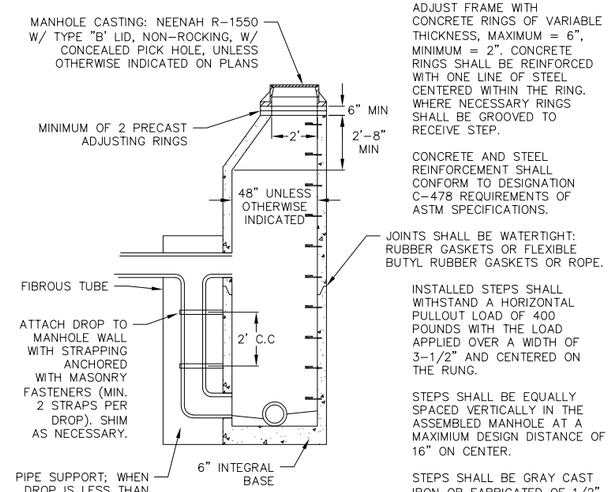

NOTE: FLOW OF DROP TO BE SET AT THE SAME ELEV. AS SPRING LINE OF MAIN.

ADJUST FRAME WITH CONCRETE RINGS OF VARIABLE THICKNESS, MAXIMUM = 6", MINIMUM = 2". CONCRETE RINGS SHALL BE REINFORCED WITH ONE LINE OF STEEL CENTERED WITHIN THE RING. WHERE NECESSARY RINGS SHALL BE GROOVED TO RECEIVE STEP.

CONCRETE AND STEEL REINFORCEMENT SHALL CONFORM TO DESIGNATION C-478 REQUIREMENTS OF ASTM SPECIFICATIONS.

JOINTS SHALL BE WATERTIGHT: RUBBER GASKETS OR FLEXIBLE BUTYL RUBBER GASKETS OR ROPE.

INSTALLED STEPS SHALL WITHSTAND A HORIZONTAL PULLOUT LOAD OF 400 POUNDS WITH THE LOAD APPLIED OVER A WIDTH OF 3-1/2" AND CENTERED ON THE RUNG.

STEPS SHALL BE EQUALLY SPACED VERTICALLY IN THE ASSEMBLED MANHOLE AT A MAXIMUM DESIGN DISTANCE OF 16" ON CENTER.

STEPS SHALL BE GRAY CAST IRON OR FABRICATED OF 1/2" DIA. GRADE 60 STEEL REINFORCING ROD WITH MOLDED PLASTIC COVERING.

PROVIDED FLEXIBLE WATERTIGHT PIPE-TO-MANHOLE SEAL FOR ALL FLEXIBLE SEWER CONNECTIONS. FILL SPACE BETWEEN PIPE AND MANHOLE BARREL WITH GROUT.

1/1 OUTSIDE DROP MANHOLE
NOT TO SCALE

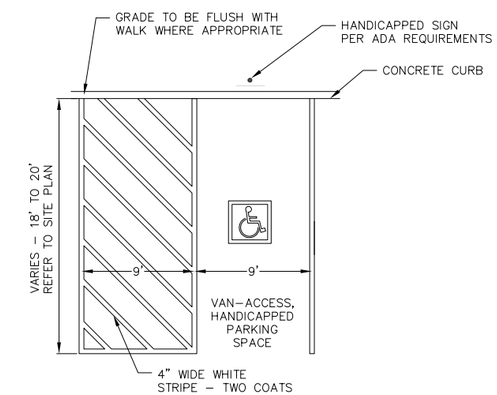

1/1 HANDICAP STRIPING
NOT TO SCALE

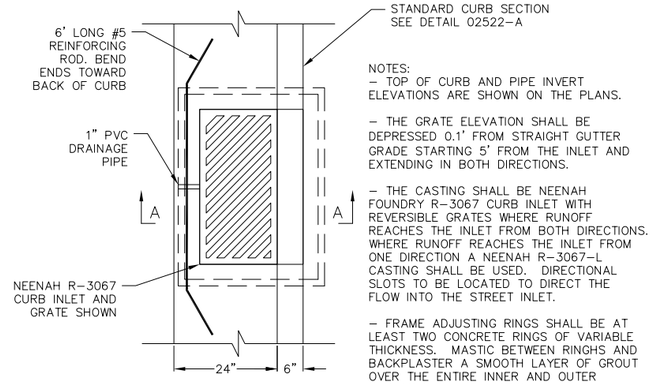

NOTES:
- TOP OF CURB AND PIPE INVERT ELEVATIONS ARE SHOWN ON THE PLANS.
- THE GRATE ELEVATION SHALL BE DEPRESSED 0.1' FROM STRAIGHT GUTTER GRADE STARTING 5' FROM THE INLET AND EXTENDING IN BOTH DIRECTIONS.
- THE CASTING SHALL BE NEENAH FOUNDRY R-3067 CURB INLET WITH REVERSIBLE GRATES WHERE RUNOFF REACHES THE INLET FROM BOTH DIRECTIONS. WHERE RUNOFF REACHES THE INLET FROM ONE DIRECTION A NEENAH R-3067-L CASTING SHALL BE USED. DIRECTIONAL SLOTS TO BE LOCATED TO DIRECT THE FLOW INTO THE STREET INLET.
- FRAME ADJUSTING RINGS SHALL BE AT LEAST TWO CONCRETE RINGS OF VARIABLE THICKNESS. MASTIC BETWEEN RINGHS AND BACKPLASTER A SMOOTH LAYER OF GROUT OVER THE ENTIRE INNER AND OUTER SURFACES OF THE RINGS.

PLAN VIEW

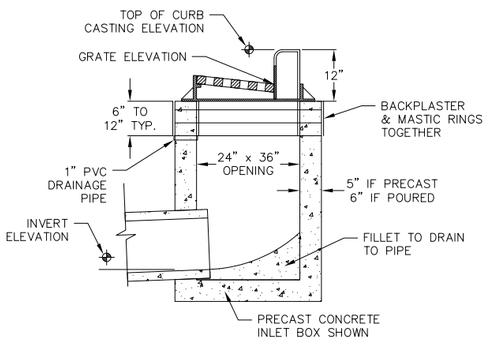

SECTION A-A

1/1 RECTANGULAR STREET INLET
NOT TO SCALE

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

CONSTRUCTION DETAILS
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C9

24 Oct 2023 - 3:07p M:\Inventure Capital\230003_Hartung\CADD\230003 - Title and Details.dwg by: bhan

© Vierbicher Associates, Inc.

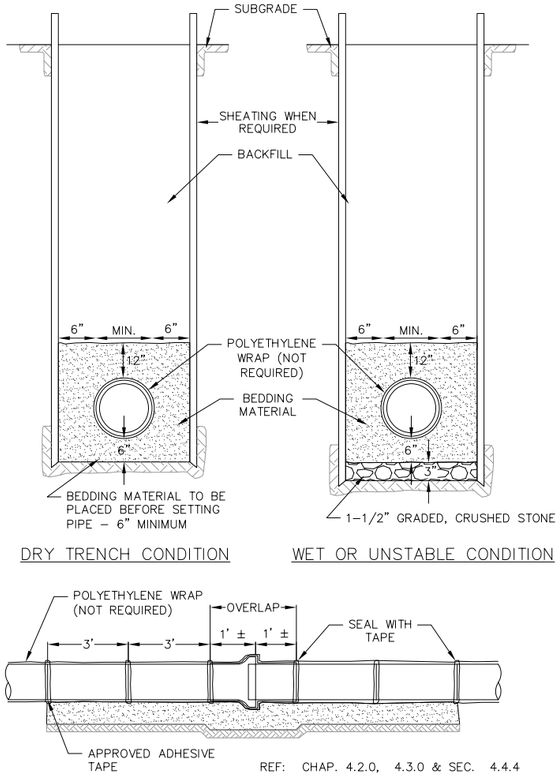

REF: CHAP. 4.2.0, 4.3.0 & SEC. 4.4.4

1/1 STANDARD WATER MAIN TRENCH SECTION
NOT TO SCALE

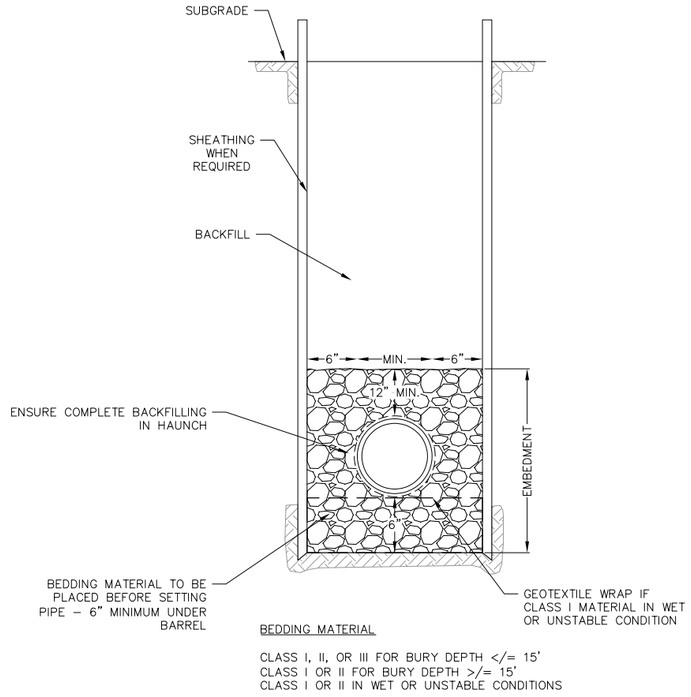

1/1 STANDARD SANITARY TRENCH SECTION
NOT TO SCALE

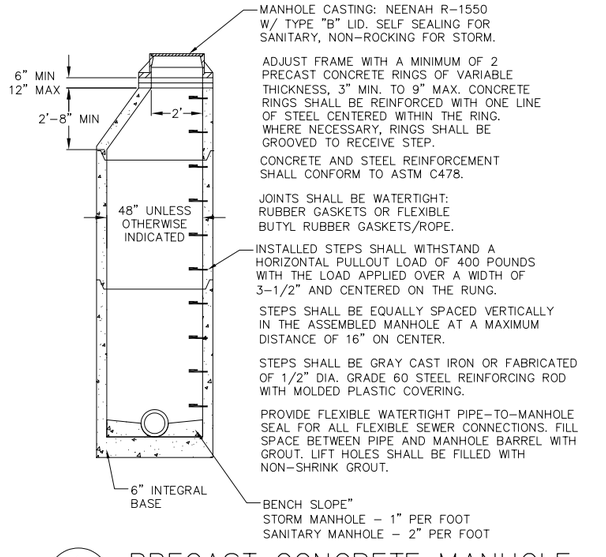

1/1 PRECAST CONCRETE MANHOLE
NOT TO SCALE

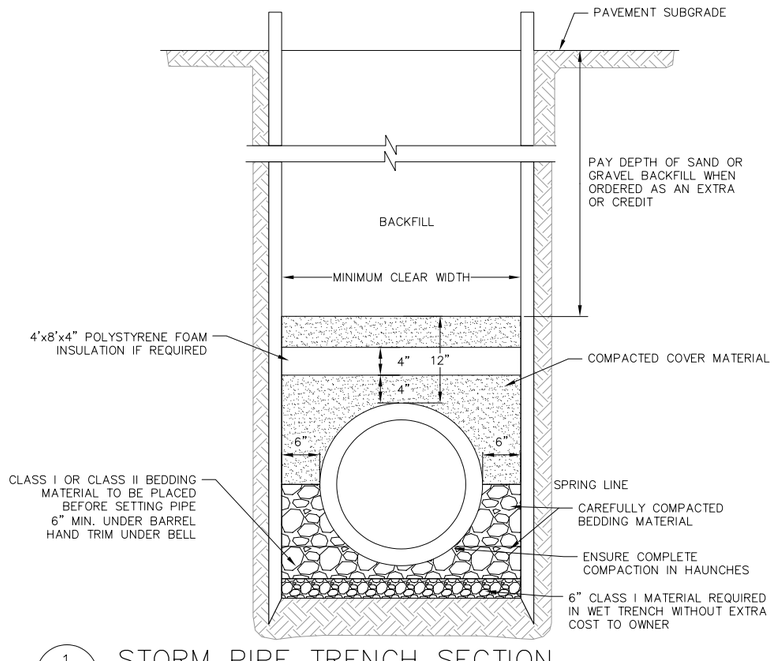

1/1 STORM PIPE TRENCH SECTION
NOT TO SCALE

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

CONSTRUCTION DETAILS
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS
NO. DATE REMARKS

REVISIONS
NO. DATE REMARKS

DATE 10/24/2023
DRAFTER BHAN
CHECKED TSCH
PROJECT NO. 230003

C10

24 Oct 2023 - 3:07p M:\Inventure Capital\230003_Hartung\CADD\230003 - Title and Details.dwg by: bhan

© Vierbicher Associates, Inc.

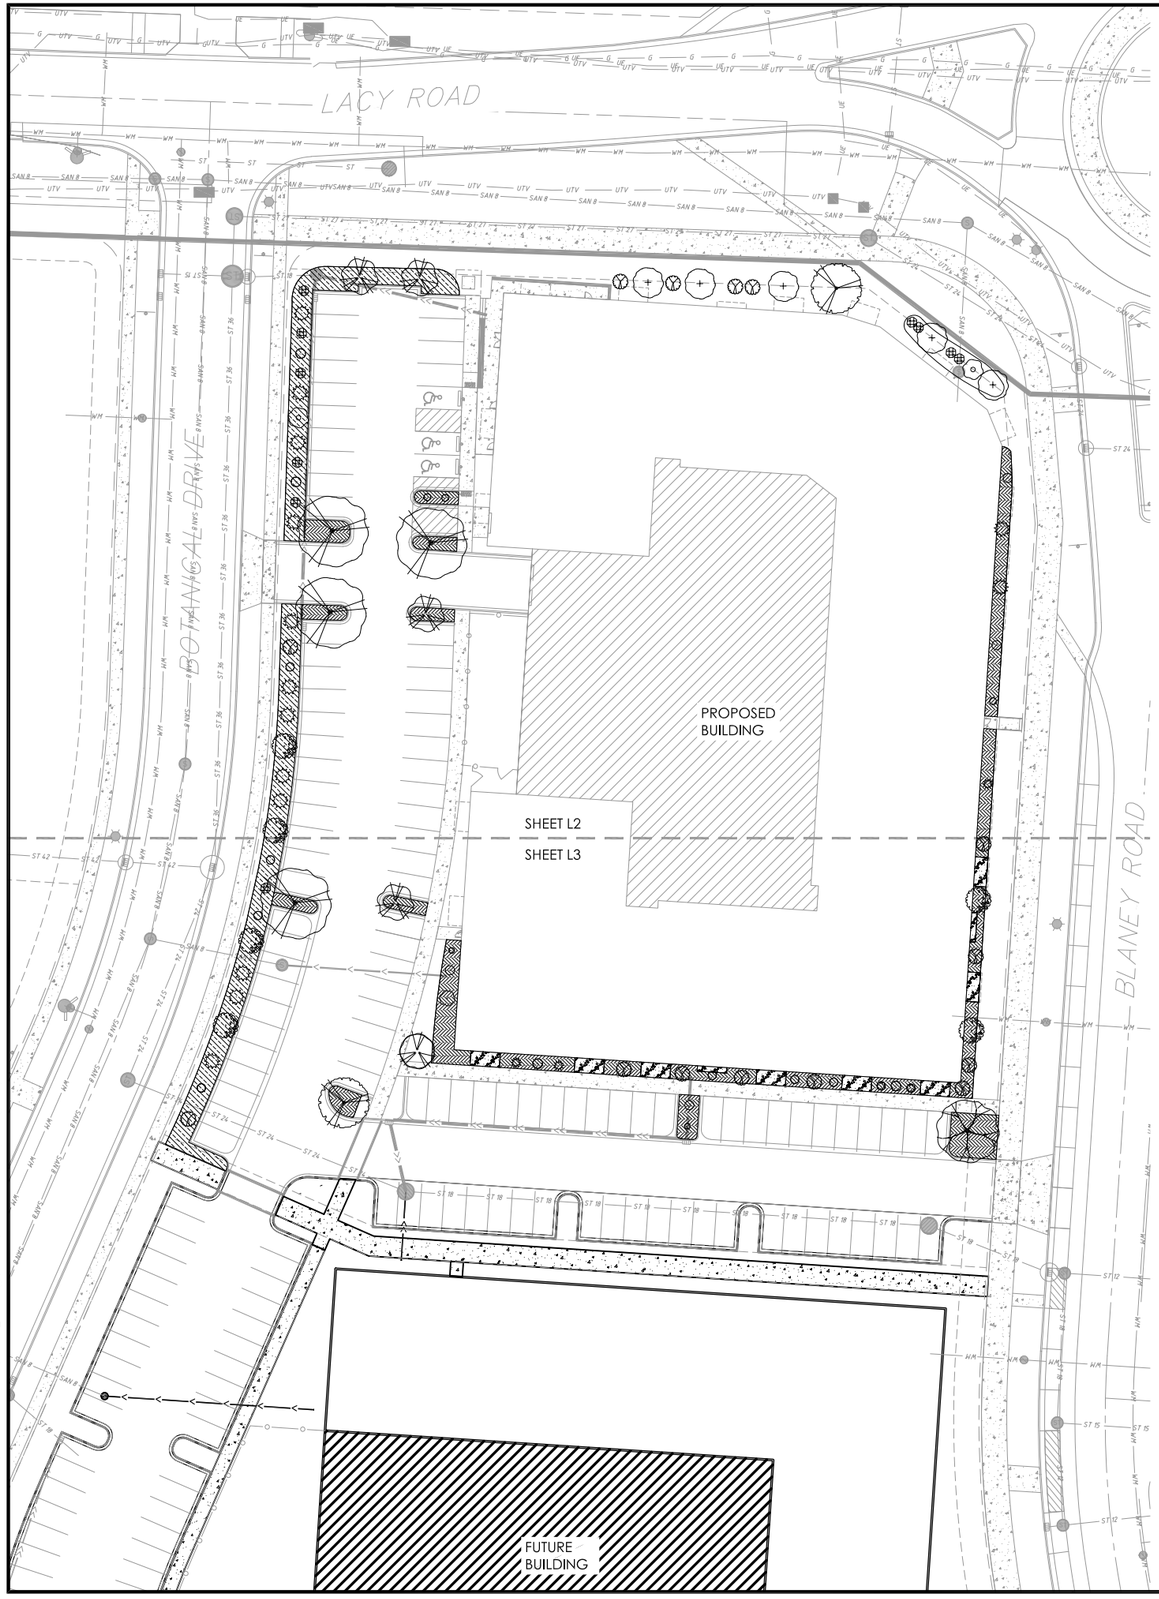

PLANT SCHEDULE

DECIDUOUS TREES	BOTANICAL / COMMON NAME	ROOT COND.	SIZE	NOTES	QTY
Co2	Celtis occidentalis / Common Hackberry	B & B	1.5"Cal		1
Qm	Quercus macrocarpa / Burr Oak	B & B	1.5"Cal		4
UNDERSTORY TREES	**BOTANICAL / COMMON NAME**	**ROOT COND.**	**SIZE**	**NOTES**	**QTY**
Aa	Amelanchier arborea / Downy Serviceberry	B & B	5` ht.	Multi-Stem	4
Cc	Carpinus caroliniana / American Hornbeam	B & B	5` ht.		2
Ci	Crataegus crus-galli inermis / Thornless Cockspur Hawthorn	B & B	1.5"Cal		1
Hv	Hamamelis virginiana / Common Witch Hazel	Cont.	5 Gal.		5
DECIDUOUS SHRUBS	**BOTANICAL / COMMON NAME**	**ROOT COND.**	**SIZE**	**NOTES**	**QTY**
As2	Amelanchier stolonifera / Running Serviceberry	Cont.	2 Gal.		7
Ac2	Amorpha canescens / Leadplant	Cont.	1 Gal.		2
Am	Aronia melanocarpa / Black Chokeberry	Cont.	5 Gal.		4
Ca2	Ceanothus americanus / New Jersey Tea	Cont.	3 Gal.		2
Co3	Cephalanthus occidentalis / Buttonbush	Cont.	5 Gal.		10
Cr2	Cornus racemosa / Gray Dogwood	Cont.	5 Gal.		4
Ca4	Corylus americana / American Hazelnut	Cont.	5 Gal.		2
Ld	Lonicera diervilla / Honeysuckle	Cont.	3 Gal.		3
Po	Physocarpus opulifolius / Ninebark	Cont.	5 Gal.		3
Sc	Sambucus canadensis / American Elderberry	Cont.	5 Gal.		14
Vc	Viburnum cassinoides / Witherod Viburnum	Cont.	5 Gal.		1
Vp	Viburnum prunifolium / Blackhaw Viburnum	B & B	4` ht.		6
EVERGREEN SHRUBS	**BOTANICAL / COMMON NAME**	**ROOT COND.**	**SIZE**	**NOTES**	**QTY**
Jc2	Juniperus communis depressa / Common Juniper	Container	5 Gal.		14

GRAPHIC SCALE FEET

0 15 30 60

CONCEPT PLANT SCHEDULE

GROUNDCOVER #1	3,172 sf
Andropogon gerardii / Big Bluestem	330
Carex bicknellii / Prairie Sedge	132
Coreopsis tripteris / Tall Coreopsis	330
Liatris aspera / Rough Blazing Star	66
Liatris pycnostachya / Gayfeather	330
Lilium michiganense / Michigan Lily	66
Monarda punctata / Spotted Horsemint	99
Panicum virgatum / Switch Grass	825
Schizachyrium scoparium / Little Bluestem	462
Silphium terebinthinaceum / Prairie Dock	66
Sorghastrum nutans / Indian Grass	396
Vernonia fasciculata / Ironweed	99
Veronicastrum virginicum / Culver's Root	99

GROUNDCOVER #2	3,485 sf
Allium cernuum / Nodding Onion	109
Anemone canadensis / Canadian Anemone	109
Asclepias tuberosa / Butterfly Milkweed	182
Carex bicknellii / Prairie Sedge	435
Coreopsis palmata / Stiff Tickseed	182
Dalea purpurea / Purple Prairie Clover	182
Echinacea pallida / Pale Purple Coneflower	182
Koeleria macrantha / Prairie Junegrass	254
Liatris aspera / Rough Blazing Star	218
Monarda punctata / Spotted Horsemint	109
Rudbeckia hirta / Black-eyed Susan	109
Schizachyrium scoparium / Little Bluestem	652
Sporobolus heterolepis / Prairie Dropseed	906

3/4" WASHED STONE	573 sf
-	

PLANT MATERIAL NOTES:

1. ALL PLANTINGS SHALL CONFORM TO QUALITY REQUIREMENTS AS PER ANSI Z60.1.
2. ALL PLANT MATERIAL SHALL BE TRUE TO SPECIES, VARIETY AND SIZE SPECIFIED, NURSERY GROWN IN ACCORDANCE WITH GOOD HORTICULTURAL PRACTICES, AND UNDER CLIMATIC CONDITIONS SIMILAR TO THOSE OF THE PROJECT SITE.
3. CONTACT LANDSCAPE ARCHITECT, IN WRITING, TO REQUEST ANY PLANT MATERIAL SUBSTITUTIONS DUE TO AVAILABILITY ISSUES.
4. ALL PLANTS SHALL BE GUARANTEED TO BE IN HEALTHY AND FLOURISHING CONDITION DURING THE GROWING SEASON FOLLOWING INSTALLATION. ALL PLANT MATERIAL SHALL BE GUARANTEED FOR ONE YEAR FROM THE TIME OF INSTALLATION.
5. EXACT LOCATIONS OF EACH PLANT ARE GIVEN IN PLAN. WHILE SLIGHT DEVIATIONS ARE ACCEPTABLE, OVERALL SCHEMATIC/ORIENTATION TO BE ADHERED TO AS ACCURATELY AS POSSIBLE.

LANDSCAPE MATERIAL NOTES:

1. CONTRACTOR SHALL PROVIDE A SUITABLE AMENDED TOPSOIL BLEND FOR ALL PLANTING AREAS WHERE SOIL CONDITIONS ARE UNSUITABLE FOR PLANT GROWTH. TOPSOIL SHALL CONFORM TO QUALITY REQUIREMENTS AS PER SECTION 625.2(1) OF THE "STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION." PROVIDE A MINIMUM OF 18" OF TOPSOIL IN ALL PLANTING AREAS AND 6" OF TOPSOIL IN AREAS TO BE SEEDED/SODDED.
2. SUBSOIL UNDER TURF AND PLANTING BEDS MUST BE FREE DRAINING AND LOOSE TO ALLOW ROOT PENETRATION AND DRAINAGE. LANDSCAPE CONTRACTOR SHOULD NOTIFY GENERAL CONTRACTOR IF SUBSURFACE COMPACTION IS UNFIT FOR PLANTING. LANDSCAPE CONTRACTOR IS NOT RESPONSIBLE FOR SUBSURFACE SOIL PREPARATION.
3. LANDSCAPE BEDS TO BE MULCHED WITH WHITE CEDAR MULCH TO 3" DEPTH MIN.
4. WASHED STONE AREAS ARE TO BE INSTALLED USING 1"–2". WASHED STONE TO A DEPTH OF 3" MINIMUM. LAY COMMERCIAL GRADE LANDSCAPE FABRIC BETWEEN GRADE AND STONE.
5. LANDSCAPE BEDS, STONE AREAS AND SEEDED AREAS ARE SEPARATED WITH COMMERCIAL GRADE ALUMINUM LANDSCAPE EDGING, PERMALOC CLEANLINE $\frac{3}{16}$"X4" OR EQUAL, COLOR BLACK ANODIZED.
6. ALL TREES AND/OR SHRUBS PLANTED IN SEEDED AREAS TO BE INSTALLED WITH A 6' DIAMETER MULCH RING AND SHOVEL CUT EDGE. A SLOW RELEASE FERTILIZER AND MYCORRHIZAL INOCULATE SHOULD BE APPLIED TOPICALLY AT TIME OF PLANTING PRIOR TO MULCH APPLICATION. APPLICATION RATES TO REFLECT MANUFACTURER SPECIFICATIONS.

SEEDING AND PLUG PLANTING NOTES:

1. ALL UNLABELED DISTURBED AREAS, AND AREAS SHOWN AS TURF GRASS TO BE SEEDED WITH 'MADISON PARKS' SEED MIX BY LA CROSSE SEED OR EQUIVALENT. ALL SEEDED AREAS ARE TO BE WATERED DAILY TO MAINTAIN ADEQUATE SOIL MOISTURE FOR PROPER GERMINATION. AFTER VIGOROUS GROWTH IS ESTABLISHED, APPLY $\frac{1}{2}$" WATER TWICE WEEKLY UNTIL FINAL ACCEPTANCE. (PRIOR TO ROUTINE MAINTENANCE SCHEDULE ESTABLISHMENT, MOWING SHOULD OCCUR TO MAINTAIN A TURF HEIGHT OF 3"–6".) PRIOR TO SEEDING APPLY A MINIMUM OF 4" TOPSOIL TO ENTIRE AREA. FOLLOWING SEEDING APPLY A MULCH LAYER OF STRAW OR STRAW MAT..
2. INSTALL GROUNDCOVERS AS 2" X 2" X 4", 2.25" X 2.25" X 5" OR 2.5" x 2.5" x 3.5" PLUGS AS SUPPLIED BY AGRECOL, MIDWEST GROUNDCOVERS, TAYLOR CREEK OR EQUAL. PLUGS TO BE INSTALLED 12" ON CENTER IN A TRIANGULAR GRID PATTERN. AFTER SHRUBS ARE INSTALLED, APPLY A LAYER OF CARDBOARD OR EQUAL BIODEGRADABLE BARRIER AND 2" MULCH MINIMUM PRIOR TO PLANTING PLUGS. SLIGHTLY WET AREA AND INSTALL PLANTS WITH 2 – 2 $\frac{1}{2}$" DRILL BIT. PLANT SPECIES RANDOMLY THROUGHOUT SPECIFIED AREA, MAINTAINING A REPRESENTATIVE RATIO OF SPECIES RESPECTIVELY THROUGHOUT PLANTING. INSTALL MULCH TO A MINIMUM DEPTH OF 3" BETWEEN PLANTS.

GENERAL LANDSCAPE NOTES:

1. CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS FOR ANY RIGHT OF WAY WORK.
2. CONTRACTOR SHALL VERIFY ALL UTILITIES WITHIN SCOPE OF CONTRACT.
3. CONTRACTOR SHALL COORDINATE ALL WORK WITH OTHER CONTRACTORS AT SITE AND COMPLETE WORK PER SCHEDULE.
4. CONTRACTOR SHALL CLEAN ALL PAVEMENT AREAS WITHIN SITE AFTER COMPLETION. CONTRACTOR SHALL CLEAN ANY AFFECTED PAVED AREAS OUTSIDE OF DISTURBANCE DELINEATION DAILY.

NOT FOR CONSTRUCTION

vierbicher planners engineers advisors

Building A Landscape Plan

HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER EGOR
CHECKED JLIL
PROJECT NO. 230003

L1

24 Oct 2023 - 3:56p M:\Inventure Capital\230003_Hartung\CADD\230003 - Landscape.dwg by: bhan

© Vierbicher Associates, Inc.

LACY ROAD

BOTANICAL DRIVE

N
W E
S

GRAPHIC SCALE FEET
0 8 16 32

(1) Co3
(1) Jc2
(1) Co3
(1) Cr2
(1) Co3
(1) Jc2
(1) Ca4
(1) Jc2
(1) Co3
(1) Cr2
(1) Co3
(1) Jc2
(2) Aa
(1) Hv
(1) Hv
(4) Sc
(1) Hv
(1) Cc
(2) Co3
(2) Co3
(1) Ca4
(2) Hv
(1) Am
(1) Jc2
(1) Jc2
(1) Am
(1) Ld
(1) Po
(1) Sc
(2) Ld
(3) Qm
(1) Aa
(1) Jc2
(1) Sc
(1) As2
(2) Jc2
(1) Vp
(2) Jc2
(1) Vp
(1) As2

PROPOSED BUILDING

SHEET L2

SHEET L3

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

Building A Landscape Plan North

HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS			
NO.	DATE	REMARKS	

REVISIONS			
NO.	DATE	REMARKS	

DATE 10/24/2023
DRAFTER EGOR
CHECKED JLIL
PROJECT NO. 230003

L2

24 Oct 2023 - 3:56p M:\Inventure Capital\230003_Hartung\CADD\230003 - Landscape.dwg by: bhan

© Vierbicher Associates, Inc.

SHEET L2

SHEET L3

(1) Vp
(1) As2
(1) Co3
(1) Qm
(1) As2
(1) Aa
(1) Vp
(2) Jc2
(1) Vp
(1) Jc2
(1) As2
(1) Sc
(1) Cc
(1) Ca2
(1) Am
(1) Vc
(1) Ci
(2) Po
(1) Cr2
(1) Sc
(2) Sc
(1) As2
(2) As2
(1) Sc
(1) Cr2
(2) Ac2
(1) Vp
(2) Sc
(1) Sc
(1) Vp
(1) Sc
(1) Am
(1) Ca2
(1) Co2

BLANEY ROAD

GRAPHIC SCALE FEET
0 8 16 32

FUTURE BUILDING

NOT FOR CONSTRUCTION

vierbicher
planners engineers advisors

Building A Landscape Plan South
HARTUNG FIELDS
CITY OF FITCHBURG
DANE COUNTY, WISCONSIN

REVISIONS
NO. DATE REMARKS

REVISIONS
NO. DATE REMARKS

DATE 10/24/2023
DRAFTER EGOR
CHECKED JLIL
PROJECT NO. 230003

L3

24 Oct 2023 - 3:57p M:\Inventure Capital\230003_Hartung\CADD\230003 - Landscape.dwg by: bhan

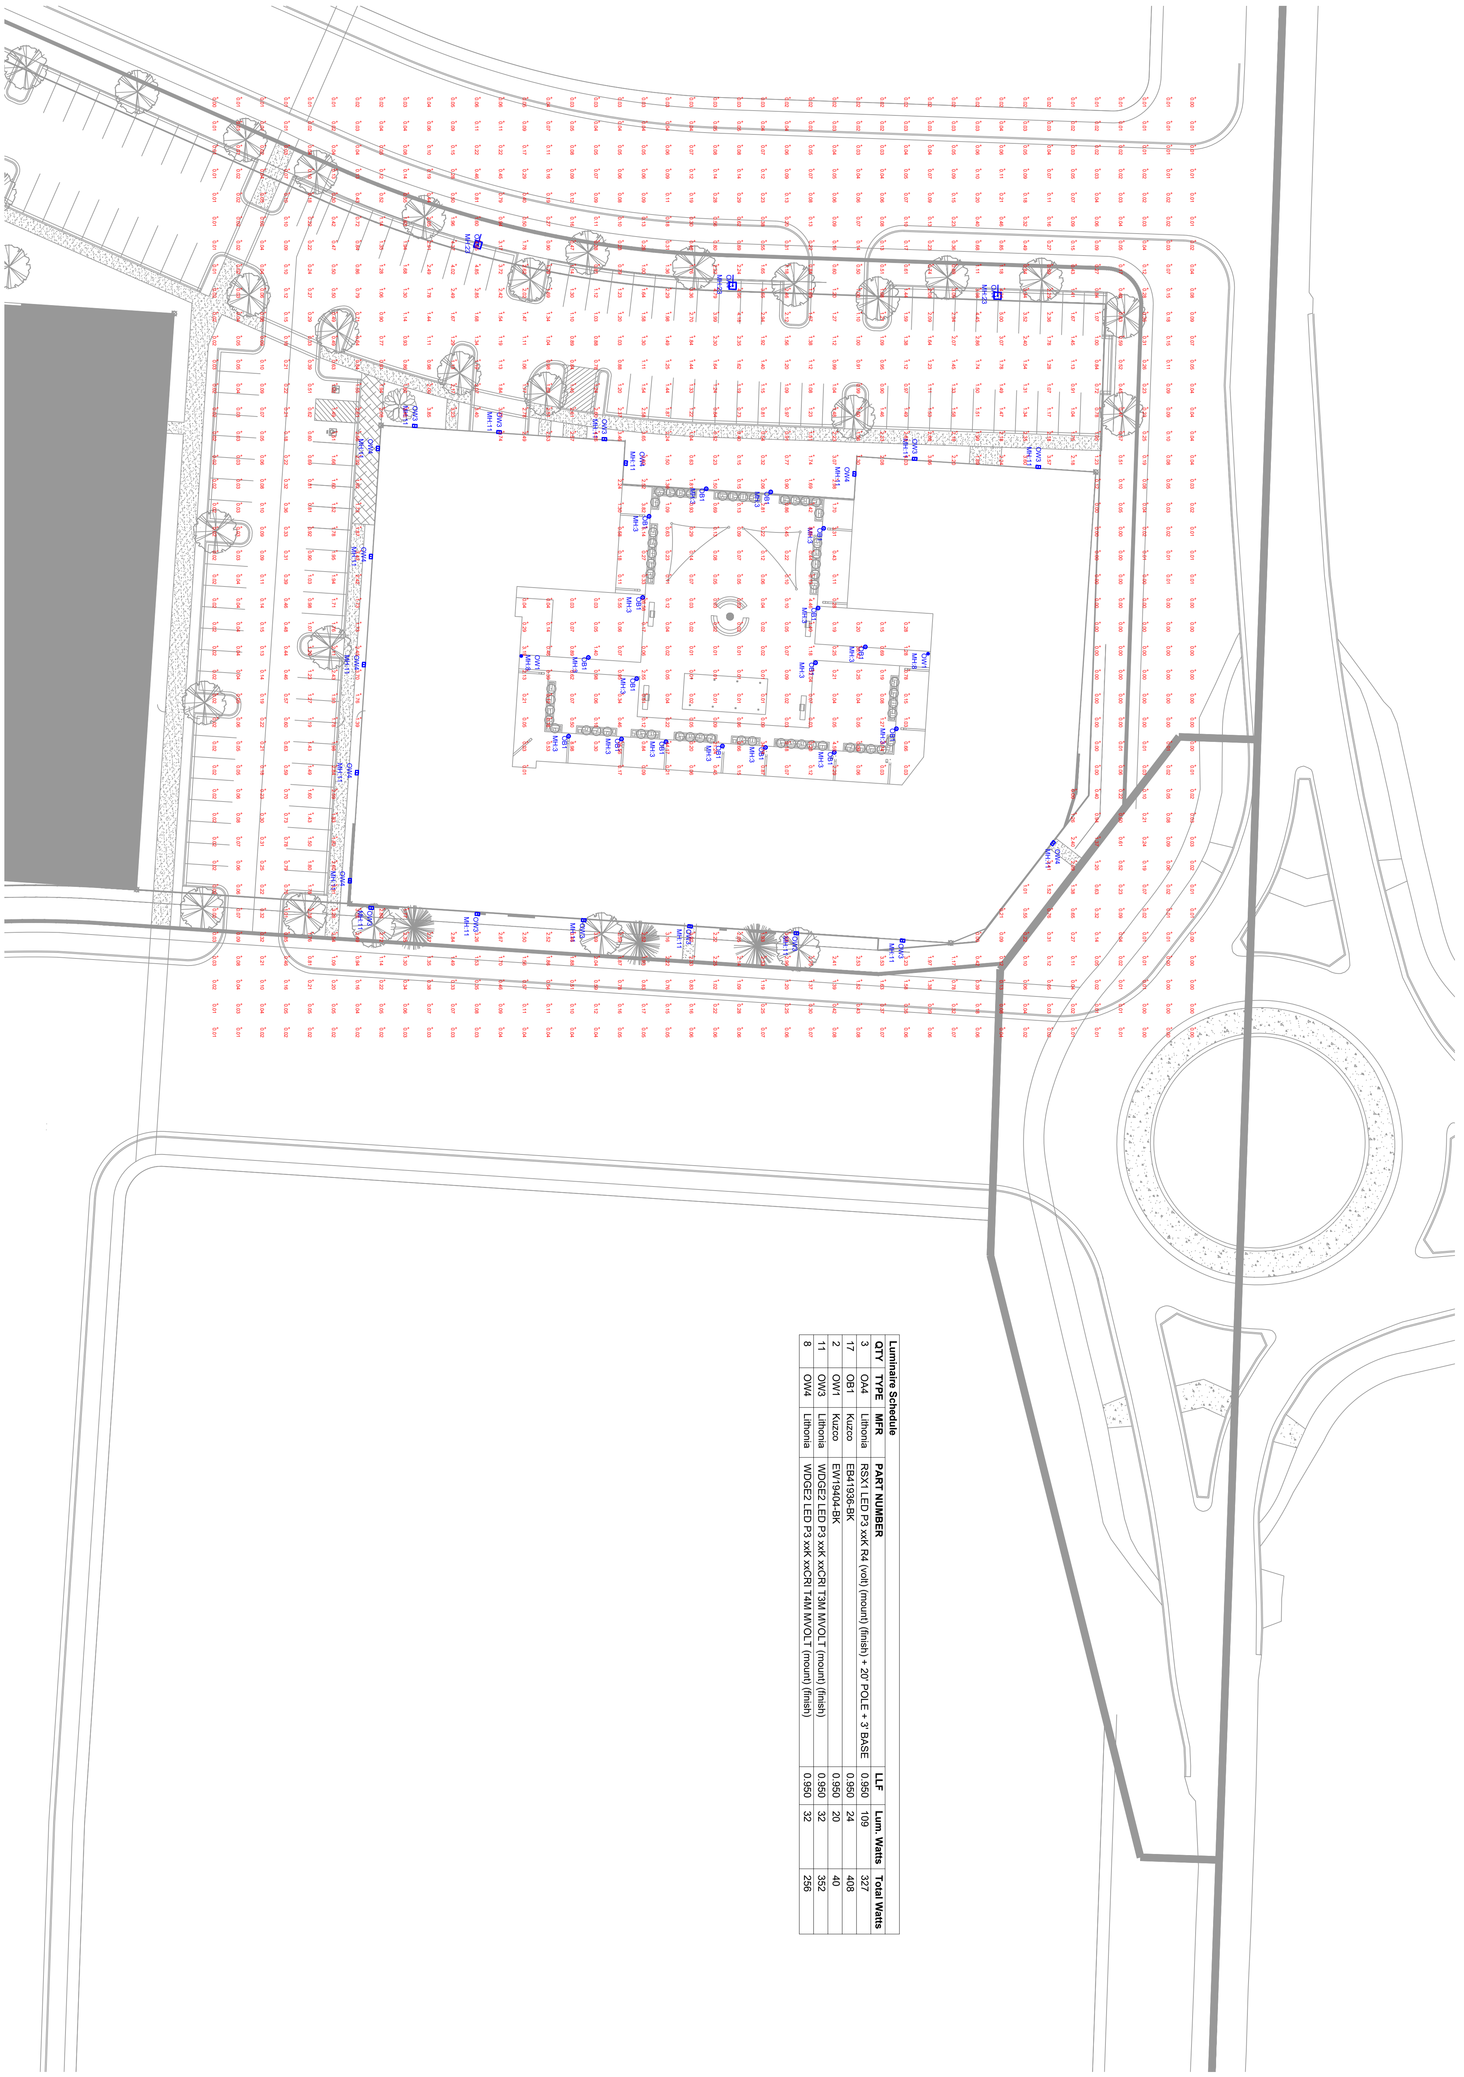

Luminaire Schedule							
QTY	TYPE	MFR	PART NUMBER	LLF	Lum. Watts	Total Watts
3	OA4	Lithonia	RSX1 LED P2 30K R4 (x9) (mount) (finish) + 20' POLE + 3' BASE	0.950	109	327
17	OB1	Lithonia		0.950	24	408
2	OW1	Kuzco	EB41936-BK EW19404-BK	0.950	20	40
11	OW3	Lithonia	WDGE2 LED P3 30K 90CRI T3M MVOLT (mount) (finish)	0.950	32	352
8	OW4	Lithonia	WDGE2 LED P3 30K 90CRI T4M MVOLT (mount) (finish)	0.950	32	256

HARTUNG FIELDS	DRAWN BY : JS	REVISIONS	# DATE COMMENTS
FITCHBURG, WI	DATE : 8 / 22 / 2023		
SITE LIGHTING CALCULATIONS	SCALE : 1" = 30'-0"		

ENTERPRISE
Lighting & Control

WDGE2 LED

Architectural Wall Sconce
Precision Refractive Optic

Catalog Number

Notes

Type OW3 /OW4

Hit the Tab key or mouse over the page to see all interactive elements.

Specifications

Depth (D1): 7"
Depth (D2): 1.5"
Height: 9"
Width: 11.5"
Weight: (without options) 13.5 lbs

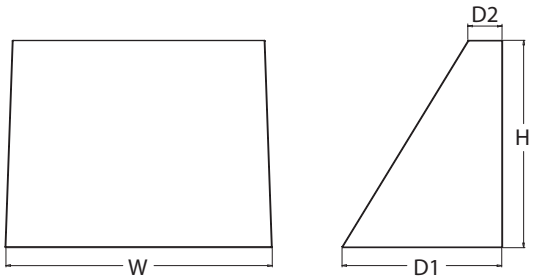

Introduction

The WDGE LED family is designed to meet specifier's every wall-mounted lighting need in a widely accepted shape that blends with any architecture. The clean rectilinear design comes in four sizes with lumen packages ranging from 1,200 to 25,000 lumens, providing a true site-wide solution. Embedded with nLight® AIR wireless controls, the WDGE family provides additional energy savings and code compliance.

WDGE2 with industry leading precision refractive optics provides great uniform distribution and optical control. When combined with multiple integrated emergency battery backup options, including an 18W cold temperature option, the WDGE2 becomes the ideal wall-mounted lighting solution for pedestrian scale applications in any environment.

WDGE LED Family Overview

Luminaire	Optics	Standard EM, 0°C	Cold EM, -20°C	Sensor	Approximate Lumens (4000K, 80CRI)						
					P0	P1	P2	P3	P4	P5	P6
WDGE1 LED	Visual Comfort	4W		--	750	1,200	2,000	--	--	--	--
WDGE2 LED	Visual Comfort	10W	18W	Standalone / nLight	--	1,200	2,000	3,000	4,500	6,000	--
WDGE2 LED	Precision Refractive	10W	18W	Standalone / nLight	700	1,200	2,000	3,200	4,200	--	--
WDGE3 LED	Precision Refractive	15W	18W	Standalone / nLight	--	7,500	8,500	10,000	12,000	--	--
WDGE4 LED	Precision Refractive			Standalone / nLight	--	12,000	16,000	18,000	20,000	22,000	25,000

Ordering Information

EXAMPLE: WDGE2 LED P3 40K 80CRI VF MVOLT SRM DDBXD

Series	Package	Color Temperature	CRI	Distribution	Voltage	Mounting
WDGE2 LED	P0[1]	27K 2700K	70CRI[4]	T1S Type I Short	MVOLT	**Shipped included**
	P1[2]	30K 3000K	80CRI	T2M Type II Medium	347[5]	SRM Surface mounting bracket
	P2[2]	40K 4000K	LW[3] Limited Wavelength	T3M Type III Medium	480[5]	ICW Indirect Canopy/Ceiling Washer bracket (dry/damp locations only)[6]
	P3[2]	50K 5000K		T4M Type IV Medium		**Shipped separately**
	P4[2]	AMB[3] Amber		TFTM Forward Throw Medium		AWS 3/8inch Architectural wall spacer
						PBBW S urface-mounted back box (top, left, right conduit entry). Use when there is no junction box available.

Options

E10WH	Emergency battery backup, Certified in CA Title 20 MAEDBS (10W, 5°C min)
E20WC	Emergency battery backup, Certified in CA Title 20 MAEDBS (18W, -20°C min)
PE[7]	Photocell, Button Type
DMG[8]	0-10V dimming wires pulled outside fixture (for use with an external control, ordered separately)
BCE	Bottom conduit entry for back box (PBBW). Total of 4 entry points.
BAA	Buy America(n) Act Compliant

Standalone Sensors/Controls

PIR	Bi-level (100/35%) motion sensor for 8-15' mounting heights. Intended for use on switched circuits with external dusk to dawn switching.
PIRH	Bi-level (100/35%) motion sensor for 15-30' mounting heights. Intended for use on switched circuits with external dusk to dawn switching
PIR1FC3V	Bi-level (100/35%) motion sensor for 8-15' mounting heights with photocell pre-programmed for dusk to dawn operation.
PIRH1FC3V	Bi-level (100/35%) motion sensor for 15-30' mounting heights with photocell pre-programmed for dusk to dawn operation.

Networked Sensors/Controls

NLTAIR2 PIR	nLightAIR Wireless enabled bi-level motion/ambient sensor for 8-15' mounting heights.
NLTAIR2 PIRH	nLightAIR Wireless enabled bi-level motion/ambient sensor for 15-30' mounting heights.

See page 4 for out of box functionality

Finish

DDBXD	Dark bronze
DBLXD	Black
DNAXD	Natural aluminum
DWHXD	White
DSSXD	Sandstone
DDBTXD	Textured dark bronze
DBLBXD	Textured black
DNATXD	Textured natural aluminum
DWHGXD	Textured white
DSSTXD	Textured sandstone

One Lithonia Way • Conyers, Georgia 30012 • Phone: 1-800-705-SERV (7378) • www.lithonia.com
© 2019-2022 Acuity Brands Lighting, Inc. All rights reserved.

Accessories

Ordered and shipped separately.

WDGEAWS DDBXD	WDGE 3/8inch Architectural Wall Spacer (specify finish)
WDGE2PBBW DDBXD U	WDGE2 surface-mounted back box (specify finish)

NOTES

1 P0 option not available with sensors/controls.
2 P1-P4 not available with AMB and LW.
3 AMB and LW always go together.
4 70CRI only available with T3M and T4M.
5 347V and 480V not available with E10WH or E20WC.
6 Not qualified for DLC. Not available with emergency battery backup or sensors/controls.
7 PE not available in 480V or with sensors/controls.
8 DMG option not available with sensors/controls.

Performance Data

Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts. Contact factory for performance data on any configurations not shown here.

Performance Package	System Watts	Dist. Type	27K (2700K, 80 CRI)					30K (3000K, 80 CRI)					40K (4000K, 80 CRI)					50K (5000K, 80 CRI)					Amber (Limited Wavelength)				
			Lumens	LPW	B	U	G	Lumens	LPW	B	U	G	Lumens	LPW	B	U	G	Lumens	LPW	B	U	G	Lumens	LPW	B	U	G
P0	7W	T1S	636	92	0	0	0	666	97	0	0	0	699	101	0	0	1	691	100	0	0	1	712	47	0	0	1
		T2M	662	96	0	0	0	693	101	0	0	0	728	106	0	0	0	719	104	0	0	0	741	48	0	0	0
		T3M	662	96	0	0	0	693	101	0	0	0	728	106	0	0	0	719	104	0	0	0	741	48	0	0	0
		T4M	648	94	0	0	0	679	98	0	0	0	712	103	0	0	0	704	102	0	0	0	726	47	0	0	0
		TFTM	652	95	0	0	0	683	99	0	0	0	717	104	0	0	0	708	103	0	0	0	730	48	0	0	1
P1	11W	T1S	1,105	99	0	0	1	1,157	104	0	0	1	1,215	109	0	0	1	1,200	107	0	0	1					
		T2M	1,150	103	0	0	1	1,204	108	0	0	1	1,264	113	0	0	1	1,249	112	0	0	1					
		T3M	1,150	103	0	0	1	1,205	108	0	0	1	1,265	113	0	0	1	1,250	112	0	0	1					
		T4M	1,126	101	0	0	1	1,179	106	0	0	1	1,238	111	0	0	1	1,223	110	0	0	1					
		TFTM	1,133	101	0	0	1	1,186	106	0	0	1	1,245	112	0	0	1	1,230	110	0	0	1					
P2	19W	T1S	1,801	95	1	0	1	1,886	99	1	0	1	1,981	104	1	0	1	1,957	103	1	0	1					
		T2M	1,875	99	1	0	1	1,963	103	1	0	1	2,061	109	1	0	1	2,037	107	1	0	1					
		T3M	1,876	99	1	0	1	1,964	103	1	0	1	2,062	109	1	0	1	2,038	107	1	0	1					
		T4M	1,836	97	1	0	1	1,922	101	1	0	1	2,018	106	1	0	1	1,994	105	1	0	1					
		TFTM	1,847	97	1	0	1	1,934	102	1	0	1	2,030	107	1	0	1	2,006	106	1	0	1					
P3	32W	T1S	2,809	87	1	0	1	2,942	92	1	0	1	3,089	96	1	0	1	3,052	95	1	0	1					
		T2M	2,924	91	1	0	1	3,062	95	1	0	1	3,215	100	1	0	1	3,176	99	1	0	1					
		T3M	2,925	91	1	0	1	3,063	95	1	0	1	3,216	100	1	0	1	3,177	99	1	0	1					
		T4M	2,862	89	1	0	1	2,997	93	1	0	1	3,147	98	1	0	1	3,110	97	1	0	1					
		TFTM	2,880	90	1	0	1	3,015	94	1	0	1	3,166	99	1	0	1	3,128	97	1	0	1					
P4	47W	T1S	3,729	80	1	0	1	3,904	84	1	0	1	4,099	88	1	0	1	4,051	87	1	0	1					
		T2M	3,881	83	1	0	1	4,063	87	1	0	1	4,267	91	1	0	1	4,216	90	1	0	1					
		T3M	3,882	83	1	0	1	4,065	87	1	0	1	4,268	91	1	0	1	4,217	90	1	0	1					
		T4M	3,799	81	1	0	1	3,978	85	1	0	1	4,177	90	1	0	1	4,127	88	1	0	1					
		TFTM	3,822	82	1	0	1	4,002	86	1	0	1	4,202	90	1	0	1	4,152	89	1	0	1					

Performance Package	System Watts	Dist. Type	27K (2700K, 70 CRI)					30K (3000K, 70 CRI)					40K (4000K, 70 CRI)					50K (5000K, 70 CRI)				
			Lumens	LPW	B	U	G	Lumens	LPW	B	U	G	Lumens	LPW	B	U	G	Lumens	LPW	B	U	G
P0	7W	T3M	737	107	0	0	0	763	111	0	0	0	822	119	0	0	0	832	121	0	0	1
		T4M	721	105	0	0	0	746	108	0	0	0	804	117	0	0	1	814	118	0	0	1
P1	11W	T3M	1,280	115	0	0	1	1,325	119	0	0	1	1,427	128	1	0	1	1,445	129	1	0	1
		T4M	1,253	112	0	0	1	1,297	116	0	0	1	1,397	125	0	0	1	1,415	127	0	0	1
P2	19W	T3M	2,087	110	1	0	1	2,160	114	1	0	1	2,327	123	1	0	1	2,357	124	1	0	1
		T4M	2,042	108	1	0	1	2,114	111	1	0	1	2,278	120	1	0	1	2,306	121	1	0	1
P3	32W	T3M	3,254	101	1	0	1	3,369	105	1	0	1	3,629	113	1	0	1	3,675	114	1	0	1
		T4M	3,185	99	1	0	1	3,297	103	1	0	1	3,552	111	1	0	1	3,597	112	1	0	1
P4	47W	T3M	4,319	93	1	0	1	4,471	96	1	0	1	4,817	103	1	0	2	4,878	105	1	0	2
		T4M	4,227	91	1	0	1	4,376	94	1	0	2	4,714	101	1	0	2	4,774	102	1	0	2

© 2019-2022 Acuity Brands Lighting, Inc. All rights reserved.

Electrical Load

Performance Package	System Watts	Current (A)					
		120Vac	208Vac	240Vac	277Vac	347Vac	480Vac
P0	7.0	0.061	0.042	0.04	0.039	--	--
	9.0	--	--	--	--	0.031	0.021
P1	11.0	0.100	0.064	0.059	0.054	--	--
	14.1	--	--	--	--	0.046	0.031
P2	19.0	0.168	0.106	0.095	0.083	--	--
	22.8	--	--	--	--	0.067	0.050
P3	32.0	0.284	0.163	0.144	0.131	--	--
	37.1	--	--	--	--	0.107	0.079
P4	47.0	0.412	0.234	0.207	0.185	--	--
	53.5	--	--	--	--	0.153	0.112

Lumen Output in Emergency Mode (4000K, 80 CRI, T3M)

Option	Lumens
E10WH	1,358
E20WC	2,230

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-40°C (32-104°F).

Ambient		Lumen Multiplier
0°C	32°F	1.03
10°C	50°F	1.02
20°C	68°F	1.01
25°C	77°F	1.00
30°C	86°F	0.99
40°C	104°F	0.97

Projected LED Lumen Maintenance

Data references the extrapolated performance projections for the platforms noted in a 25°C ambient, based on 10,000 hours of LED testing (tested per IESNA LM-80-08 and projected per IESNA TM-21-11).

To calculate LLF, use the lumen maintenance factor that corresponds to the desired number of operating hours below. For other lumen maintenance values, contact factory.

Operating Hours	0	25,000	50,000	100,000
Lumen Maintenance Factor	1.0	>0.96	>0.93	>0.87

Photometric Diagrams

To see complete photometric reports or download .ies files for this product, visit the Lithonia Lighting WDGE LED homepage. Tested in accordance with IESNA LM-79 and LM-80 standards.

LEGEND

0.25 fc
0.5 fc
1.0 fc
3.0 fc

MH = 10ft
Grid = 10ft x 10ft

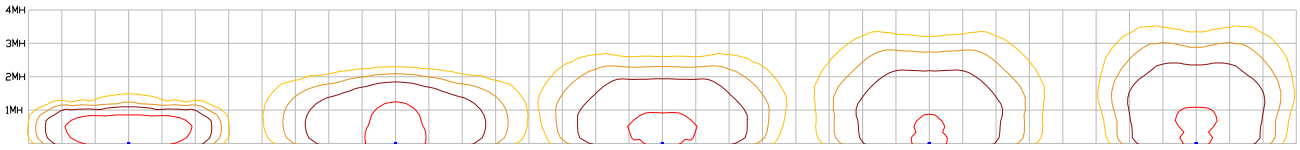

"P3 40K 80CRI T1S" "P3 40K 80CRI T2M" "P3 40K 80CRI T3M" "P3 40K 80CRI T4M" "P3 40K 80CRI TFTM"

Emergency Egress Options

Emergency Battery Backup

The emergency battery backup is integral to the luminaire — no external housing required! This design provides reliable emergency operation while maintaining the aesthetics of the product. All emergency battery backup configurations include an independent secondary driver with an integral relay to immediately detect loss of normal power and automatically energize the luminaire. The emergency battery will power the luminaire for a minimum duration of 90 minutes (maximum duration of three hours) from the time normal power is lost and maintain a minimum of 60% of the light output at the end of 90minutes.

Applicable codes: NFPA 70/NEC – section 700.16, NFPA 101 Life Safety Code Section 7.9

© 2019-2022 Acuity Brands Lighting, Inc. All rights reserved.

Control / Sensor Options

Motion/Ambient Sensor (PIR_, PIRH_)

Motion/Ambeint sensor (Sensor Switch MSOD) is integrated into the the luminaire. The sensor provides both Motion and Daylight based dimming of the luminaire. For motion detection, the sensor utilizes 100% Digital Passive Infrared (PIR) technology that is tuned for walking size motion while preventing false tripping from the environment. The integrated photocell enables additional energy savings during daytime periods when there is sufficient daylight. Optimize sensor coverage by either selecting PIR or PIRH option. PIR option comes with a sensor lens that is optimized to provide maximum coverage for mounting heights between 8-15ft, while PIRH is optimized for 15-40ft mounting height.

Networked Control (NLTAIR2)

nLight® AIR is a wireless lighting controls platform that allows for seamless integration of both indoor and outdoor luminaires. Five-tier security architecture, 900 MHz wireless communication and app (CLAIRITY™ Pro) based configurability combined together make nLight® AIR a secure, reliable and easy to use platform.

PIR

HIGH VIEW

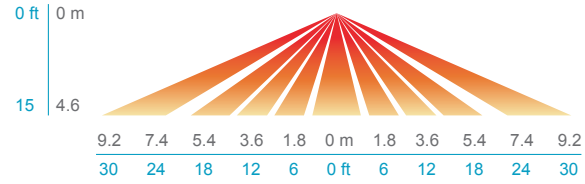

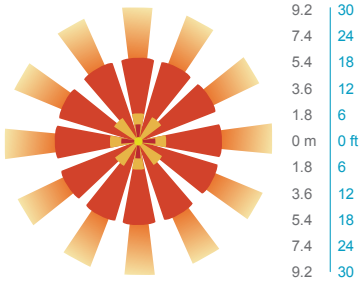

PIRH

SIDE VIEW

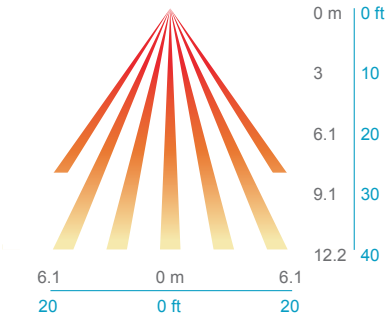

TOP VIEW

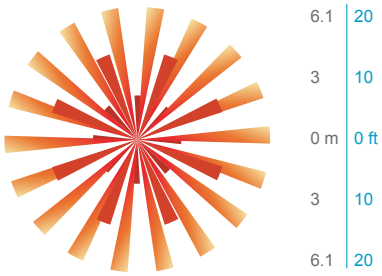

Option	Dim Level	High Level (when triggered	Photocell Operation	Motion Time Delay	Ramp-down Time	Ramp-up Time
PIR or PIRH	Motion - 3V (37% of full output) Photocell - 0V (turned off)	10V (100% output)	Enabled @ 5fc	5 min	5 min	Motion - 3 sec Photocell - 45 sec
PIR1FC3V, PIRH1FC3V	Motion - 3V (37% of full output) Photocell - 0V (turned off)	10V (100% output)	Enabled @ 1fc	5 min	5 min	Motion - 3 sec Photocell - 45 sec
NLTAIR2 PIR, NLTAIR2 PIRH (out of box)	Motion - 3V (37% of full output) Photocell - 0V (turned off)	10V (100% output)	Enabled @ 5fc	7.5 min	5 min	Motion - 3 sec Photocell - 45 sec

© 2019-2022 Acuity Brands Lighting, Inc. All rights reserved.

Mounting, Options & Accessories

Motion/Ambient Sensor

D = 7"

H = 9" (Standalone controls)
11" (nLight AIR controls, 2" antenna will be pointing down behind the sensor)

W = 11.5"

PBBW – Surface-Mounted Back Box
Use when there is no junction box available.

D = 1.75"

H = 9"

W = 11.5"

AWS – 3/8inch Architectural Wall Spacer

D = 0.38"

H = 4.4"

W = 7.5"

FEATURES & SPECIFICATIONS

INTENDED USE
Common architectural look, with clean rectilinear shape, of the WDGE LED was designed to blend with any type of construction, whether it be tilt-up, frame or brick. Applications include commercial offices, warehouses, hospitals, schools, malls, restaurants, and other commercial buildings.

CONSTRUCTION
The single-piece die-cast aluminum housing integrates secondary heat sinks to optimize thermal transfer from the internal light engine heat sinks and promote long life. The driver is mounted in direct contact with the casting for a low operating temperature and long life. The die-cast door frame is fully gasketed with a one-piece solid silicone gasket to keep out moisture and dust, providing an IP66 rating for the luminaire.

FINISH
Exterior painted parts are protected by a zinc-infused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures a 3 mils thickness for a finish that can withstand extreme climate changes without cracking or peeling. Standard Super Durable colors include dark bronze, black, natural aluminum, sandstone and white. Available in textured and non-textured finishes.

OPTICS
Individually formed acrylic lenses are engineered for superior application efficiency which maximizes the light in the areas where it is most needed. The WDGE LED has zero uplight and qualifies as a Nighttime Friendly™ product, meaning it is consistent with the LEED® and Green Globes™ criteria for eliminating wasteful uplight.

ELECTRICAL
Light engine consists of high-efficacy LEDs mounted to metal-core circuit boards to maximize heat dissipation and promote long life (up to L91/100,000 hours at 25°C). The electronic driver has a power factor of >90%, THD <20%. Luminaire comes with built in 6kV surge protection, which meets a minimum Category C low exposure (per ANSI/IEEE C62.41.2). Fixture ships standard with 0-10v dimmable driver.

INSTALLATION
A universal mounting plate with integral mounting support arms allows the fixture to hinge down for easy access while making wiring connections. The 3/8" Architectural Wall Spacer (AWS) can be used to create a floating appearance or to accommodate small imperfections in the wall surface. The ICW option can be used to mount the luminaire inverted for indirect lighting in dry and damp locations. Design can withstand up to a 1.5 G vibration load rating per ANSI C136.31.

LISTINGS
CSA certified to U.S. and Canadian standards. Luminaire is IP66 rated. PIR options are rated for wet location. Rated for -40°C minimum ambient. DesignLights Consortium® (DLC) Premium qualified product and DLC qualified product. Not all versions of this product may be DLC Premium qualified or DLC qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified. International Dark-Sky Association (IDA) Fixture Seal of Approval (FSA) is available for all products on this page utilizing 2700K and 3000K color temperature only and SRM mounting only.

BUY AMERICAN ACT
Product with the BAA option is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT regulations.
Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY
5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at:
www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.

© 2019-2022 Acuity Brands Lighting, Inc. All rights reserved.

RSX1 LED
Area Luminaire

Catalog Number

Notes

Type **OA4**

Hit the Tab key or mouse over the page to see all interactive elements.

Specifications

EPA (ft²@0°): 0.57 ft² (0.05 m²)

Length: 21.8" (55.4 cm) (SPA mount)

Width: 13.3" (33.8 cm)

Height: 3.0" (7.6 cm) Main Body 7.2" (18.4 cm) Arm

Weight (SPA mount): 22.0 lbs (10.0 kg)

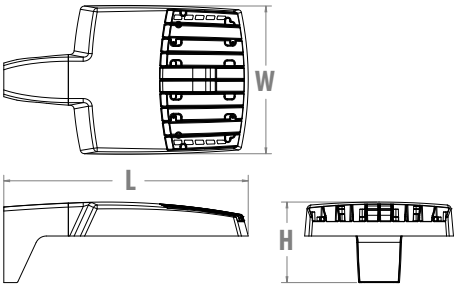

Introduction

The new RSX LED Area family delivers maximum value by providing significant energy savings, long life and outstanding photometric performance at an affordable price. The RSX1 delivers 7,000 to 17,000 lumens allowing it to replace 70W to 400W HID luminaires.

The RSX features an integral universal mounting mechanism that allows the luminaire to be mounted on most existing drill hole patterns. This "no-drill" solution provides significant labor savings. An easy-access door on the bottom of mounting arm allows for wiring without opening the electrical compartment. A mast arm adaptor, adjustable integral slipfitter and other mounting configurations are available.

design select

Items marked by a shaded background qualify for the Design Select program and ship in 15 days or less. To learn more about Design Select, visit www.acuitybrands.com/designselect.
*See ordering tree for details

Design Select options indicated by this color background.

Ordering Information

EXAMPLE: RSX1 LED P4 40K R3 MVOLT SPA DDBXD

RSX1 LED

Series	Performance Package	Color Temperature	Distribution	Voltage	Mounting
RSX1 LED	P1	30K 3000K	R2 Type 2 Wide	MVOLT (120V-277V) [2]	SPA Square pole mounting (3.0" min. SQ pole for 1 at 90°, 3.5" min. SQ pole for 2, 3, 4 at 90°)
	P2	40K 4000K	R3 Type 3 Wide	HVOLT (347V-480V) [3]	RPA Round pole mounting (3.2" min. dia. RND pole for 2, 3, 4 at 90°, 3.0" min. dia. RND pole for 1 at 90°, 2 at 180°, 3 at 120°)
	P3	50K 5000K	R3S Type 3 Short	XVOLT (277V-480V) [4]	MA Mast arm adaptor (fits 2-3/8" OD horizontal tenon)
	P4		R4 Type 4 Wide	(use specific voltage for options as noted)	IS Adjustable slipfitter (fits 2-3/8" OD tenon) [6]
			R4S Type 4 Short	120 [3] 277 [5]	WBA Wall bracket [1]
			R5 Type 5 Wide [1]	208 [3] 347 [5]	WBASC Wall bracket with surface conduit box
			R5S Type 5 Short [1]	240 [3] 480 [5]	AASP Adjustable tilt arm square pole mounting [6]
			AFR Automotive Front Row		AARP Adjustable tilt arm round pole mounting [6]
			AFRR90 Automotive Front Row Right Rotated		AAWB Adjustable tilt arm with wall bracket [6]
			AFRL90 Automotive Front Row Left Rotated		AAWSC Adjustable tilt arm wall bracket and surface conduit box [6]

Options

Shipped Installed

HS	House-side shield [7]
PE	Photocontrol, button style [8,9]
PER7	Seven-wire twist-lock receptacle only (no controls) [9,10,11]
SF	Single fuse (120, 277, 347) [5]
DF	Double fuse (208, 240, 480) [5]
SPD20KV	20KV Surge pack (10KV standard)
FAO	Field adjustable output [9]
DMG	0-10V dimming extend out back of housing for external control (control ordered separate) [9]

Shipped Installed

***Standalone and Networked Sensors/Controls (factory default settings, see table page 9)**

NLTAIR2 PIRHN	nLight AIR generation 2, with Networked, Bi-Level motion/ambient sensor [9, 12, 13, 14]
BAA	Buy America(n) Act Compliant
CCE	Coastal Construction [15]

*Note: NLTAIR2 PIRHN with nLight Air can be used as a standalone or networked solution. Sensor coverage pattern is affected when luminaire is tilted.

Shipped Separately (requires some field assembly)

EGS	External glare shield [7]
EGFV	External glare full visor (360° around light aperture) [7]
BS	Bird spikes [16]

Finish

DDBXD	Dark Bronze
DBLXD	Black
DNAXD	Natural Aluminum
DWHXD	White
DDBTXD	Textured Dark Bronze
DBLBXD	Textured Black
DNATXD	Textured Natural Aluminum
DWHGXD	Textured White

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Ordering Information

Accessories
Ordered and shipped separately.

RSX1HS	RSX1 House side shield (includes 1 shield)
RSX1HSAFRR U	RSX1 House side shield for AFR rotated optics (includes 1 shield)
RSX1EGS (FINISH) U	External glares hield (specify finish)
RSX1EGFV (FINISH) U	External glare full visor (specify finish)
RSXRPA (FINISH) U	RSX Universal round pole adaptor plate (specify finish)
RSXWBA (FINISH) U	RSX WBA wall bracket (specify finish) [1]
RSXSCB (FINISH) U	RSX Surface conduit box (specify finish, for use with WBA, WBA not included)
DLL127F 1.5 JU	Photocell -SSL twist-lock (120-277V) [17]
DLL347F 1.5 CUL JU	Photocell -SSL twist-lock (347V) [17]
DLL480F 1.5 CUL JU	Photocell -SSL twist-lock (480V) [17]
DSHORT SBK U	Shorting cap [17]

NOTES
1. Any Type 5 distribution, is not available with WBA.
2. MVOLT driver operates on any line voltage from 120-277V (50/60 Hz).
3. HVOLT driver operates on any line voltage from 347-480V (50/60 Hz).
4. XVOLT driver not available with P1 or P2. XVOLT driver operates on any line voltage from 277V-480V (50/60 Hz). XVOLT not available with fusing (SF or DF) and not available with PE.
5. Single fuse (SF) requires 120V, 277V or 347V. Double fuse (DF) requires 208V, 240V or 480V.
6. Maximum tilt is 90° above horizontal.
7. It may be ordered as an accessory.
8. Requires MVOLT or 347V.
9. Two or more of the following options cannot be combined including PE, DMG, PER7, FAO and NLTAIR2 PIRHN. (Exception: PE and FAO can be combined; also PE and DMG can be combined.)
10. Compatible with standard twist-lock photocells for dusk to dawn operation or advanced control nodes that provide 0-10V dimming signals. Wire 4/Wire 5 wired to dimming leads on driver. Wire6/Wire7 capped inside luminaire. Twistlock photocell ordered and shipped as a separate line item from Acuity Brands Controls. See accessories. Shorting Cap included.
11. For units with option PER7, the mounting must be restricted to +/- 45° from horizontal aim per ANSI C136.10-2010.
12. Must be ordered with PIRHN.
13. Requires MVOLT or HVOLT.
14. Must be ordered with NLTAIR2. For additional information on PIRHN visit here.
15. CCE option not available with WBA, WBASC, AASP, AARP, AAWB, AAWBSC, EGS, EGFV and BS.
16. Must be ordered with fixture for factory pre-drilling.
17. Requires luminaire to be specified with PER7 option. Ordered and shipped as a separate line item from Acuity Brands Controls.

External Shields

House Side Shield

External Glare Shield

External 360 Full Visor

Pole/Mounting Informatiion

Accessories including bullhorns, cross arms and other adpaters are available under the accessories tab at Lithonia's Outdoor Poles and Arms product page. Click here to visit Accessories.

HANDHOLE ORIENTATION



RSX POLE DRILLING

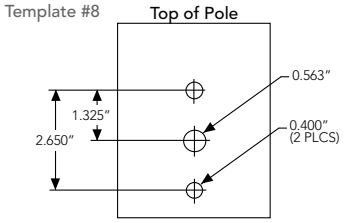

RSX STANDARD ARM & ADJUSTABLE ARM



Round Tenon Mount - Pole Top Slipfitters

Tenon O.D.	RSX Mounting	Single	2 at 180°	2 at 90°	3 at 120°	3 at 90°	4 at 90°
2 - 3/8"	RPA, AARP	AS3-5 190	AS3-5 280	AS3-5 290	AS3-5 320	AS3-5 390	AS3-5 490
2 - 7/8"	RPA, AARP	AST25-190	AST25-280	AST25-290	AST25-320	AST25-390	AST25-490
4"	RPA, AARP	AST35-190	AST35-280	AST35-290	AST35-320	AST35-390	AST35-490

Drill/Side Location by Configuration Type

Drilling Template	Mounting Option	Single	2 @ 180	2 @ 90	3 @ 120	3 @ 90	4 @ 90
	Head Location	Side B	Side B & D	Side B & C	Round Pole Only	Side B, C & D	Side A, B, C & D
#8	**Drill Nomenclature**	DM19AS	DM28AS	DM29AS	DM32AS	DM39AS	DM49AS

RSX1 - Luminaire EPA

*Includes luminaire and integral mounting arm. Other tenons, arms, brackets or other accessories are not included in this EPA data.

Fixture Quantity & Mounting Configuration		Single	2 @ 90	2 @ 180	3 @ 90	3 @ 120	4 @ 90	2 Side by Side	3 Side by Side	4 Side by Side
Mounting Type	**Tilt**									
SPA - Square Pole Adaptor	0°	0.57	1.03	1.05	1.52	1.36	2.03	1.31	1.7	2.26
RPA - Round Pole Adaptor		0.62	1.08	1.15	1.62	1.46	2.13	1.36	1.8	2.36
MA - Mast Arm Adaptor		0.49	0.95	0.89	1.36	1.2	1.87	1.23	1.54	2.1
IS - Integral Slipfitter AASP/AARP - Adjustable Arm Square/Round Pole	0°	0.57	1.03	1.05	1.52	1.36	2.03	1.31	1.7	2.26
	10°	0.68	1.34	1.33	2	1.74	2.64	1.35	2.03	2.71
	20°	0.87	1.71	1.73	2.56	2.26	3.42	1.75	2.62	3.49
	30°	1.24	2.19	2.3	3.21	2.87	4.36	2.49	3.73	4.97
	40°	1.81	2.68	2.98	3.85	3.68	5.30	3.62	5.43	7.24
	45°	2.11	2.92	3.44	4.2	4.08	5.77	4.22	6.33	8.44
	50°	2.31	3.17	3.72	4.52	4.44	6.26	4.62	6.94	9.25
	60°	2.71	3.66	4.38	5.21	5.15	7.24	5.43	8.14	10.86
	70°	2.78	3.98	4.54	5.67	5.47	7.91	5.52	8.27	11.03
	80°	2.76	4.18	4.62	5.97	5.76	8.31	5.51	8.27	11.03
	90°	2.73	4.25	4.64	6.11	5.91	8.47	5.45	8.18	10.97

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Photometric Diagrams

To see complete photometric reports or download .ies files for this product, visit Lithonia Lighting's RSX Area homepage.

Isofootcandle plots for the RSX1 LED P4 40K. Distances are in units of mounting height (20').

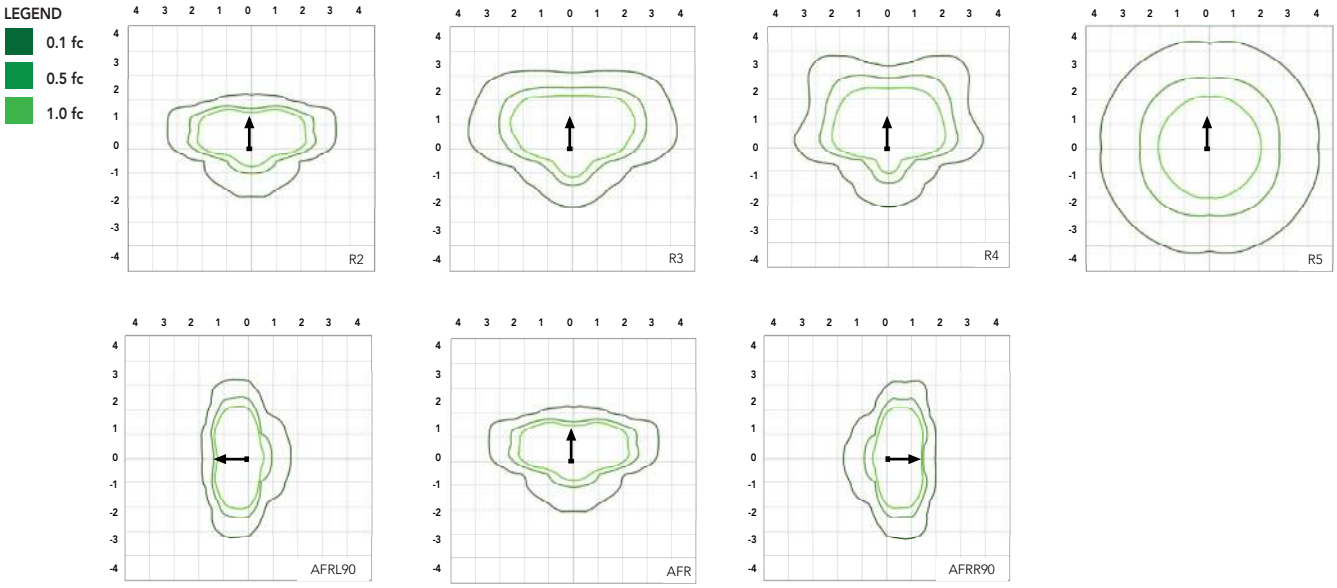

Performance Data

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-50°C (32-122°F).

Ambient	Ambient	Lumen Multiplier
0°C	32°F	1.05
5°C	41°F	1.04
10°C	50°F	1.03
15°C	59°F	1.02
20°C	68°F	1.01
25°C	77°F	1.00
30°C	86°F	0.99
35°C	95°F	0.98
40°C	104°F	0.97
45°C	113°F	0.96
50°C	122°F	0.95

Electrical Load

		Current (A)					
Performance Package	System Watts (W)	120V	208V	240V	277V	347V	480V
P1	51W	0.42	0.25	0.21	0.19	0.14	0.11
P2	72W	0.60	0.35	0.30	0.26	0.21	0.15
P3	109W	0.91	0.52	0.45	0.39	0.31	0.23
P4	133W	1.11	0.64	0.55	0.48	0.38	0.27

Projected LED Lumen Maintenance

Operating Hours	50,000	75,000	100,000
Lumen Maintenance Factor	>0.97	>0.95	>0.92

Values calculated according to IESNA TM-21-11 methodology and valid up to 40°C.

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts. Contact factory for performance data on any configurations not shown here.

Performance Package	System Watts	Distribution. Type	30K (3000K, 70 CRI)					40K (4000K, 70 CRI)					50K (5000K, 70 CRI)				
			Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW
P1	51W	R2	6,482	1	0	1	126	7,121	1	0	1	139	7,121	1	0	1	139
		R3	6,459	1	0	2	127	7,096	1	0	2	139	7,096	1	0	2	139
		R3S	6,631	1	0	1	129	7,286	1	0	2	142	7,286	1	0	2	142
		R4	6,543	1	0	2	128	7,189	1	0	2	141	7,189	1	0	2	141
		R4S	6,313	1	0	1	124	6,936	1	0	1	136	6,936	1	0	1	136
		R5	6,631	3	0	2	130	7,286	3	0	2	143	7,286	3	0	2	143
		R5S	6,807	3	0	1	133	7,479	3	0	1	147	7,479	3	0	1	147
		AFR	6,473	1	0	1	127	7,112	1	0	1	139	7,112	1	0	1	139
		AFRR90	6,535	2	0	2	127	7,179	2	0	2	140	7,179	2	0	2	140
		AFRL90	6,562	2	0	1	128	7,210	2	0	2	140	7,210	2	0	2	140
P2	72W	R2	8,991	2	0	1	123	9,878	2	0	1	135	9,878	2	0	1	135
		R3	8,959	2	0	2	124	9,843	2	0	2	137	9,843	2	0	2	137
		R3S	9,198	2	0	2	126	10,106	2	0	2	139	10,106	2	0	2	139
		R4	9,077	2	0	2	126	9,972	2	0	2	139	9,972	2	0	2	139
		R4S	8,757	1	0	2	122	9,622	2	0	2	134	9,622	2	0	2	134
		R5	9,198	4	0	2	128	10,106	4	0	2	140	10,106	4	0	2	140
		R5S	9,443	3	0	1	131	10,374	3	0	1	144	10,374	3	0	1	144
		AFR	8,979	2	0	1	125	9,865	2	0	1	137	9,865	2	0	1	137
		AFRR90	9,064	3	0	2	124	9,959	3	0	2	137	9,959	3	0	2	137
		AFRL90	9,102	3	0	2	125	10,001	3	0	2	137	10,001	3	0	2	137
P3	109W	R2	12,808	2	0	1	117	14,072	2	0	2	129	14,072	2	0	2	129
		R3	12,763	2	0	2	117	14,023	2	0	2	129	14,023	2	0	2	129
		R3S	13,104	2	0	2	120	14,397	2	0	2	132	14,397	2	0	2	132
		R4	12,930	2	0	2	119	14,206	2	0	2	130	14,206	2	0	2	130
		R4S	12,475	2	0	2	114	13,707	2	0	2	126	13,707	2	0	2	126
		R5	13,104	4	0	2	120	14,397	4	0	2	132	14,397	4	0	2	132
		R5S	13,452	3	0	2	123	14,779	3	0	2	136	14,779	3	0	2	136
		AFR	12,791	2	0	1	117	14,053	2	0	2	129	14,053	2	0	2	129
		AFRR90	12,913	3	0	3	118	14,187	3	0	3	130	14,187	3	0	3	130
		AFRL90	12,967	3	0	2	118	14,247	3	0	3	130	14,247	3	0	3	130
P4	133W	R2	14,943	2	0	2	112	16,417	2	0	2	123	16,417	2	0	2	123
		R3	14,890	2	0	3	112	16,360	2	0	3	123	16,360	2	0	3	123
		R3S	15,287	2	0	2	115	16,796	2	0	2	126	16,796	2	0	2	126
		R4	15,085	2	0	3	113	16,574	2	0	3	125	16,574	2	0	3	125
		R4S	14,554	2	0	2	109	15,991	2	0	2	120	15,991	2	0	2	120
		R5	15,287	4	0	2	115	16,796	4	0	2	126	16,796	4	0	2	126
		R5S	15,693	4	0	2	118	17,242	4	0	2	130	17,242	4	0	2	130
		AFR	14,923	2	0	2	112	16,395	2	0	2	123	16,395	2	0	2	123
		AFRR90	15,065	3	0	3	113	16,551	3	0	3	124	16,551	3	0	3	124
		AFRL90	15,128	3	0	3	114	16,621	3	0	3	125	16,621	3	0	3	125

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Luminaire Weight by Mounting Type

Mounting Configuration	Total Luminaire Weight
SPA	22 lbs
RPA	24 lbs
MA	22 lbs
WBA	25 lbs
WBASC	28 lbs
IS	25 lbs
AASP	25 lbs
AARP	27 lbs
AAWB	28 lbs
AAWSC	31 lbs

RSX1 with Round Pole Adapter (RPA)

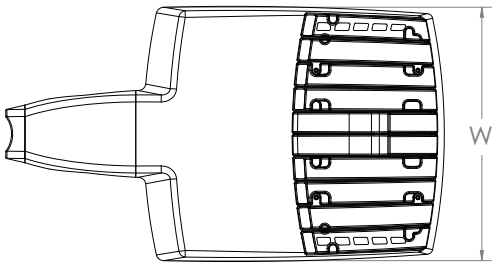

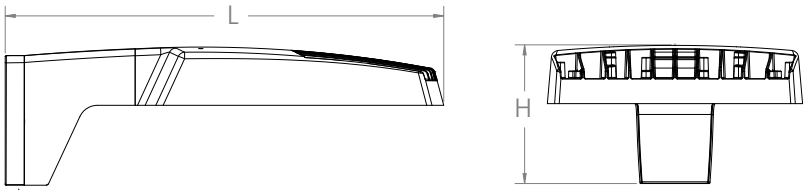

Note: RPA — Round Pole mount can also be used to mount on square poles by omitting the round pole adapter plate shown here.

Length: 22.8" (57.9 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
7.2" (18.4 cm) Arm

RSX1 with Mast Arm Adapter (MA)

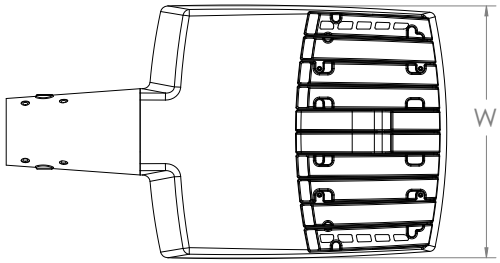

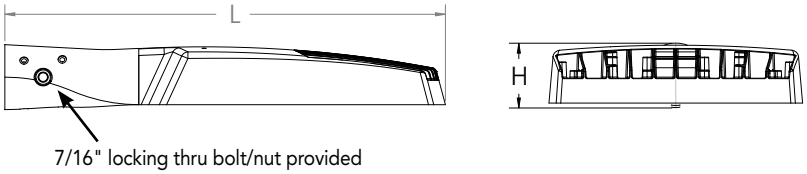

Length: 23.2" (59.1 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
3.5" (8.9 cm) Arm

RSX1 with Adjustable Slipfitter (IS)

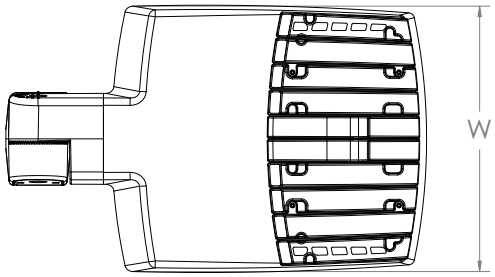

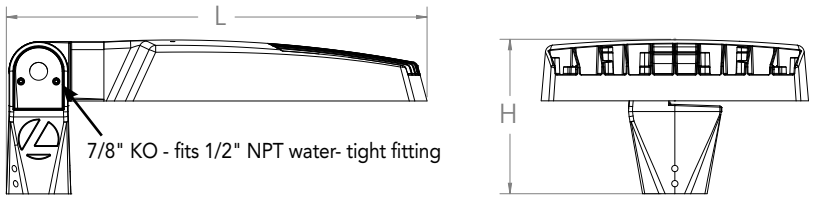

Length: 20.7" (52.7 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
7.6" (19.3 cm) Arm

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Dimensions

RSX1 with Wall Bracket (WBA)

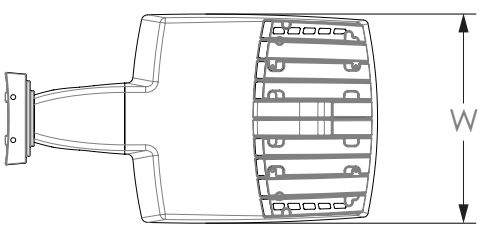

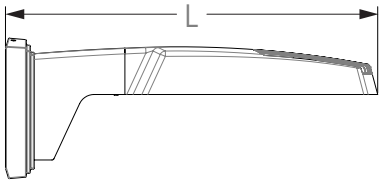



Length: 23.6" (59.9 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
8.9" (22.6 cm) Arm

Wall Bracket (WBA) Mounting Detail

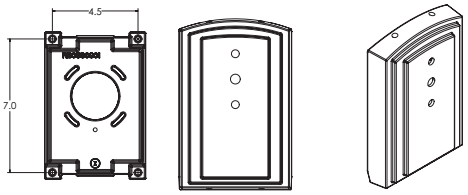

RSX1 with Wall Bracket with Surface Conduit Box (WBASC)

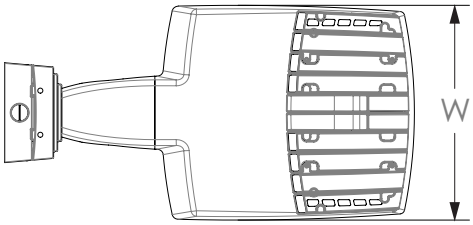

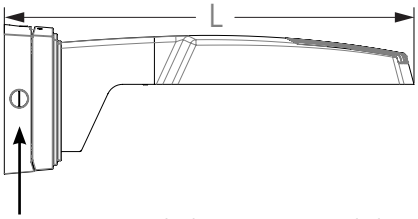

3/4" NPT taps with plugs - Qty (4) provided



Length: 25.3" (64.3 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
9.2" (23.4 cm) Arm

Surface Conduit Box (SCB) Mounting Detail

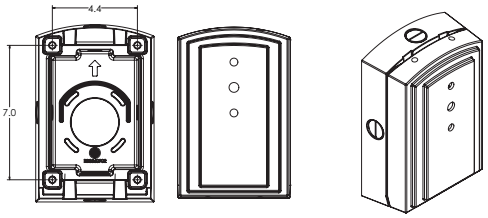

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Dimensions

RSX1 with Adjustable Tilt Arm - Square or Round Pole (AASP or AARP)

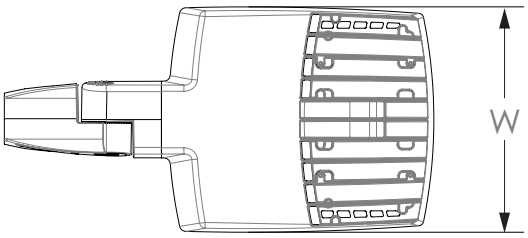

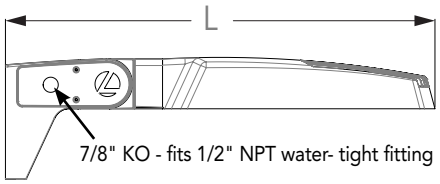



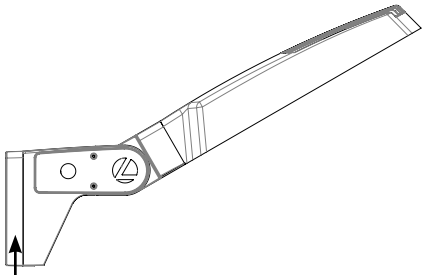

Length: 25.3" (65.3 cm) **AASP**
26.3" (66.8 cm) **AARP**
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
7.2" (18.2 cm) Arm

NOTE:
RPA - Round Pole mount can also be used to mount on square poles by omitting the round pole adapter plate shown here.

Notes

AASP: Requires 3.0" min. square pole for 1 at 90°. Requires 3.5" min. square pole for mounting 2, 3, 4 at 90°.

AARP: Requires 3.2" min. dia. round pole for 2, 3, 4 at 90°. Requires 3.0" min. dia. round pole for mounting 1 at 90°, 2 at 180°, 3 at 120°.

RSX1 with Adjustable Tilt Arm with Wall Bracket (AAWB)

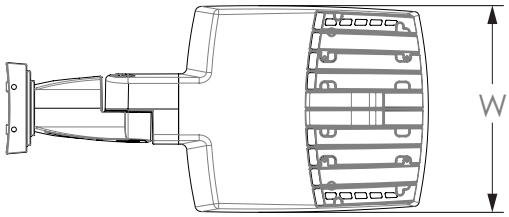

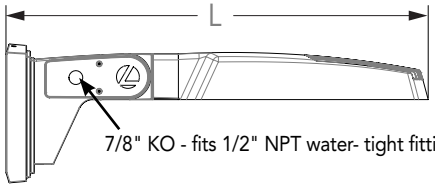



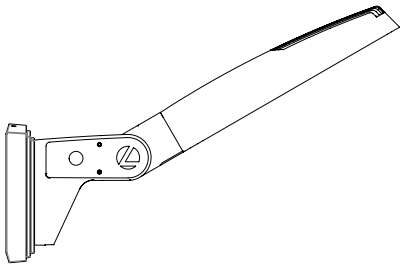

Length: 27.1" (68.8 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
8.9" (22.6 cm) Arm

Wall Bracket (WBA) Mounting Detail

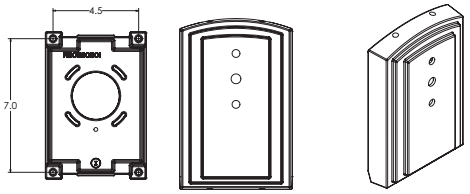

One Lithonia Way • Conyers, Georgia 30012 • Phone: 1-800-705-SERV (7378) • www.acuitybrands.com
© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

Dimensions

RSX1 with Adjustable Tilt Arm with Wall Bracket and Surface Conduit Box (AAWSC)

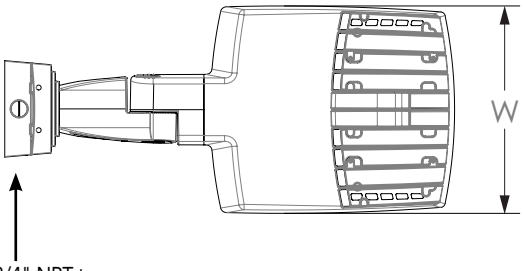

3/4" NPT taps
with plugs - Qty (4)
provided

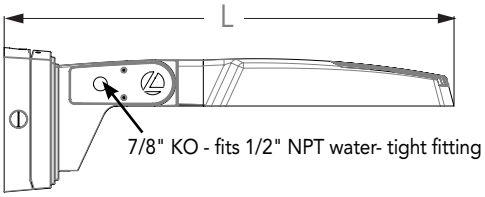



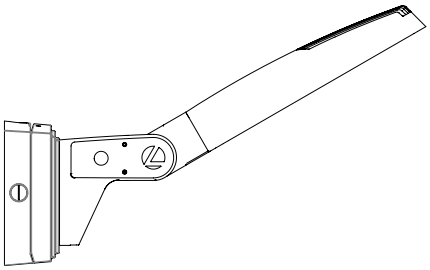

Length: 28.8" (73.2 cm)
Width: 13.3" (33.8 cm)
Height: 3.0" (7.6 cm) Main Body
9.2" (23.4 cm) Arm

Surface Conduit Box (SCB) Mounting Detail

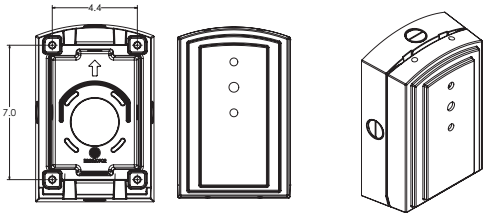

Automotive Front Row - Rotated Optics (AFRL90/R90)

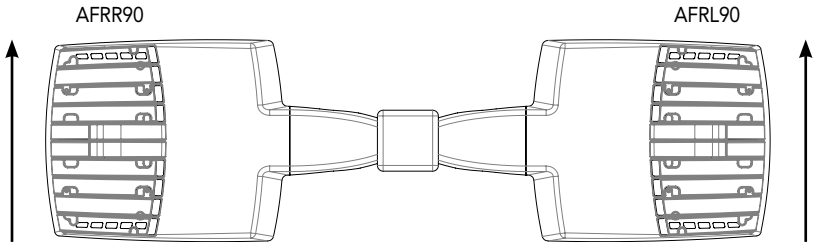

(Example: 2@180 - arrows indicate direction of light exiting the luminaire)

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

nLight Control - Sensor Coverage and Settings

nLight Sensor Coverage Pattern

NLTAIR2 PIRHN

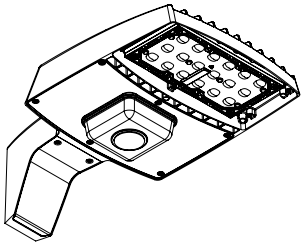

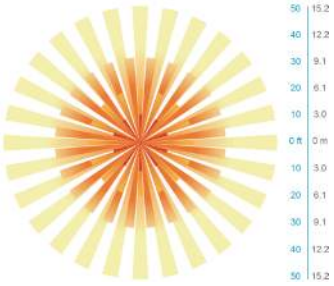

Top

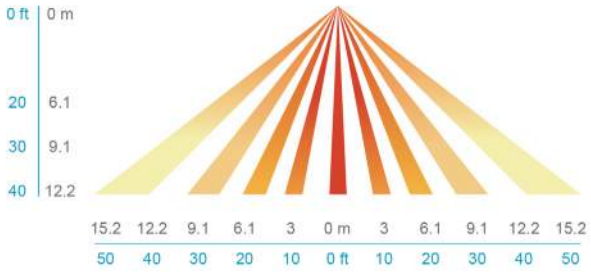

Side

Motion Sensor Default Settings - Option PIRHN						
Option	Dimmed State (unoccupied)	High Level (when occupied)	Photocell Operation	Dwell Time (occupancy time delay)	Ramp-up Time (from unoccupied to occupied)	Ramp-down Time (from occupied to unoccupied)
NLTAIR2 PIRHN	Approx. 30% Output	100% Output	Enabled @ 1.5FC	7.5 minutes	3 seconds	5 minutes

*Note: NLTAIR2 PIRHN default settings including photocell set-point, high/low dim rates, and occupancy sensor time delay are all configurable using the Clairity Pro App. Sensor coverage pattern shown with luminaire at 0°. Sensor coverage pattern is affected when luminaire is titled.

FEATURES & SPECIFICATIONS

INTENDED USE
The RSX LED area family is designed to provide a long-lasting, energy-efficient solution for the one-for-one replacement of existing metal halide or high pressure sodium lighting. The RSX1 delivers 7,000 to 17,000 lumens and is ideal for replacing 70W to 400W HID pole-mounted luminaires in parking lots and other area lighting applications.

CONSTRUCTION
The RSX LED area luminaire features a rugged die-cast aluminum main body that uses heat-dissipating fins and flow-through venting to provide optimal thermal management that both enhances LED performance and extends component life. Integral "no drill" mounting arm allows the luminaire to be mounted on existing pole drillings, greatly reducing installation labor. The light engines and housing are sealed against moisture and environmental contaminants to IP66. The low-profile design results in a low EPA, allowing pole optimization. All mountings are rated for minimum 1.5 G vibration load per ANSI C136.31. 3G Mountings: Include SPA, RPA, MA, IS, AASP, and AARP rated for 3G vibration. 1.5G Mountings: Include WBA, WBASC, AAWB and AAWSC rated for 1.5G vibration.

FINISH
Exterior parts are protected by a zinc-infused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures superior adhesion as well as a minimum finish thickness of 3 mils. The result is a high-quality finish that is warrantied not to crack or peel.

COASTAL CONSTRUCTION (CCE)
ptional corrosion resistant construction is engineered with added corrosion rotection in materials and/or pre-treatment of base material under superŸurable paint. Provides additional corrosion protection for applications nearÜoastal areas. Finish is salt spray tested to over 5,000 hours per ASTM B117 with cribe rating of 10. Additional lead-times apply.

OPTICS
Precision acrylic refractive lenses are engineered for superior application efficiency, distributing the light to where it is needed most. Available in short and wide pattern distributions including Type 2, Type 3, Type 3S, Type 4, Type 4S, Type 5, Type 5S, AFR (Automotive Front Row), and AFR rotated AFRR90 and ARFL90.

ELECTRICAL
Light engine(s) configurations consist of high-efficacy LEDs mounted on metal-core circuit boards and aluminum heat sinks to maximize heat dissipation. Light engines are IP66 rated. LED lumen maintenance is >L92/100,000 hours. CCT's of 3000K, 4000K and 5000K (minimum 70 CRI) are available. Fixtures ship standard with 0-10v dimming driver. Class 1 electronic drivers ensure system power factor >90% and THD <20%. Easily serviceable 10kV surge protection device meets a minimum Category C Low operation (per ANSI/IEEE C62.41.2).

STANDARD CONTROLS
The RSX LED area luminaire has a wide assortment of control options. Dusk to dawn controls include MVOLT and 347V button-type photocells and NEMA twist-lock photocell receptacles.

nLIGHT AIR CONTROLS
The RSX LED area luminaire is also available with nLight® AIR for the ultimate in wireless control. This powerful controls platform provides out-of-the-box basic motion sensing with photocontrol functionality and is suitable for mounting heights up to 40 feet. No commissioning is required when using factory default settings that provide basic stand-alone motion occupancy dimming that is switched on and off with a built-in photocell. See chart above for motion sensor default out-of-box settings. For more advanced wireless functionality, such as group dimming, nLight AIR can be commissioned using a smartphone and the easy-to-use CLAIRITY app. nLight AIR equipped luminaries can be grouped, resulting in motion sensor and photocell group response without the need for additional equipment. Scheduled dimming with motion sensor over-ride can be achieved when used with the nLight Eclypse. Additional information about nLight Air can be found here.

INSTALLATION
Integral "no-drill" mounting arm allows for fast, easy mounting using existing pole drillings. Select the "SPA" option for square poles and the "RPA" option to mount to round poles. Note, the RPA mount can also be used for mounting to square poles by omitting the RPA adapter plate. Select the "MA" option to attach the luminaire to a 2 3/8" horizontal mast arm or the "IS" option for an adjustable slipfitter that mounts on a 2 3/8" OD tenon. The adjustable slipfitter has an integral junction box and offers easy installation. Can be tilted up to 90° above horizontal. Additional mountings are available including a wall bracket, adjustable tilt arm for direct-to-pole and wall and a surface conduit box for wall mount applications.

LISTINGS
CSA Certified to meet U.S. and Canadian standards. Suitable for wet locations. Rated for -40°C minimum ambient. DesignLights Consortium® (DLC) Premium qualified product and DLC qualified product. Not all versions of this product may be DLC Premium qualified or DLC qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.
International Dark-Sky Association (IDA) Fixture Seal of Approval (FSA) is available for all products on this page utilizing 3000K color temperature only. U.S. Patent No. D882, 146S

BUY AMERICAN ACT
Product with the BAA option is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT regulations. Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY
5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at:
www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.

© 2018-2023 Acuity Brands Lighting, Inc. All rights reserved.

LAMAR
EW19404

WALL

PROJECT

OW1

EW19404-BK
Black

EW19404-WH
White

DESCRIPTION

Extruded aluminum cylinders with cast retaining rings and mounts. Exterior surface mount or pendant with Frosted PC Diffuser. Down light. Custom options available.

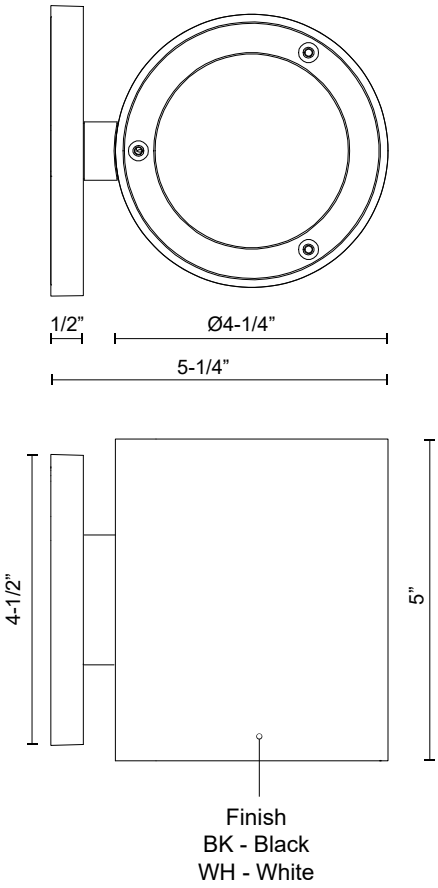

SPECIFICATION DETAILS

Fixture Dimensions	W4-1/4" x H5" x E5-1/4"
Light Source	LED with DC Driver
Wattage	20W
Total Lumens	1530lm
Delivered Lumens	BK-1022lm; WH-1100lm*;
Voltage	120V
Color Temperature	3000K
CRI (Ra)	90CRI
Optional Color Temps	2700K - 5000K Available, Minimum Order Quantities Apply
LED Rated Life	50,000 hours
Dimming	100% - 10%, TRIAC or ELV Dimmer (Not Included)
Diffuser Details	Frosted PC Diffuser
Location	Wet
Illumination Direction	Downlight
Mounting Style	All Orientation; Wall;
Canopy Dimensions	W4-1/2" x H4-1/2" x E1/2"

* For custom options, consult factory for details.
* For warranty information, please visit www.kuzcolighting.com/warranty

KUZCO

CANADA: 19054 28TH AVENUE - SURREY, BC V3Z 6M3
USA: 3035 E. LONE MOUNTAIN ROAD - LAS VEGAS, NV 89081

WWW.KUZCOLIGHTING.COM

© 2021 KUZCO LIGHTING. ALL RIGHTS RESERVED.

COMMENT

Intertek

KNOX
EB41936

BOLLARDS

PROJECT

OB1

EB41936-BK
Black

DESCRIPTION

Architecturally designed high-power LED exterior bollard fixture. This die-cast aluminum cylinder with a powder-coated finish features a high top and cage design with a radiant downlight to illuminate walkways and paths effectively

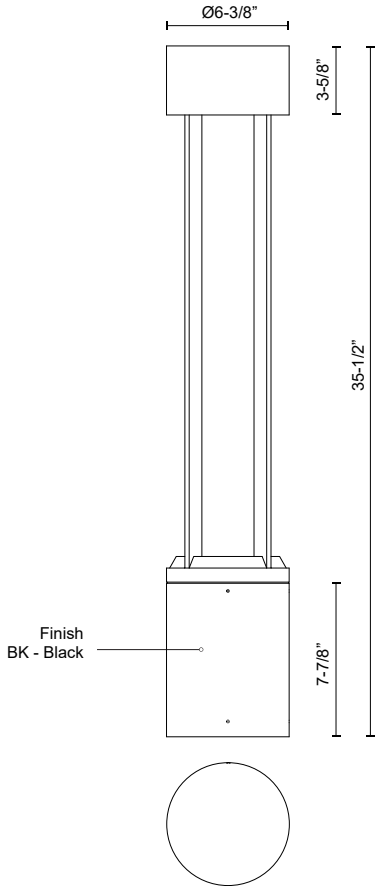

SPECIFICATION DETAILS

Fixture Dimensions	D6-3/8" x H35-1/2"
Light Source	LED with DC Driver
Wattage	24W
Total Lumens	2500lm
Delivered Lumens	1350lm*
Voltage	120-277V
Color Temperature	3000K
CRI (Ra)	80CRI
Optional Color Temps	2700K - 5000K Available, Minimum Order Quantities Apply
LED Rated Life	50,000 hours
Dimming	100% - 10%, TRIAC or ELV Dimmer (Not Included)
Location	Wet
Illumination Direction	Down

* For custom options, consult factory for details.
* For warranty information, please visit www.kuzcolighting.com/warranty

KUZCO

CANADA: 19054 28TH AVENUE - SURREY, BC V3Z 6M3
USA: 3035 E. LONE MOUNTAIN ROAD - LAS VEGAS, NV 89081

WWW.KUZCOLIGHTING.COM

© 2023 KUZCO LIGHTING. ALL RIGHTS RESERVED.

COMMENT

Intertek